


# **OIL ANALYSIS REPORT**

Sample Rating Trend



ISO

Machine Id

# KAESER BSD 40 5625545 (S/N 1027)

Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

#### Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of particulates present in the oil.


#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		0ct2018	Mar2019 Nov2018	AprŽ021 AprŽ022	May/2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC130807	KC104382	KC90205
Sample Date		Client Info		22 May 2024	27 Apr 2022	08 Apr 2021
Machine Age	hrs	Client Info		22778	14859	12202
Oil Age	hrs	Client Info		6000	2657	3000
Oil Changed		Client Info		Changed	Changed	Changed
Sample Status				ATTENTION	ATTENTION	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	0	<1	0
Aluminum	ppm	ASTM D5185m	>10	0	<1	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	9	7	13
Tin	ppm	ASTM D5185m	>10	0	<1	<1
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	<1	<1
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	<1	21
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m	90	5	33	24
Calcium	ppm	ASTM D5185m	2	0	<1	0
Phosphorus	ppm	ASTM D5185m		0	6	1
Zinc	ppm	ASTM D5185m		138	175	214
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	<1
Sodium	ppm	ASTM D5185m		7	18	16
Potassium	ppm	ASTM D5185m	>20	2	4	4
Water	%	ASTM D6304	>0.05	0.010	0.017	0.023
ppm Water	ppm	ASTM D6304	>500	105	172.6	236.0
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		2579	2677	1755
Particles >6µm		ASTM D7647	>1300	1039	938	763
Particles >14µm		ASTM D7647	>80	111	133	<u>^</u> 204
Particles >21µm		ASTM D7647	>20	<b>26</b>	30	<u></u> ▲ 61
Particles >38µm		ASTM D7647	>4	0	2	3
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	<b>19/17/14</b>	19/17/14	<b>△</b> 17/15
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.41	0.37	0.384



## **OIL ANALYSIS REPORT**

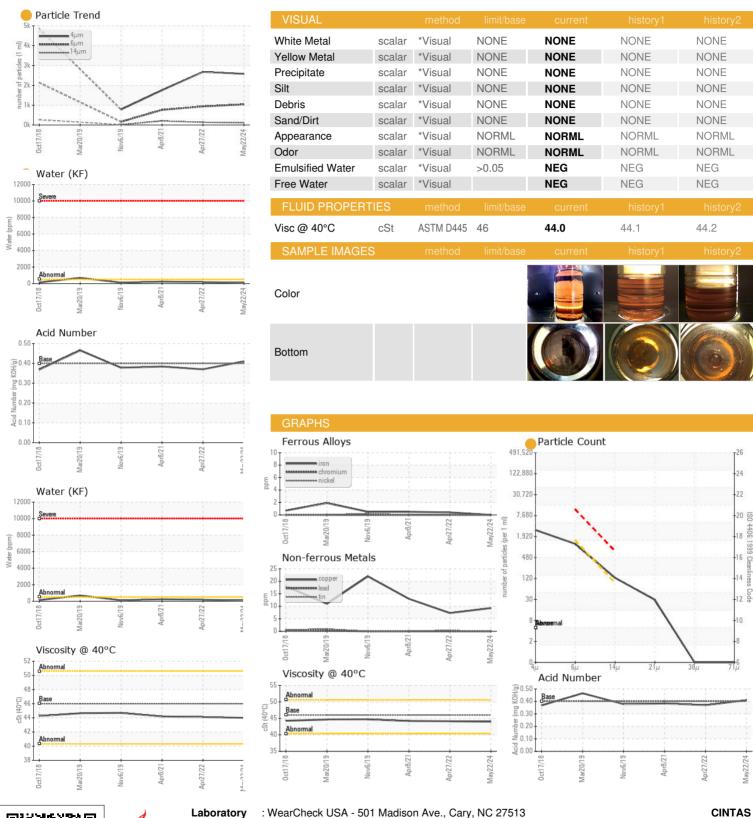





Certificate 12367

Laboratory

Sample No. : KC130807 Lab Number : 06200775 Unique Number : 11062898

Received : 05 Jun 2024 **Tested** : 06 Jun 2024

Diagnosed : 07 Jun 2024 - Don Baldridge Test Package : IND 2

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

LADSON, SC

Contact: Service Manager

LIS

T:

F: