

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

KAESER 8405413

Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Apr2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC06200778		
Sample Date		Client Info		04 Apr 2024		
Machine Age	hrs	Client Info		101		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	8		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	<1		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	4		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	1		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m	>10	<1		
Cadmium	ppm	ASTM D5185m		0		
Caumum	ррпп	ASTIVI DOTOSIII		<u> </u>		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	90	27		
Calcium	ppm	ASTM D5185m	2	0		
Phosphorus	ppm	ASTM D5185m		0		
Zinc	ppm	ASTM D5185m		19		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon		ASTM D5185m	>25	<1		
Sodium	ppm		>20	10		
	ppm	ASTM D5185m	. 00			
Potassium	ppm	ASTM D5185m	>20	9		
Water	%	ASTM D6304	>0.05	0.019		
ppm Water	ppm	ASTM D6304	>500	197		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		2107		
Particles >6µm		ASTM D7647	>1300	716		
Particles >14µm		ASTM D7647	>80	67		
Particles >21µm		ASTM D7647	>20	19		
Particles >38μm		ASTM D7647	>4	1		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/17/13		
FLUID DEGRADA	TION _	method	limit/base	current	history1	history2


Acid Number (AN)

mg KOH/g ASTM D8045 0.4

0.33



OIL ANALYSIS REPORT

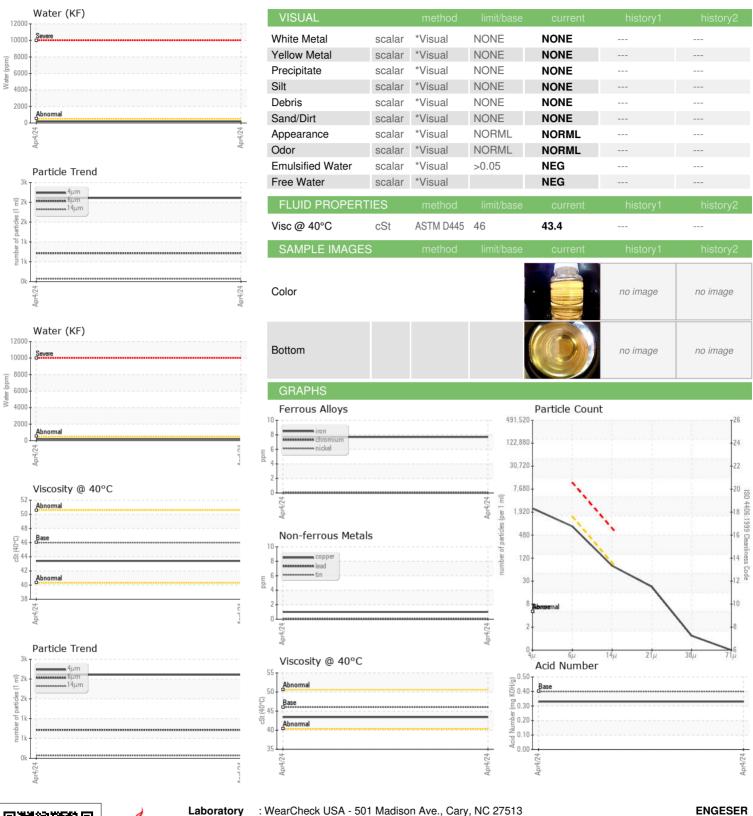



Certificate 12367

Laboratory

Sample No. Lab Number : 06200778

: KC06200778 Unique Number : 11062901 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 05 Jun 2024 **Tested** : 06 Jun 2024

Diagnosed : 07 Jun 2024 - Don Baldridge 115 FABRICATORS ST SUMMERVILLE, SC US 29483

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: