

OIL ANALYSIS REPORT

Sample Rating Trend

....................

NORMAL

Machine Id

KAESER 510473-MK METALS FOILS

Component Compressor

Fluid KAESER SIGMA (OEM) S-460 (5 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORM	1ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0915365	WC0863733	WC0758158
Sample Date		Client Info		23 May 2024	12 Dec 2023	15 Dec 2022
Machine Age	hrs	Client Info		4379	4261	2660
Oil Age	hrs	Client Info		0	20000	292
Oil Changed		Client Info		Not Changd	Changed	Not Changd
Sample Status				NORMAL	NORMAL	NORMAL
CONTAMINATION	١	method	limit/base	current	history1	history2
Water		WC Method	>0.05	NEG	NEG	NEG
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	<1
Chromium	ppm	ASTM D5185m	>10	0	<1	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	5	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	<1	3	0
Tin	ppm	ASTM D5185m	>10	0	0	0
Vanadium	ppm	ASTM D5185m		<1	<1	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	2	0	<1
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m	90	65	0	83
Calcium	ppm	ASTM D5185m	2	0	0	<1
Phosphorus	ppm	ASTM D5185m		0	33	1
Zinc	ppm	ASTM D5185m		19	0	27
Sulfur	ppm	ASTM D5185m		21706	3946	21448
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	<1
Sodium	ppm	ASTM D5185m		19	7	23
Potassium	ppm	ASTM D5185m	>20	2	2	<1
FLUID DEGRADA	TION	method	limit/base	current	history1	history2




OIL ANALYSIS REPORT

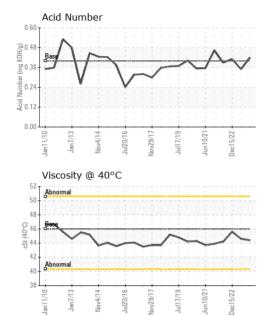

11 Print

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT		method	limit/base	current	biotorut	biotors/0
	IE0	methoa	iiiiii/base	Current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.4	44.6	45.6
	cSt				· · · · · ·	
Visc @ 40°C	cSt	ASTM D445	46	44.4	44.6	45.6
Visc @ 40°C SAMPLE IMAGES	cSt	ASTM D445	46	44.4	44.6	45.6

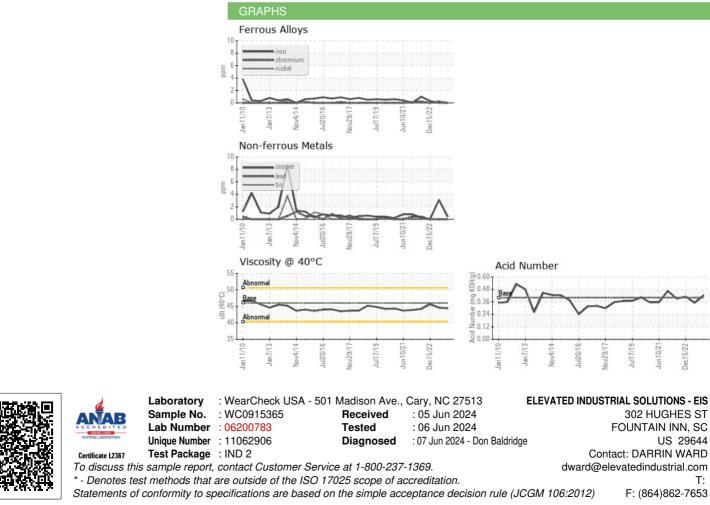

Contact/Location: DARRIN WARD - PALFOU