


OIL ANALYSIS REPORT

Area [2608] **QUNCY 92057J - SCHAEFFLER**

Compressor

ULTRACHEM PO 4010 (--- GAL)



Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0863565	WC0863527	
Sample Date		Client Info		09 Apr 2024	30 Oct 2023	
Machine Age	hrs	Client Info		19285	0	
Oil Age	hrs	Client Info		2000	3000	
Oil Changed		Client Info		Not Changd	Not Changd	
Sample Status				NORMAL	NORMAL	
CONTAMINATIO	N	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG	NEG	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	1	
Chromium	ppm	ASTM D5185m	>10	0	<1	
Nickel	ppm	ASTM D5185m		0	0	
Titanium	ppm	ASTM D5185m		<1	0	
Silver	ppm	ASTM D5185m		0	0	
Aluminum	ppm	ASTM D5185m	>25	<1	2	
Lead	ppm	ASTM D5185m	>25	0	0	
Copper	ppm	ASTM D5185m	>50	2	1	
Tin	ppm	ASTM D5185m	>15	<1	0	
Vanadium	ppm	ASTM D5185m		<1	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	0.4	0	0	
Molybdenum	ppm	ASTM D5185m	0.5	0	0	
Manganese	ppm	ASTM D5185m	0.4	<1	0	
Magnesium	ppm	ASTM D5185m	0	0	0	
Calcium	ppm	ASTM D5185m	0.3	0	0	
Phosphorus	ppm	ASTM D5185m	1376	694	452	
Zinc	ppm	ASTM D5185m	0	11	0	
Sulfur	ppm	ASTM D5185m	320	1299	516	
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	
Sodium	ppm	ASTM D5185m		2	6	
Potassium	ppm	ASTM D5185m	>20	<1	<1	
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.573	0.64	0.56	





OIL ANALYSIS REPORT

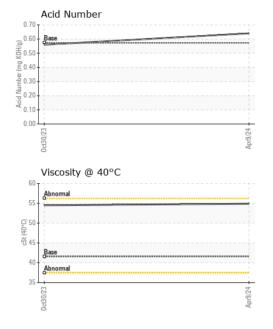
















Laboratory Sample No.

: WC0863565 **Lab Number** : 06200802

Unique Number : 11062925 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 05 Jun 2024 **Tested**

: 06 Jun 2024 Diagnosed : 07 Jun 2024 - Don Baldridge

ELEVATED INDUSTRIAL SOLUTIONS - EIS

302 HUGHES ST FOUNTAIN INN, SC US 29644

Contact: DARRIN WARD dward@elevatedindustrial.com

F: (864)862-7653

Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) T: