


## **OIL ANALYSIS REPORT**

Sample Rating Trend

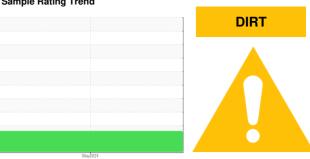

Machine Id

# **INGERSOLL RAND CBV854021 - CAMPING WORLD**

Compressor

{not provided} (--- GAL)

### DIAGNOSIS

#### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

### Contamination

Elemental level of silicon (Si) above normal indicating ingress of dirt/seal material.


#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0915357		
Sample Date		Client Info		15 May 2024		
Machine Age	hrs	Client Info		5438		
Oil Age	hrs	Client Info		5438		
Oil Changed		Client Info		Not Changd		
Sample Status				ABNORMAL		
CONTAMINATION		method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		<1		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	0		
Lead	ppm	ASTM D5185m	>25	0		
Copper	ppm	ASTM D5185m	>50	<1		
Tin	ppm	ASTM D5185m	>15	1		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		393		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		8		
Phosphorus	ppm	ASTM D5185m		0		
Zinc	ppm	ASTM D5185m		77		
Sulfur	ppm	ASTM D5185m		1053		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>69</b>		
Sodium	ppm	ASTM D5185m		31		
Potassium	ppm	ASTM D5185m	>20	2		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.23		



## **OIL ANALYSIS REPORT**

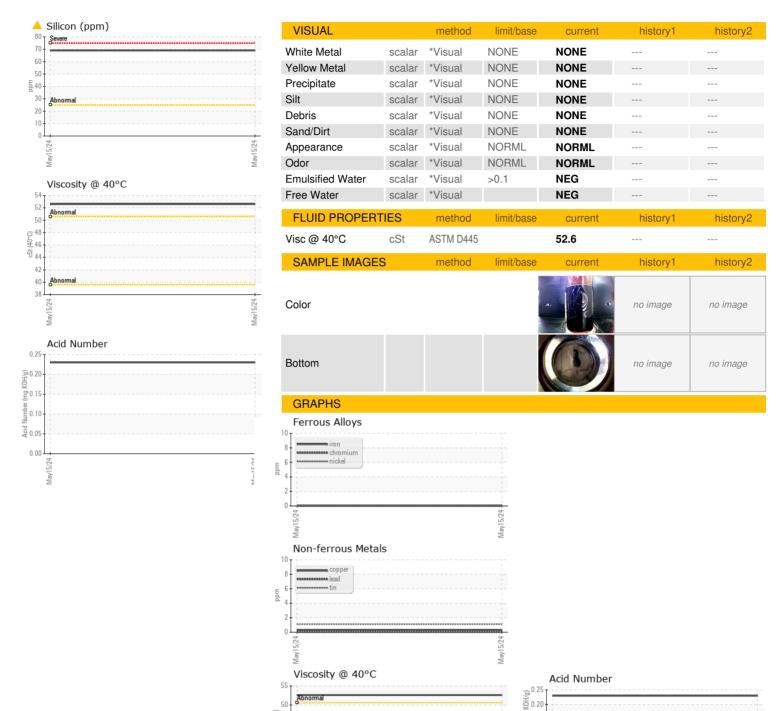





Certificate 12367

Laboratory Sample No.

: WC0915357 Lab Number : 06200809 Unique Number : 11062932 Test Package : IND 2

To discuss this sample report, contact Customer Service at 1-800-237-1369.

(40°C)

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 05 Jun 2024

**Tested** : 06 Jun 2024 Diagnosed : 07 Jun 2024 - Don Baldridge

£ 0.15 은 0.10 0.05 0.00

> **ELEVATED INDUSTRIAL SOLUTIONS - EIS** 302 HUGHES ST

FOUNTAIN INN, SC US 29644

Contact: DARRIN WARD dward@elevatedindustrial.com

 $^st$  - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: DARRIN WARD - PALFOU

T: