


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id

KAESER 5759312 - ARAMARK (S/N 1296)

Component Compressor

KAESER SIGMA (OEM) S-460 (5 GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		0012019	Nov2UZ1	0012022	May2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0915362	WC0730220	WC0730222
Sample Date		Client Info		23 May 2024	26 Oct 2022	26 Oct 2022
Machine Age	hrs	Client Info		25007	18115	16715
Oil Age	hrs	Client Info		600	2000	1500
Oil Changed		Client Info		Not Changd	Not Changd	Not Changd
Sample Status				NORMAL	NORMAL	NORMAL
CONTAMINATION		method	limit/base	current	history1	history2
Water		WC Method	>0.05	NEG	NEG	NEG
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	<1	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	5	6	8
Tin	ppm	ASTM D5185m	>10	0	<1	<1
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m	90	45	34	27
Calcium	ppm	ASTM D5185m	2	0	0	0
Phosphorus	ppm	ASTM D5185m		0	2	2
Zinc	ppm	ASTM D5185m		56	100	73
Sulfur	ppm	ASTM D5185m		21198	21841	21129
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	<1
Sodium	ppm	ASTM D5185m		23	16	12
Potassium	ppm	ASTM D5185m	>20	5	5	4
FLUID DEGRADATION		method	limit/base	current	history1	history2

0.38

Acid Number (AN)


mg KOH/g ASTM D8045 0.4

0.34


0.32



OIL ANALYSIS REPORT

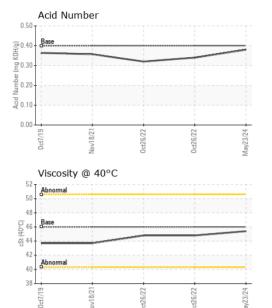

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	TES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	45.4	44.8	44.8
SAMPLE IMAGES		method	limit/base	current	history1	history2
Color					n à x x x x x x x x x x x x x x x x x x	E ATRIBU
Bottom						

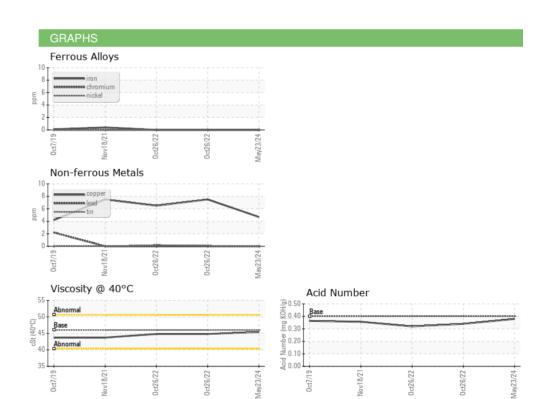





Laboratory Sample No.

Lab Number : 06200813

: WC0915362 Unique Number : 11062936

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received

: 05 Jun 2024 **Tested** : 06 Jun 2024 Diagnosed : 07 Jun 2024 - Don Baldridge

ELEVATED INDUSTRIAL SOLUTIONS - EIS 302 HUGHES ST FOUNTAIN INN, SC US 29644 Contact: DARRIN WARD

Test Package : IND 2 Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

dward@elevatedindustrial.com T:

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: DARRIN WARD - PALFOU

F: (864)862-7653