


# **OIL ANALYSIS REPORT**

Sample Rating Trend







HUSKY 2
Component

Hydraulic System

FIRE-RESISTANT FLUID ISO 46 (--- GAL)

### DIAGNOSIS

## Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

## Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.


## **Fluid Condition**


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


w/2021 Aug/2021 New/2021 Apr/2022 Sep/2022 Mar/2023 Oc/2023 Mar/2024						
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		PTK0005071	PTK0005070	PTK0005073
Sample Date		Client Info		30 May 2024	18 Mar 2024	24 Jan 2024
Machine Age	mths	Client Info		0	0	0
Oil Age	mths	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	<1	2	0
Chromium	ppm	ASTM D5185m	>10	<1	<1	<1
Nickel	ppm	ASTM D5185m	>10	0	0	0
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>10	2	0	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>75	1	0	0
Tin	ppm	ASTM D5185m	>10	<1	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	5	0	0	0
Barium	ppm	ASTM D5185m	5	<1	0	0
Molybdenum	ppm	ASTM D5185m	5	0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	5	<1	0	0
Calcium	ppm	ASTM D5185m	50	1	<1	0
Phosphorus	ppm	ASTM D5185m	175	133	99	104
Zinc	ppm	ASTM D5185m	62	17	24	27
Sulfur	ppm	ASTM D5185m	500	0	90	81
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>20	4	4	4
Sodium	ppm	ASTM D5185m		0	0	0
Potassium	ppm	ASTM D5185m	>20	1	0	0
Water	%	ASTM D6304	>55	NEG	NEG	NEG
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1093	349	329
Particles >6μm		ASTM D7647	>2500	282	68	73
Particles >14μm		ASTM D7647	>320	21	6	13
Particles >21µm		ASTM D7647		6	2	3
Particles >38μm		ASTM D7647	>20	1	1	0
Particles >71μm		ASTM D7647	>4	1	0	0
Oil Cleanliness		ISO 4406 (c)	>/18/15	17/15/12	16/13/10	16/13/11
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	3.63	0.49	0.541	0.53




## **OIL ANALYSIS REPORT**









VISUAL		method				history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
<b>Emulsified Water</b>	scalar	*Visual	>55	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG


Visc @ 40°C	cSt	ASTM D445	46	46.2	45.8	45.6

AIVIE	LE I	IIVIA	GES		

Color

**Bottom** 



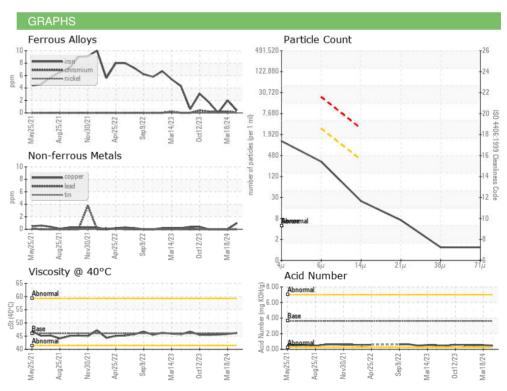





Certificate 12367

Laboratory Sample No.

Lab Number : 06201472

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : PTK0005071 Unique Number : 11063595

Test Package : MOB 2 ( Additional Tests: KF, pH, ReserveAlk )

Received **Tested** Diagnosed

: 06 Jun 2024 : 11 Jun 2024

: 11 Jun 2024 - Jonathan Hester

Contact: BEN POKLEMBO bpoklembo@niagarawater.com

To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**NIAGARA BOTTLING** 

201 SOLAR DR

IMPERIAL, PA

US 15126

T:

F: