




OIL ANALYSIS REPORT

Sample Rating Trend

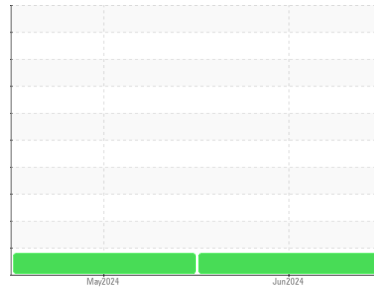

WEAR



Machine Id
RECLAIM TANK
 Component
Refrigeration Compressor
 Fluid
USPI 1009-68 SC (--- GAL)

DIAGNOSIS

▲ Recommendation

This is a baseline read-out on the submitted sample.

▲ Wear

The iron level is abnormal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| SAMPLE INFORMATION | | method | limit/base | current | history1 | history2 |
|--------------------|-------------|-------------|------------|--------------------|-------------|----------|
| Sample Number | Client Info | | | USP0012507 | USP0011101 | --- |
| Sample Date | Client Info | | | 03 Jun 2024 | 01 May 2024 | --- |
| Machine Age | mths | Client Info | | 0 | 0 | --- |
| Oil Age | mths | Client Info | | 0 | 0 | --- |
| Oil Changed | Client Info | | | N/A | N/A | --- |
| Sample Status | | | | ABNORMAL | ABNORMAL | --- |

| WEAR METALS | | method | limit/base | current | history1 | history2 |
|-------------|-----|-------------|------------|--------------|----------|----------|
| Iron | ppm | ASTM D5185m | >8 | ▲ 34 | ▲ 42 | --- |
| Chromium | ppm | ASTM D5185m | >2 | <1 | 0 | --- |
| Nickel | ppm | ASTM D5185m | | <1 | 0 | --- |
| Titanium | ppm | ASTM D5185m | | <1 | <1 | --- |
| Silver | ppm | ASTM D5185m | >2 | 0 | 0 | --- |
| Aluminum | ppm | ASTM D5185m | >3 | 2 | 1 | --- |
| Lead | ppm | ASTM D5185m | >2 | 0 | 0 | --- |
| Copper | ppm | ASTM D5185m | >8 | <1 | <1 | --- |
| Tin | ppm | ASTM D5185m | >4 | <1 | 0 | --- |
| Vanadium | ppm | ASTM D5185m | | 0 | 0 | --- |
| Cadmium | ppm | ASTM D5185m | | <1 | 0 | --- |

| ADDITIVES | | method | limit/base | current | history1 | history2 |
|------------|-----|-------------|------------|--------------|----------|----------|
| Boron | ppm | ASTM D5185m | | 0 | 0 | --- |
| Barium | ppm | ASTM D5185m | | <1 | 0 | --- |
| Molybdenum | ppm | ASTM D5185m | | 0 | 0 | --- |
| Manganese | ppm | ASTM D5185m | | 0 | 0 | --- |
| Magnesium | ppm | ASTM D5185m | | 0 | 0 | --- |
| Calcium | ppm | ASTM D5185m | | 0 | 0 | --- |
| Phosphorus | ppm | ASTM D5185m | | 2 | 0 | --- |
| Zinc | ppm | ASTM D5185m | | <1 | 0 | --- |
| Sulfur | ppm | ASTM D5185m | 50 | 18 | 0 | --- |






| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
|--------------|-----|-------------|------------|--------------|----------|----------|
| Silicon | ppm | ASTM D5185m | >15 | 4 | 4 | --- |
| Sodium | ppm | ASTM D5185m | | 0 | 0 | --- |
| Potassium | ppm | ASTM D5185m | >20 | <1 | <1 | --- |
| Water | % | ASTM D6304 | >0.01 | 0.006 | 0.001 | --- |
| ppm Water | ppm | ASTM D6304 | >100 | 69 | 2 | --- |

| FLUID CLEANLINESS | | method | limit/base | current | history1 | history2 |
|-------------------|--|--------------|------------|-----------------|----------|----------|
| Particles >4µm | | ASTM D7647 | >10000 | 1099 | 187 | --- |
| Particles >6µm | | ASTM D7647 | >2500 | 268 | 46 | --- |
| Particles >14µm | | ASTM D7647 | >320 | 13 | 8 | --- |
| Particles >21µm | | ASTM D7647 | >80 | 3 | 2 | --- |
| Particles >38µm | | ASTM D7647 | >20 | 0 | 0 | --- |
| Particles >71µm | | ASTM D7647 | >4 | 0 | 0 | --- |
| Oil Cleanliness | | ISO 4406 (c) | >20/18/15 | 17/15/11 | 15/13/10 | --- |

| FLUID DEGRADATION | | method | limit/base | current | history1 | history2 |
|-------------------|----------|-----------|------------|--------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D974 | 0.005 | 0.014 | 0.014 | --- |




OIL ANALYSIS REPORT

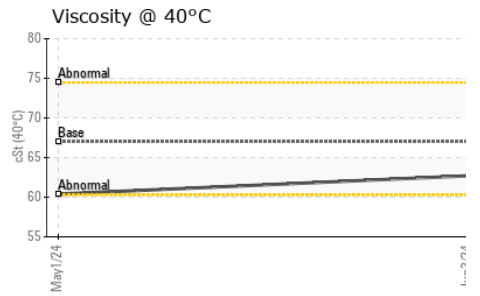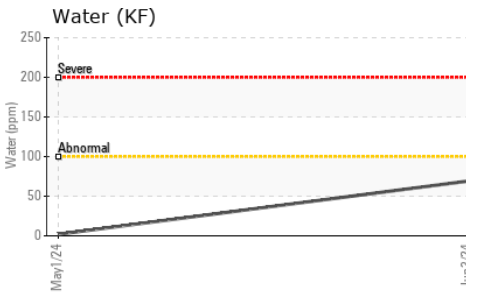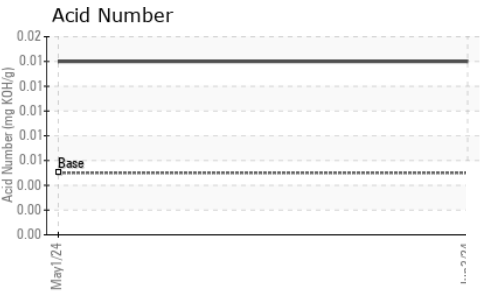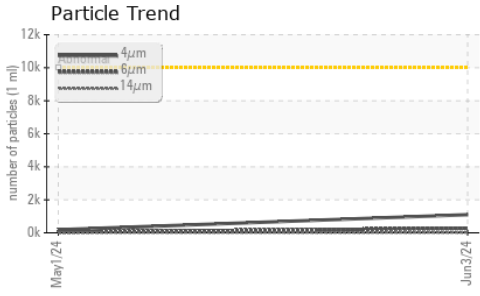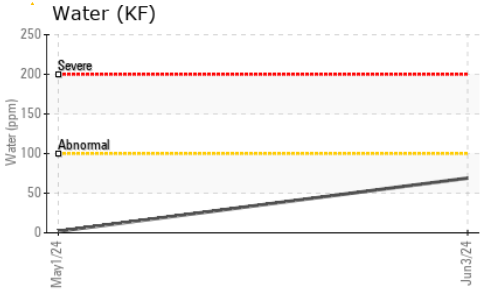






| VISUAL | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|--------------|----------|
| White Metal | scalar | *Visual | NONE | NONE | --- |
| Yellow Metal | scalar | *Visual | NONE | NONE | --- |
| Precipitate | scalar | *Visual | NONE | NONE | --- |
| Silt | scalar | *Visual | NONE | NONE | --- |
| Debris | scalar | *Visual | NONE | LIGHT | NONE |
| Sand/Dirt | scalar | *Visual | NONE | NONE | --- |
| Appearance | scalar | *Visual | NORML | NORML | --- |
| Odor | scalar | *Visual | NORML | NORML | --- |
| Emulsified Water | scalar | *Visual | >0.01 | NEG | NEG |
| Free Water | scalar | *Visual | | NEG | NEG |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|--------------|-------------|----------|----------|
| Visc @ 40°C | cSt | ASTM D445 67 | 62.7 | 60.4 | --- |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

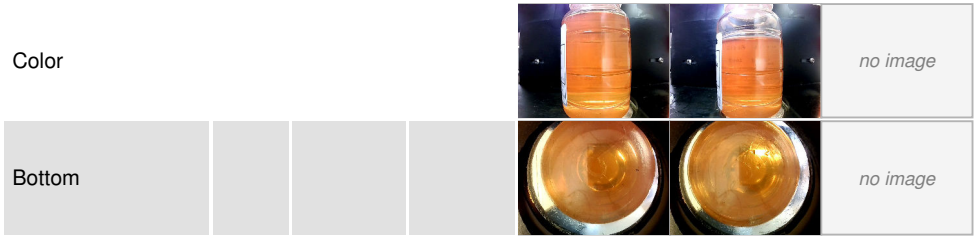

GRAPHS

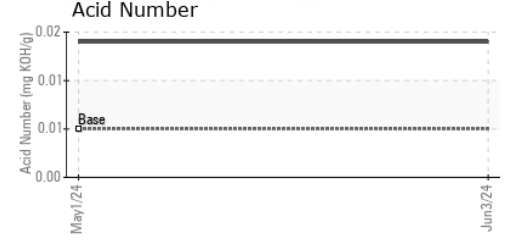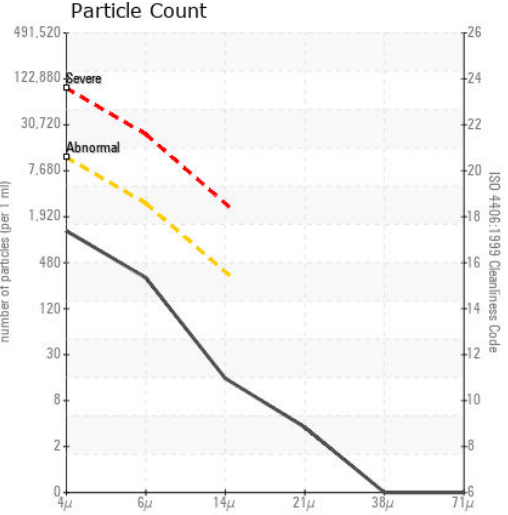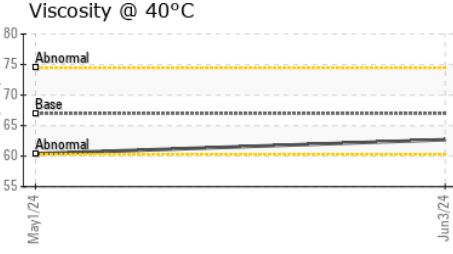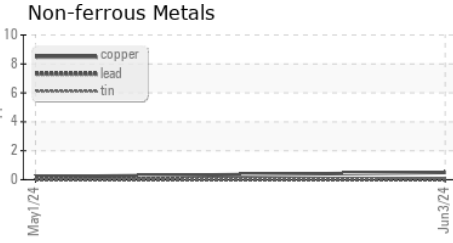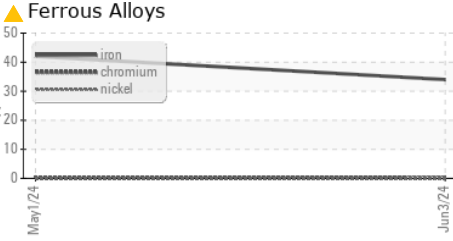

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : USP0012507 **Received** : 06 Jun 2024
Lab Number : **06201531** **Tested** : 07 Jun 2024
Unique Number : 11063654 **Diagnosed** : 11 Jun 2024 - Doug Bogart
Test Package : IND 2

JBS-OTTUMWA
 600 SOUTH IOWA AVENUE
 OTTUMWA, IA 52501
 Contact: LISA PIERCE
 lisa_pierce@cargill.com
 T: (641)683-4741
 F: (641)683-4731

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)