




# OIL ANALYSIS REPORT

Sample Rating Trend

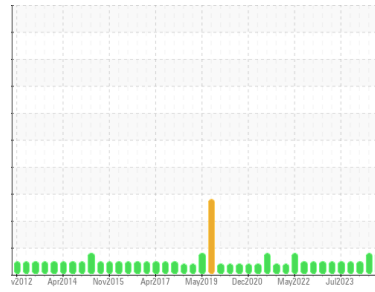

ISO



Machine Id

## SOUTH ER: B-5 (S/N CFFCB B-5)

Component

### Refrigeration Compressor

Fluid

### USPI ALT-68 SC (175 GAL)

#### DIAGNOSIS

##### Recommendation

Resample at the next service interval to monitor.

##### Wear

All component wear rates are normal.

##### Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

##### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

#### SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>USP0012520</b>	USP0005900	USP0004417
Sample Date	Client Info	<b>29 May 2024</b>	12 Mar 2024	18 Dec 2023
Machine Age	hrs	<b>0</b>	0	0
Oil Age	hrs	<b>0</b>	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>ABNORMAL</b>	ATTENTION	NORMAL

#### WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >8	<b>1</b>	0	0
Chromium	ppm	ASTM D5185m >2	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >3	<b>0</b>	0	0
Lead	ppm	ASTM D5185m >2	<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185m >8	<b>&lt;1</b>	0	0
Tin	ppm	ASTM D5185m >4	<b>&lt;1</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

#### ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Calcium	ppm	ASTM D5185m	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	<b>1</b>	0	0
Zinc	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Sulfur	ppm	ASTM D5185m 50	<b>0</b>	0	9

#### CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >15	<b>2</b>	1	1
Sodium	ppm	ASTM D5185m	<b>0</b>	<1	0
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	0
Water	%	ASTM D6304 >0.01	<b>0.005</b>	0.003	0.002
ppm Water	ppm	ASTM D6304 >100	<b>56</b>	37	23






#### FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	<b>40352</b>	16522	29553
Particles >6µm	ASTM D7647 >2500	<b>8064</b>	2529	2459
Particles >14µm	ASTM D7647 >320	<b>176</b>	60	36
Particles >21µm	ASTM D7647 >80	<b>19</b>	8	5
Particles >38µm	ASTM D7647 >20	<b>1</b>	0	0
Particles >71µm	ASTM D7647 >4	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c) >--/18/15	<b>23/20/15</b>	21/19/13	22/18/12

#### FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D974 0.005	<b>0.014</b>	0.014	0.012


# OIL ANALYSIS REPORT

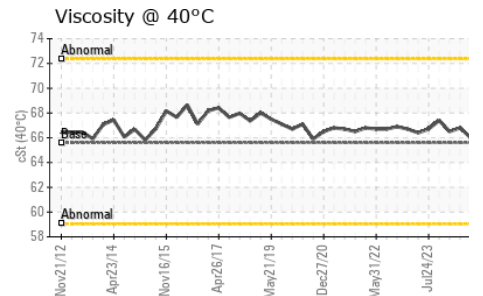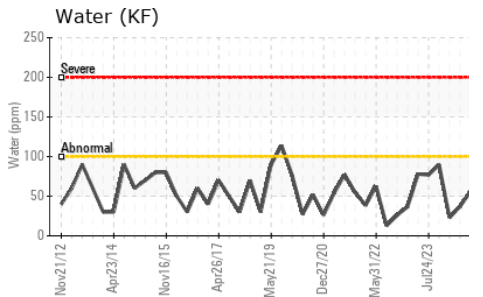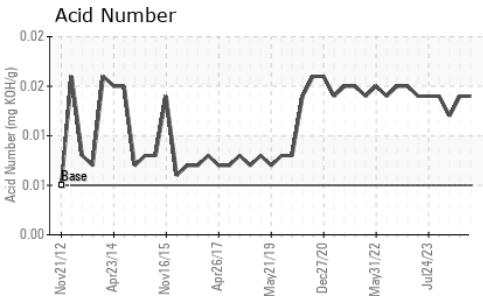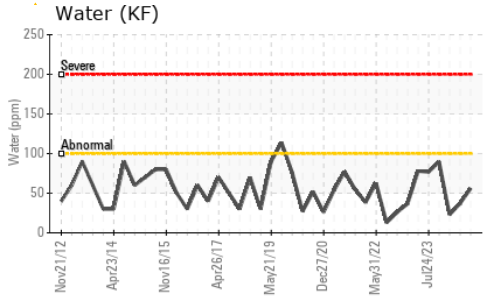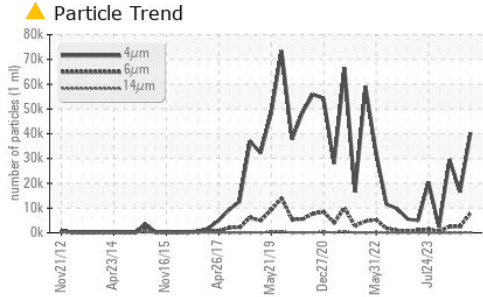






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	65.6	66.0	66.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

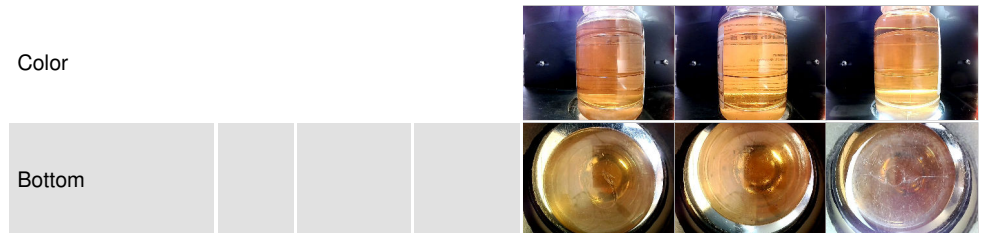

## GRAPHS

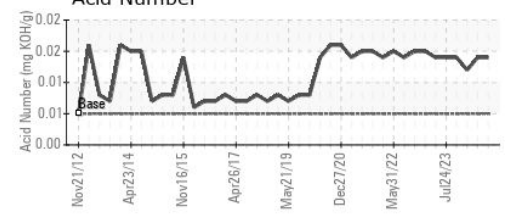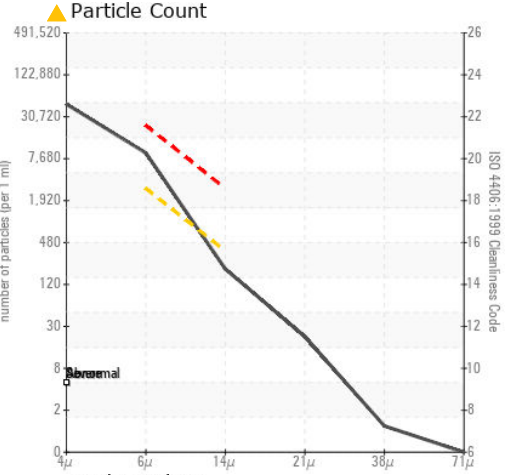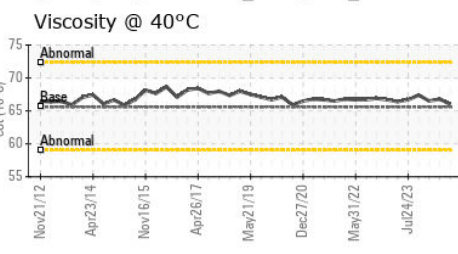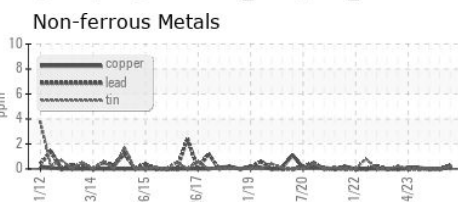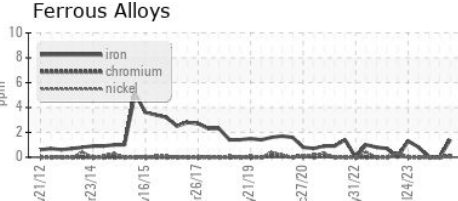

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USP0012520      **Received** : 06 Jun 2024  
**Lab Number** : 06201533      **Tested** : 07 Jun 2024  
**Unique Number** : 11063656      **Diagnosed** : 11 Jun 2024 - Doug Bogart  
**Test Package** : IND 2

**CONAGRA-COUNCIL BLUFFS-USPI**  
 1023 4TH STREET  
 COUNCIL BLUFFS, IA  
 US 51503  
 Contact: CRAIG BARR

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)