

OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

Machine Id **RECYCLED NH3 (S/N SCC1918**

Refrigeration Compressor

USPI ALT-68 SC (--- GAL)

DIAGNOSIS

Recommendation

This is a baseline read-out on the submitted sample. DRUM 245

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


(19180005)						
		g2021 May20	22 Sep2022 Dec2022	Mar2023 Aug2023 Dec2023 I	Aar2024	
SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0012526	USP0012817	USP0006474
Sample Date		Client Info		03 Jun 2024	20 May 2024	19 Apr 2024
Machine Age	days	Client Info		0	0	0
Oil Age	days	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	0	4	0
Chromium	ppm	ASTM D5185m	>2	<1	0	<1
Nickel	ppm	ASTM D5185m		0	0	<1
Titanium	ppm	ASTM D5185m		<1	<1	<1
Silver	ppm	ASTM D5185m	>2	0	<1	0
Aluminum	ppm	ASTM D5185m	>3	0	0	0
Lead	ppm	ASTM D5185m	>2	0	<1	<1
Copper	ppm	ASTM D5185m	>8	<1	0	<1
Tin	ppm	ASTM D5185m	>4	<1	<1	<1
Vanadium	ppm	ASTM D5185m		0	<1	<1
Cadmium	ppm	ASTM D5185m		0	<1	<1
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		<1	0	0
Molybdenum	ppm	ASTM D5185m		0	0	<1
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m		0	<1	<1
Calcium	ppm	ASTM D5185m		0	0	0
Phosphorus	ppm	ASTM D5185m		<1	<1	0
Zinc	ppm	ASTM D5185m		0	0	0
Sulfur	ppm	ASTM D5185m		0	3	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm		>15	2	2	3
Sodium	ppm	ASTM D5185m		0	<1	1
Potassium	ppm	ASTM D5185m	>20	1	1	<1
Water	%	ASTM D6304		0.002	0.002	0.006
ppm Water	ppm	ASTM D6304	>100	23	20	65
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		2674	1738	5900
Particles >6µm		ASTM D7647	>2500	319	177	690
Particles >14µm		ASTM D7647	>320	3	10	7
Particles >21µm		ASTM D7647	>80	0	3	1
Particles >38µm		ASTM D7647	>20	0	0	0
Particles >71µm		ASTM D7647	>4	0	0	0


ASTM D7647 >4 0 0 0 **Oil Cleanliness** ISO 4406 (c) >--/18/15 19/15/9 18/15/10 20/17/10 FLUID DEGRADATION 0.014 Acid Number (AN) mg KOH/g ASTM D974 0.005 0.014 0.014





OIL ANALYSIS REPORT












VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	IES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	65.6	62.9	64.3	63.6
SAMPLE IMAGES	5	method	limit/base	current	history1	history2
Color				· · · · ·	A Recycled a Danny H Lan when and when the second when the second whe	DRUM 241
Bottom						

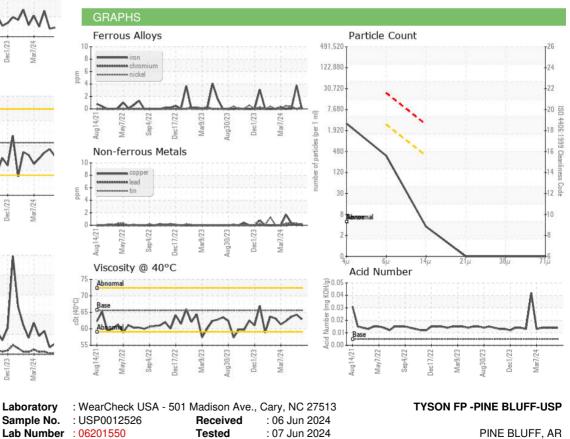



Unique Number : 11063673 Test Package : IND 2 Certificate 12367

Tested : 07 Jun 2024 Diagnosed : 11 Jun 2024 - Doug Bogart

PINE BLUFF, AR US 71602 Contact: RICHARD RICKELS

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: TYSPBFP [WUSCAR] 06201550 (Generated: 06/11/2024 12:21:14) Rev: 1

Contact/Location: RICHARD RICKELS - TYSPBFP

T:

F:

11