


OIL ANALYSIS REPORT

Area CAPL **CAPL 7.2 BRIDLE NO.7 (S/N 16-3100-0806)** Gearbox



Sample Rating Trend



Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

GEAR OIL ISO 320 (--- QTS)

Contamination

There is no indication of any contamination in the

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		RP0044211	RP0034982	RP0030703
Sample Date		Client Info		05 Jun 2024	03 Aug 2023	02 Feb 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184		33	27	50
Iron	ppm	ASTM D5185m	>200	69	68	83
Chromium	ppm	ASTM D5185m	>15	<1	<1	<1
Nickel	ppm	ASTM D5185m	>15	<1	0	0
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	2	<1	0
Lead	ppm	ASTM D5185m	>100	0	0	0
Copper	ppm	ASTM D5185m	>200	<1	<1	0
Tin	ppm	ASTM D5185m	>25	<1	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	50	19	18	20
Barium	ppm	ASTM D5185m	15	5	4	5
Molybdenum	ppm	ASTM D5185m	15	<1	0	0
Manganese	ppm	ASTM D5185m		<1	1	1
Magnesium	ppm	ASTM D5185m	50	<1	2	<1
Calcium	ppm	ASTM D5185m	50	6	13	51
Phosphorus	ppm	ASTM D5185m	350	165	188	185
Zinc	ppm	ASTM D5185m	100	22	15	27
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	6	5	3
Sodium	ppm	ASTM D5185m		0	1	0
Potassium	ppm	ASTM D5185m	>20	1	<1	<1
Water	%	ASTM D6304	>0.2	0.002	0.029	0.010
ppm Water	ppm	ASTM D6304	>2000	18	293.7	106.1
FLUID DEGRADA	TION	method	limit/base	current	history1	history2

0.73

Acid Number (AN)


mg KOH/g ASTM D8045 0.85


0.78


0.64




OIL ANALYSIS REPORT










VISUAL		method				history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG


FLUID PROPER	THES	method	ilmit/base		nistory i	nistory2
Visc @ 40°C	cSt	ASTM D445	320	431	436	427

SAMPLE IMAGES	method		

Color





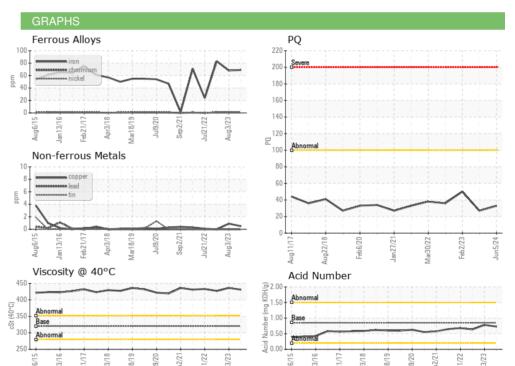





Certificate 12367

Laboratory Sample No.

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : RP0044211 Lab Number : 06201583

Unique Number : 11063706

Received : 06 Jun 2024 **Tested** Diagnosed

: 07 Jun 2024 : 09 Jun 2024 - Don Baldridge

Test Package : IND 2 (Additional Tests: PQ)

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

OUTOKUMPU STAINLESS USA

HWY 43 N CALVERT, AL

US 36513 Contact: MARIO JOHNSON Mario.johnson@outokumpu.com T: (251)321-4105

F: x: