




# OIL ANALYSIS REPORT

Sample Rating Trend

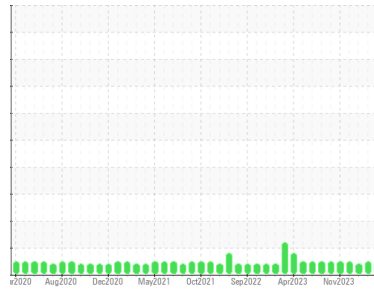

**NORMAL**



Area  
**Kentucky**  
 Machine Id  
**[Kentucky] Oil - Port Genset**  
 Component  
**Port Genset**  
 Fluid  
**DIESEL ENGINE OIL SAE 15W40 (7 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0874594</b>	WC0845802	WC0874825
Sample Date	Client Info			<b>25 May 2024</b>	25 Apr 2024	16 Mar 2024
Machine Age	hrs	Client Info		<b>20102</b>	19646	19011
Oil Age	hrs	Client Info		<b>639</b>	184	49
Oil Changed	Client Info			<b>Changed</b>	Not Changd	Changed
Sample Status				<b>NORMAL</b>	NORMAL	ABNORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method		>4.0	<b>&lt;1.0</b>	<1.0	<1.0
Glycol	WC Method			<b>NEG</b>	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>5</b>	4	3
Chromium	ppm	ASTM D5185m	>4	<b>0</b>	<1	<1
Nickel	ppm	ASTM D5185m	>2	<b>0</b>	<1	<1
Titanium	ppm	ASTM D5185m		<b>0</b>	<1	<1
Silver	ppm	ASTM D5185m	>5	<b>0</b>	<1	<1
Aluminum	ppm	ASTM D5185m	>12	<b>&lt;1</b>	2	2
Lead	ppm	ASTM D5185m	>17	<b>2</b>	2	<1
Copper	ppm	ASTM D5185m	>70	<b>&lt;1</b>	1	<1
Tin	ppm	ASTM D5185m	>15	<b>0</b>	<1	<1
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Cadmium	ppm	ASTM D5185m		<b>0</b>	<1	<1

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	250	<b>0</b>	15	7
Barium	ppm	ASTM D5185m	10	<b>0</b>	<1	0
Molybdenum	ppm	ASTM D5185m	100	<b>67</b>	97	61
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m	450	<b>1540</b>	2324	▲ 1392
Calcium	ppm	ASTM D5185m	3000	<b>1355</b>	1932	1189
Phosphorus	ppm	ASTM D5185m	1150	<b>1171</b>	1767	1187
Zinc	ppm	ASTM D5185m	1350	<b>1389</b>	2082	1298
Sulfur	ppm	ASTM D5185m	4250	<b>4009</b>	5698	3963

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>2</b>	5	4
Sodium	ppm	ASTM D5185m	>158	<b>6</b>	3	1
Potassium	ppm	ASTM D5185m	>20	<b>3</b>	2	2
Water	%	ASTM D6304	>0.1	<b>NEG</b>	NEG	NEG


INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		<b>0.3</b>	0.1	0.1
Nitration	Abs/cm	*ASTM D7624	>20	<b>9.2</b>	7.0	5.8
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>20.6</b>	19.1	18.7

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>16.5</b>	15.0	15.0
Base Number (BN)	mg KOH/g	ASTM D2896	8.5	<b>12.80</b>	12.42	11.83




# OIL ANALYSIS REPORT


### FT-IR (Direct Trend)

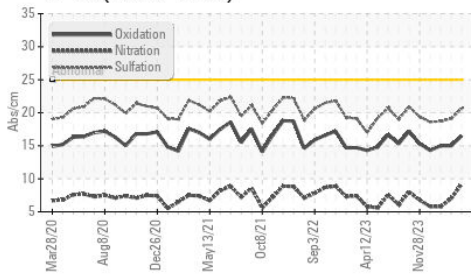


### Water (KF)

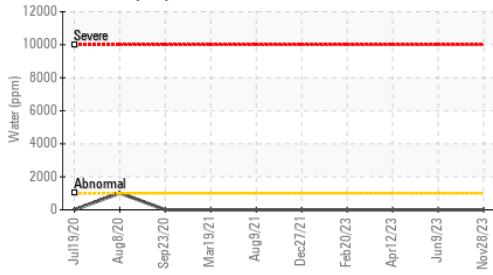

### Viscosity @ 100°C

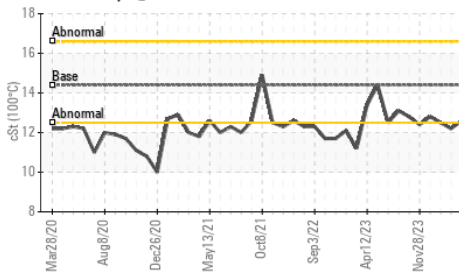

### Water (KF)

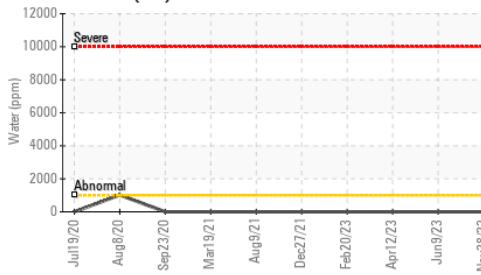


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.4	12.6	12.2

### GRAPHS


#### Ferrous Alloys

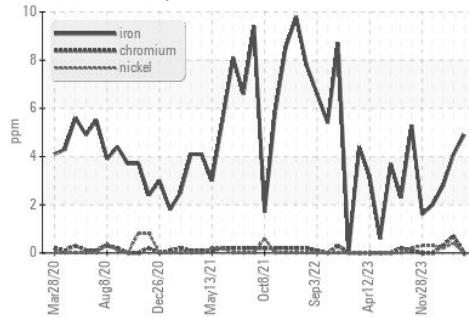


#### Non-ferrous Metals

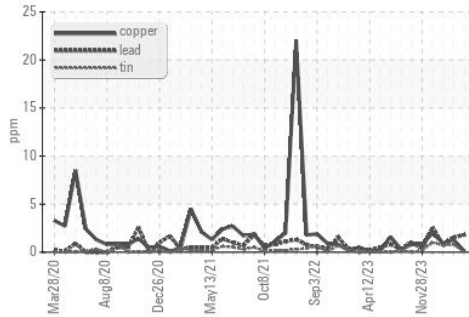

#### Viscosity @ 100°C

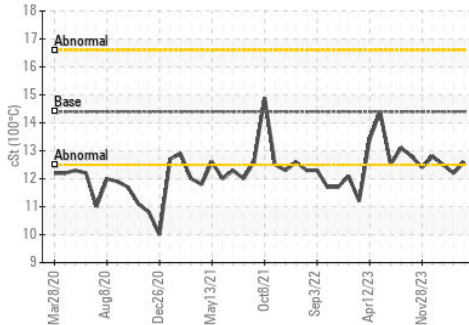

#### Base Number

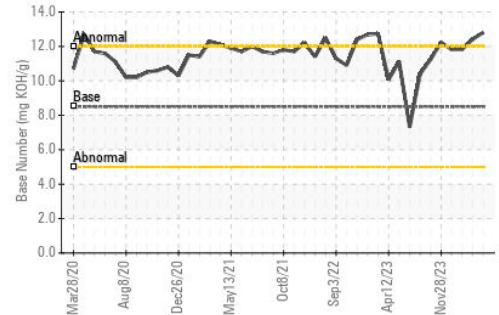

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0874594

Lab Number : 06201646

Unique Number : 11063769

Test Package : IND 2 ( Additional Tests: KF )

Received : 06 Jun 2024

Tested : 11 Jun 2024

Diagnosed : 11 Jun 2024 - Sean Felton

MARATHON PETROLEUM CO.

101 12TH ST

CATLETTSBURG, KY

US 41169

Contact: CORY GUMBERT

cagumbert@marathonpetroleum.com

T: (606)585-3950

F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)