




OIL ANALYSIS REPORT

Sample Rating Trend

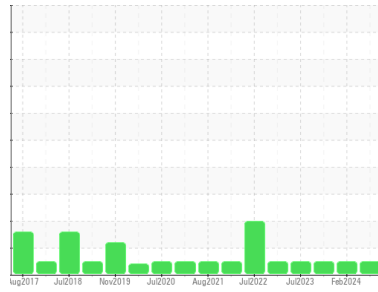

NORMAL



Area

63

Machine Id

[63] A63 SPQ 1 Fire Pump

Component

Diesel Engine

Fluid

HIGH PERFORMANCE LUBRICANTS HDMO 15W40 (8 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		HPL0004894	HPL0003925	HPL0003927
Sample Date	Client Info		03 Jun 2024	09 Feb 2024	02 Jan 2024
Machine Age	hrs	Client Info	93	91	90
Oil Age	hrs	Client Info	13	11	10
Oil Changed	Client Info		Not Chngd	Not Chngd	Not Chngd
Sample Status			NORMAL	NORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>3.0	<1.0	<1.0	<1.0
Water	WC Method	>0.2	NEG	NEG	NEG
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>90	2	2	3
Chromium	ppm	ASTM D5185m	>20	<1	0	0
Nickel	ppm	ASTM D5185m	>2	0	<1	0
Titanium	ppm	ASTM D5185m	>2	0	0	0
Silver	ppm	ASTM D5185m	>2	0	<1	0
Aluminum	ppm	ASTM D5185m	>20	4	7	3
Lead	ppm	ASTM D5185m	>40	8	4	5
Copper	ppm	ASTM D5185m	>330	199	159	138
Tin	ppm	ASTM D5185m	>15	0	<1	0
Vanadium	ppm	ASTM D5185m		<1	<1	0
Cadmium	ppm	ASTM D5185m		0	<1	0

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	200	8	37	24
Barium	ppm	ASTM D5185m		0	0	<1
Molybdenum	ppm	ASTM D5185m	85	495	468	472
Manganese	ppm	ASTM D5185m		<1	<1	0
Magnesium	ppm	ASTM D5185m	525	978	857	901
Calcium	ppm	ASTM D5185m	4300	2650	2426	2518
Phosphorus	ppm	ASTM D5185m	1000	1117	1058	1011
Zinc	ppm	ASTM D5185m	1100	1313	1219	1240
Sulfur	ppm	ASTM D5185m	20200	10308	8406	8523

CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>25	7	6	13
Sodium	ppm	ASTM D5185m		12	11	10
Potassium	ppm	ASTM D5185m	>20	<1	<1	<1

INFRA-RED

	method	limit/base	current	history1	history2	
Soot %	%	*ASTM D7844	>6	0.1	0.1	0.1
Nitration	Abs/cm	*ASTM D7624	>20	7.1	7.2	7.1
Sulfation	Abs/.1mm	*ASTM D7415	>30	31.0	33.9	33.8


FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Oxidation	Abs/.1mm	*ASTM D7414	>25	29.7	33.1	33.2
Base Number (BN)	mg KOH/g	ASTM D2896	14.5	15.84	16.16	15.61




OIL ANALYSIS REPORT


FT-IR (Direct Trend)

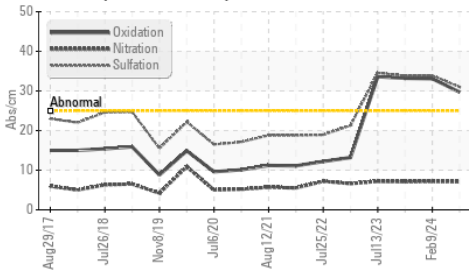

Base Number

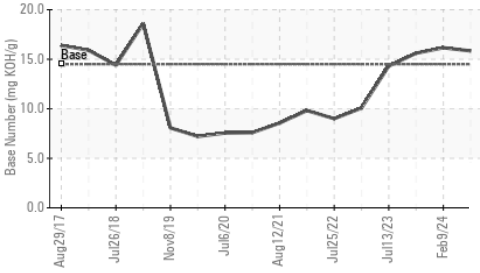









Viscosity @ 100°C

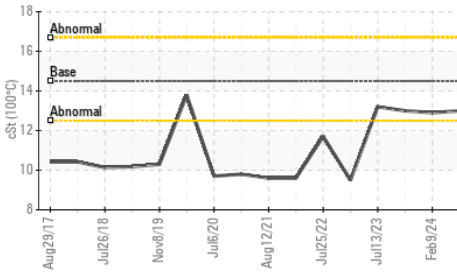

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.5	13.0	12.9

GRAPHS

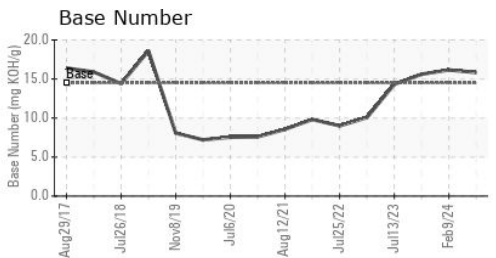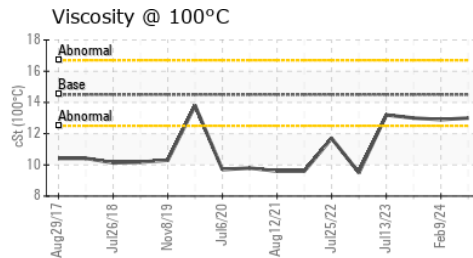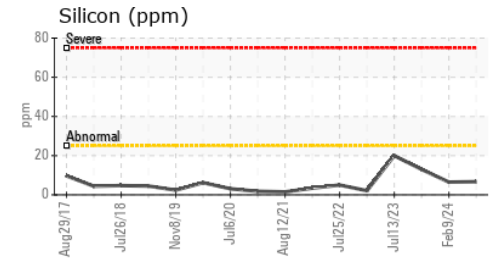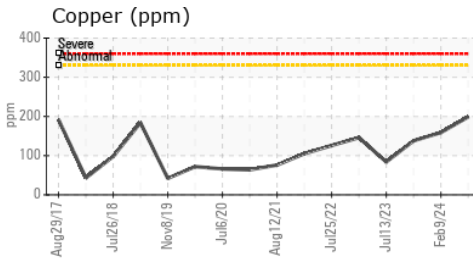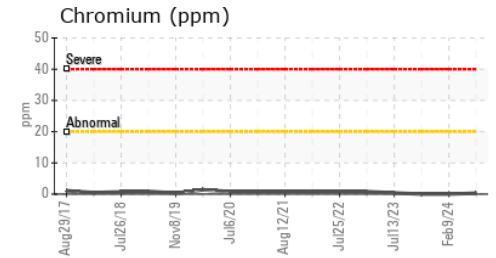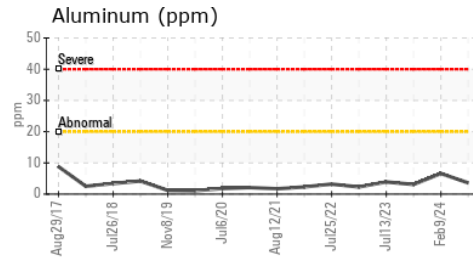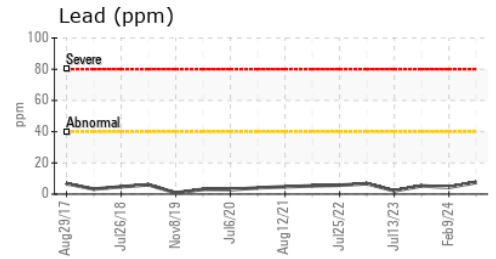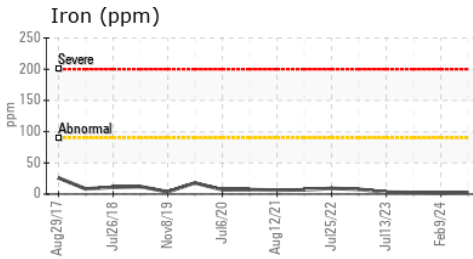

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : HPL0004894

Lab Number : 06201656

Unique Number : 11063779

Test Package : MOB 2

Received : 06 Jun 2024

Tested : 07 Jun 2024

Diagnosed : 09 Jun 2024 - Don Baldrige

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

KENSING

2525 S KENSINGTON RD

KANKAKEE, IL

US 60901

Contact: TIM HUBERT

timothy.hubert@kensingolutions.com

T: (815)939-8918

F: x: