


OIL ANALYSIS REPORT

Sample Rating Trend




NORMAL

Machine Id

KAESER BSD50 5626305 (S/N 1548)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)



Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA017150	KCPA004444	KCP33363
Sample Date		Client Info		03 May 2024	19 Jul 2023	06 Sep 2022
Machine Age	hrs	Client Info		33770	29909	25660
Oil Age	hrs	Client Info		8110	0	4365
Oil Changed		Client Info		Not Changd	N/A	Changed
Sample Status				NORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	2
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	<1	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	<1	0
Aluminum	ppm	ASTM D5185m	>10	0	0	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	5	13	8
Tin	ppm	ASTM D5185m	>10	0	0	<1
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	0	1
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	<1
Magnesium	ppm	ASTM D5185m	90	<1	1	<1
Calcium	ppm	ASTM D5185m	2	0	0	0
Phosphorus	ppm	ASTM D5185m		1	4	3
Zinc	ppm	ASTM D5185m		0	0	4
Sulfur	ppm	ASTM D5185m		14029	17082	15843
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	0
Sodium	ppm	ASTM D5185m		<1	0	5
Potassium	ppm	ASTM D5185m	>20	0	2	<1
Water	%	ASTM D6304	>0.05	0.003	0.025	△ 0.241
ppm Water	ppm	ASTM D6304	>500	33	258.1	<u>4</u> 2410
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		200		
Particles >6µm		ASTM D7647	>1300	113		
Particles >14µm		ASTM D7647	>80	36		
Particles >21µm		ASTM D7647	>20	16		
Particles >38µm		ASTM D7647	>4	1		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>17/13	14/12		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2



OIL ANALYSIS REPORT

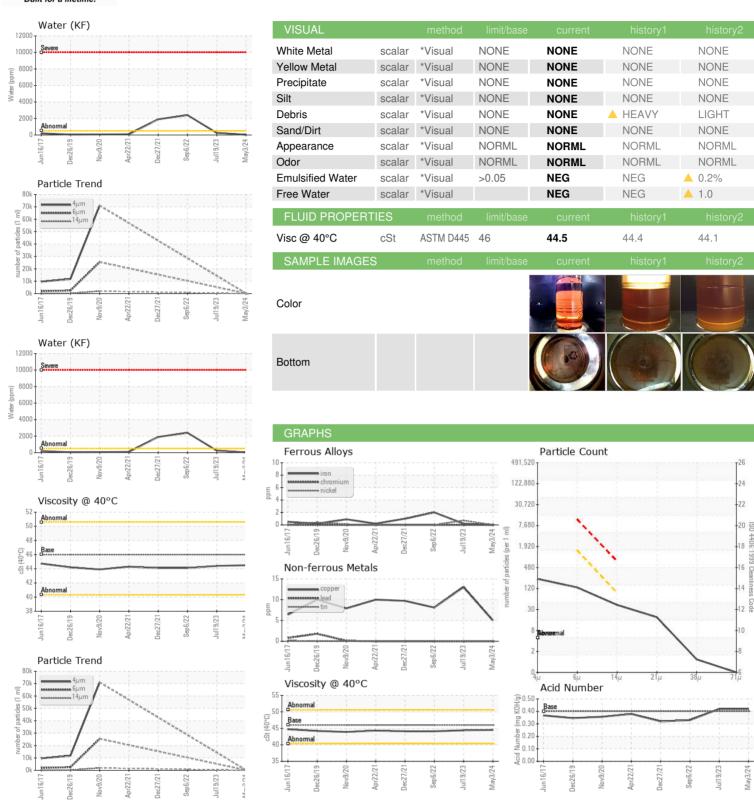





Certificate 12367

Laboratory Sample No. Lab Number

Unique Number : 11069479

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : KCPA017150 : 06202018

Received **Tested** Diagnosed

: 07 Jun 2024 : 09 Jun 2024 - Don Baldridge

Test Package : IND 2 (Additional Tests: KF, PrtCount)

: 06 Jun 2024

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

REHAU CONSTRUCTION LLC

2424 INDUSTRIAL DR SW CULLMAN, AL

US 35055 Contact: BRYAN KRAUSE

bryan.krause@rehau.com T:

F: Contact/Location: BRYAN KRAUSE - REHCUL