




OIL ANALYSIS REPORT

Sample Rating Trend

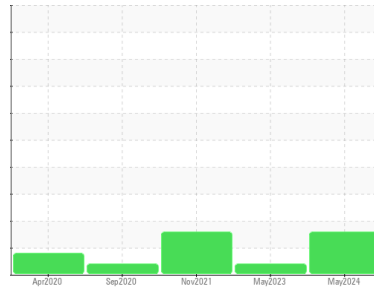

ISO



Machine Id
KAESER AS 30T 4463746 (S/N 1051)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KCPA017886	KCPA000290	KCP43015
Sample Date	Client Info	28 May 2024	23 May 2023	23 Nov 2021
Machine Age	hrs	29212	28163	25200
Oil Age	hrs	0	0	2753
Oil Changed	Client Info	Changed	N/A	Changed
Sample Status		ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >50	0	<1	<1
Chromium	ppm ASTM D5185m >10	0	0	0
Nickel	ppm ASTM D5185m >3	0	0	0
Titanium	ppm ASTM D5185m >3	0	0	0
Silver	ppm ASTM D5185m >2	0	0	<1
Aluminum	ppm ASTM D5185m >10	0	0	0
Lead	ppm ASTM D5185m >10	0	0	0
Copper	ppm ASTM D5185m >50	9	6	9
Tin	ppm ASTM D5185m >10	0	0	0
Antimony	ppm ASTM D5185m	---	---	0
Vanadium	ppm ASTM D5185m	0	0	0
Cadmium	ppm ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	0	0	0
Barium	ppm ASTM D5185m 90	0	0	0
Molybdenum	ppm ASTM D5185m	0	0	0
Manganese	ppm ASTM D5185m	0	<1	0
Magnesium	ppm ASTM D5185m 90	5	19	0
Calcium	ppm ASTM D5185m 2	0	1	0
Phosphorus	ppm ASTM D5185m	28	9	52
Zinc	ppm ASTM D5185m	19	23	6
Sulfur	ppm ASTM D5185m	19692	21853	13024

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >25	<1	<1	3
Sodium	ppm ASTM D5185m	3	5	1
Potassium	ppm ASTM D5185m >20	0	1	0
Water	% ASTM D6304 >0.05	0.006	0.012	0.002
ppm Water	ppm ASTM D6304 >500	70	127.1	16.5






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	4398	---	15965
Particles >6µm	ASTM D7647 >1300	▲ 1596	---	▲ 4753
Particles >14µm	ASTM D7647 >80	▲ 233	---	▲ 572
Particles >21µm	ASTM D7647 >20	▲ 68	---	▲ 197
Particles >38µm	ASTM D7647 >4	3	---	▲ 9
Particles >71µm	ASTM D7647 >3	0	---	0
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 19/18/15	---	▲ 19/16

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D8045 0.4	0.32	0.36	0.334

OIL ANALYSIS REPORT

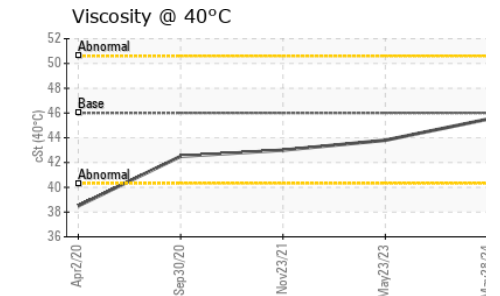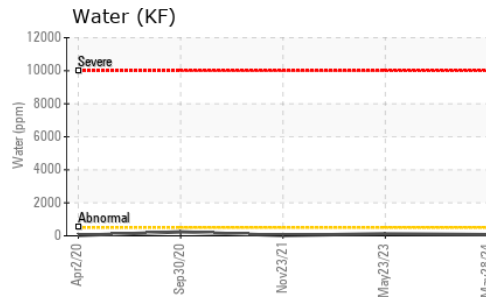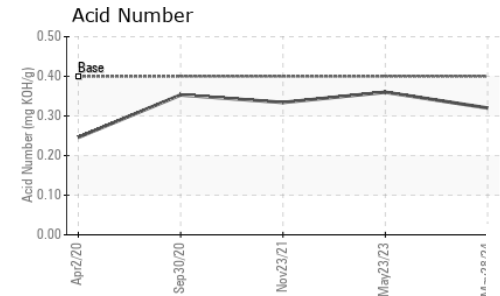
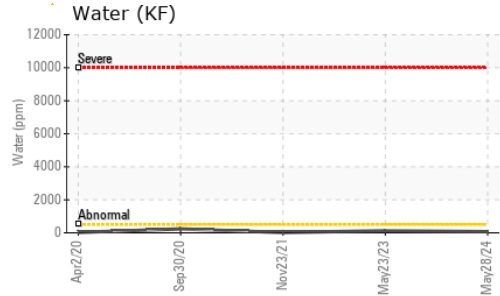
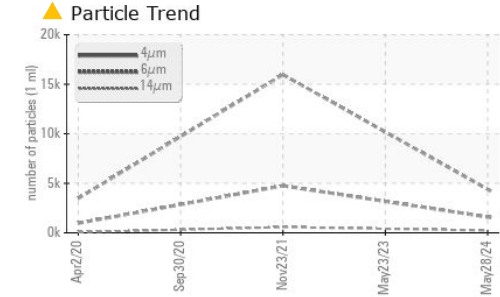


PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	45.5	43.8	43.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

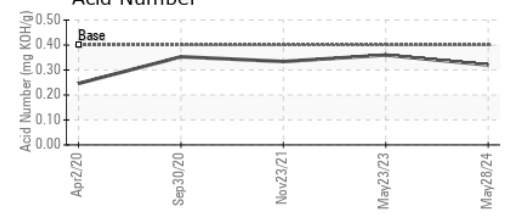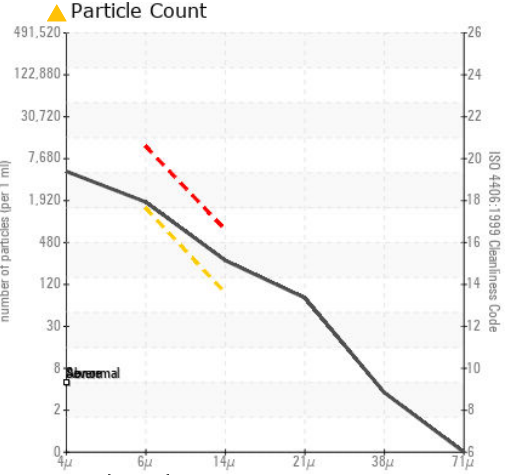

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA017886 **Received** : 06 Jun 2024
Lab Number : 06202022 **Tested** : 11 Jun 2024
Unique Number : 11069483 **Diagnosed** : 11 Jun 2024 - Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PrtCount)

D & F EQUIPMENT SALES
 8641 HWY 227 N
 CROSSVILLE, AL
 US 35962
 Contact: C. LEDBETTER
 cledbetter@dfequip.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)