


# **OIL ANALYSIS REPORT**

Sample Rating Trend




NORMAL

Machine Id

# KAESER SM 11 1960324 (S/N 1519)

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)



### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA013891	KCP48268	
Sample Date		Client Info		14 Mar 2024	09 Mar 2016	
Machine Age	hrs	Client Info		8605	7242	
Oil Age	hrs	Client Info		8605	4000	
Oil Changed		Client Info		Changed	Changed	
Sample Status				NORMAL	ATTENTION	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	1	
Chromium	ppm	ASTM D5185m	>10	0	<1	
Nickel	ppm	ASTM D5185m	>3	0	<1	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	0	0	
Lead	ppm	ASTM D5185m	>10	2	0	
Copper	ppm	ASTM D5185m	>50	6	13	
Tin	ppm	ASTM D5185m	>10	0	2	
Antimony	ppm	ASTM D5185m			0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	<1	
Barium	ppm	ASTM D5185m	90	0	0	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		<1	<1	
Magnesium	ppm	ASTM D5185m	100	21	23	
Calcium	ppm	ASTM D5185m	0	0	<1	
Phosphorus	ppm	ASTM D5185m	0	11	65	
Zinc	ppm	ASTM D5185m	0	19	22	
Sulfur	ppm	ASTM D5185m	23500	21751	17630	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	
Sodium	ppm	ASTM D5185m		11	13	
Potassium	ppm	ASTM D5185m	>20	<1	1	
Water	%	ASTM D6304	>0.05	0.019	0.009	
ppm Water	ppm	ASTM D6304	>500	190	90	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		206	1000	
Particles >6µm		ASTM D7647	>1300	88	544	
Particles >14μm		ASTM D7647	>80	21	92	
Particles >21µm		ASTM D7647	>20	8	31	
Particles >38µm		ASTM D7647	>4	1	4	
Particles >71μm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	15/14/12	16/14	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2

Acid Number (AN)


mg KOH/g ASTM D8045 1.0

0.352

Contact/Location: R. JENKINS - EMACHA



## **OIL ANALYSIS REPORT**

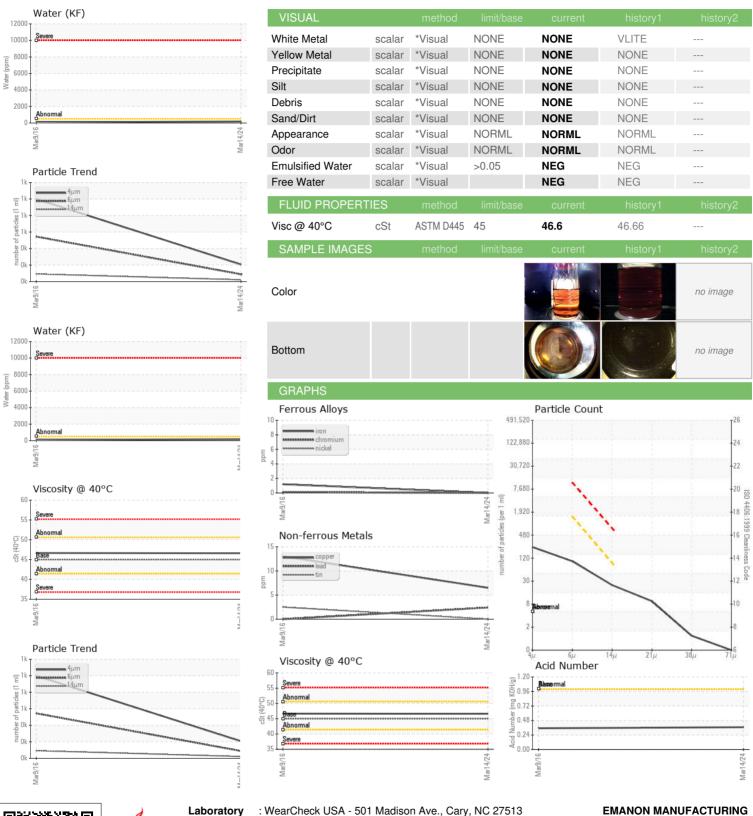





Certificate 12367

Laboratory

Sample No.

Lab Number Unique Number : 11069486

: KCPA013891 : 06202025

Received **Tested** Diagnosed

: 07 Jun 2024 : 09 Jun 2024 - Don Baldridge

: 06 Jun 2024

Test Package : IND 2 ( Additional Tests: KF, PrtCount ) To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

4125 S CREEK RD CHATTANOOGA, TN US 37406 Contact: R. JENKINS

rjenkins@emanonmfg.com

T: F: