


# **OIL ANALYSIS REPORT**

Sample Rating Trend

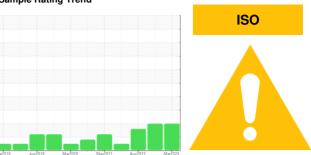

Machine Id

# KAESER AS 25 5272773 (S/N 1120)

Compressor

KAESER SIGMA (OEM) S-460 (--- QTS)

### **DIAGNOSIS**

#### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

## Contamination

There is a high amount of particulates present in the oil.

#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Mar2016	Jun2018 Mar2020	May2021 Aug2022	Mar2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA013797	KCP48050D	KCP50043
Sample Date		Client Info		13 Mar 2024	01 Aug 2023	05 Aug 2022
Machine Age	hrs	Client Info		32403	29501	24302
Oil Age	hrs	Client Info		3000	0	6088
Oil Changed		Client Info		Not Changd	Changed	Changed
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	0	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	6	9	10
Tin	ppm	ASTM D5185m	>10	0	0	0
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	<1
Barium	ppm	ASTM D5185m	90	0	0	<1
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	90	16	<1	0
Calcium	ppm	ASTM D5185m	2	0	0	<1
Phosphorus	ppm	ASTM D5185m		2	0	4
Zinc	ppm	ASTM D5185m		26	3	16
Sulfur	ppm	ASTM D5185m		20008	17937	14741
CONTAMINANTS	<b>;</b>	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	0
Sodium	ppm	ASTM D5185m		12	1	<1
Potassium	ppm	ASTM D5185m	>20	<1	0	0
Water	%	ASTM D6304	>0.05	0.013	0.004	0.011
ppm Water	ppm	ASTM D6304	>500	138	43	113.3
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		32723	3416	3443
Particles >6µm		ASTM D7647	>1300	<u> </u>	<u>▲</u> 1380	1273
Particles >14µm		ASTM D7647	>80	<b>△</b> 3084	<u>▲</u> 346	<u>▲</u> 163
Particles >21µm		ASTM D7647	>20	<b>A</b> 783	<u>▲</u> 152	<b>4</b> 3
Particles >38µm		ASTM D7647	>4	<u>^</u> 20	<u>6</u>	<u> 5</u>
Particles >71µm		ASTM D7647	>3	1	0	0
Oil Cleanliness		ISO 4406 (c)	>17/13	<u>^</u> 21/19	<u>▲</u> 18/16	<b>△</b> 17/15
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2



## OIL ANALYSIS REPORT







Certificate 12367

Laboratory Sample No.

Lab Number

: KCPA013797 : 06202026 Unique Number : 11069487

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 06 Jun 2024

**Tested** : 07 Jun 2024 Diagnosed : 09 Jun 2024 - Don Baldridge Test Package : IND 2 ( Additional Tests: KF, PrtCount )

9356 OOLTEWAH RINGGOLD RD OOLTAWAH, TN US 37363 Contact: R. PLUMLEY rplumley@ufpi.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  $^st$  - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: