


OIL ANALYSIS REPORT

Sample Rating Trend

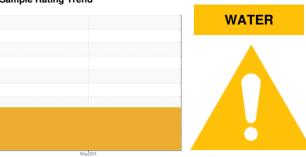

Machine Id

8967704 (S/N 1046)

Component Compressor

G-680 (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition.

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil. There is a light concentration of water present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

				May2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA017638		
Sample Date		Client Info		14 May 2024		
Machine Age	hrs	Client Info		7130		
Oil Age	hrs	Client Info		7130		
Oil Changed		Client Info		Changed		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	<1		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		1526		
Zinc	ppm	ASTM D5185m		<1		
Sulfur	ppm	ASTM D5185m		223		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	0		
Water	%	ASTM D6304	>0.05	△ 0.105		
ppm Water	ppm	ASTM D6304	>500	<u>▲</u> 1051		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		10101		
Particles >6µm		ASTM D7647	>1300	△ 3019		
Particles >14µm		ASTM D7647	>80	169		
Particles >21µm		ASTM D7647	>20	<u>^</u> 22		
Particles >38µm		ASTM D7647	>4	1		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	△ 21/19/15		
FLUID DEGRADA	TION	method	limit/base		history1	history2
			milliv Dase	current		
Acid Number (AN)	mg KOH/g	ASTM D8045		0.111		



OIL ANALYSIS REPORT







Certificate 12367

Laboratory Sample No. Lab Number

: KCPA017638 : 06202041

Unique Number : 11069502 Test Package : IND 2 (Additional Tests: KF, PrtCount)

Received : 06 Jun 2024 Tested Diagnosed

: 07 Jun 2024 : 09 Jun 2024 - Don Baldridge 1301 GENE E STEWART BLVD SYLACAUGA, AL

US 35151 Contact: B. ATKINS batkins@ucaair.com T:

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: UNISYLAL [WUSCAR] 06202041 (Generated: 06/09/2024 19:04:23) Rev: 1

Contact/Location: B. ATKINS - UNISYLAL

F: