


# **OIL ANALYSIS REPORT**

Sample Rating Trend

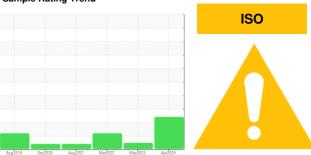

Machine Id

# KAESER BSD 60 6613951 (S/N 1473)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

### **DIAGNOSIS**

### Recommendation

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Augzoto	DECEDED Magaza	Halott Hajtoto	THE STATE OF THE S	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA016487	KC112414	KC104375
Sample Date		Client Info		24 Apr 2024	09 May 2023	22 Mar 2022
Machine Age	hrs	Client Info		21178	18056	14197
Oil Age	hrs	Client Info		4000	4000	3600
Oil Changed		Client Info		Not Changd	Changed	Changed
Sample Status				ABNORMAL	NORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	<1
Aluminum	ppm	ASTM D5185m	>10	0	<1	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	16	17	26
Tin	ppm	ASTM D5185m	>10	0	0	<1
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	<1
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	90	<1	0	0
Calcium	ppm	ASTM D5185m	2	0	0	0
Phosphorus	ppm	ASTM D5185m		4	1	3
Zinc	ppm	ASTM D5185m		7	0	0
Sulfur	ppm	ASTM D5185m		19095	19030	13063
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	<1
Sodium	ppm	ASTM D5185m		2	<1	<1
Potassium	ppm	ASTM D5185m	>20	0	0	0
Water	%	ASTM D6304	>0.05	0.005	0.008	0.006
ppm Water	ppm	ASTM D6304	>500	59	86.4	66.1
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		91913	774	1125
Particles >6µm		ASTM D7647	>1300	<u>▲</u> 36735	258	579
Particles >14µm		ASTM D7647	>80	<b>4594</b>	35	<u> </u>
Particles >21µm		ASTM D7647	>20	<u> </u>	10	<u>▲</u> 55
Particles >38µm		ASTM D7647	>4	<b>49</b>	1	4
Particles >71μm		ASTM D7647	>3	<u>^</u> 2	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>4</u> 24/22/19	17/15/12	<b>△</b> 17/16/15
FLUID DEGRADA	TION	method	limit/base	current	history1	history2



## **OIL ANALYSIS REPORT**

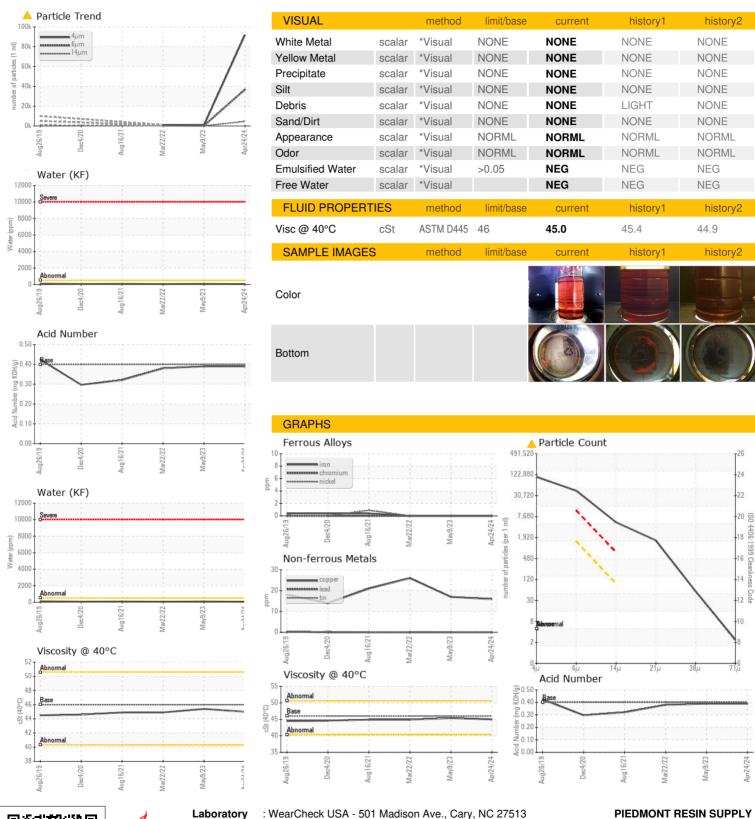





Certificate 12367

Laboratory Sample No.

Lab Number

: KCPA016487 : 06202043 Unique Number : 11069504

Received : 06 Jun 2024 **Tested** Diagnosed

: 11 Jun 2024 : 11 Jun 2024 - Jonathan Hester

Test Package : IND 2 ( Additional Tests: KF, PrtCount )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

US 30120 Contact: JR THOMAS jrthomas@piedmontresins.com

 $^st$  - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) T:

F:

420 S ERWIN DR

CARTERSVILLE, GA