



OIL ANALYSIS REPORT

Sample Rating Trend



ISO



Machine Id

8148259 (S/N 1152)

Component

Compressor

Fluid

KAESER SIGMA (OEM) M-460 (--- QTS)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA017081	---	---
Sample Date	Client Info		09 Apr 2024	---	---
Machine Age	hrs	Client Info	4761	---	---
Oil Age	hrs	Client Info	4761	---	---
Oil Changed	Client Info		Changed	---	---
Sample Status			ABNORMAL	---	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	---	---
Chromium	ppm	ASTM D5185m >10	0	---	---
Nickel	ppm	ASTM D5185m >3	0	---	---
Titanium	ppm	ASTM D5185m >3	0	---	---
Silver	ppm	ASTM D5185m >2	0	---	---
Aluminum	ppm	ASTM D5185m >10	<1	---	---
Lead	ppm	ASTM D5185m >10	0	---	---
Copper	ppm	ASTM D5185m >50	4	---	---
Tin	ppm	ASTM D5185m >10	0	---	---
Vanadium	ppm	ASTM D5185m	0	---	---
Cadmium	ppm	ASTM D5185m	0	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	---	---
Barium	ppm	ASTM D5185m 90	<1	---	---
Molybdenum	ppm	ASTM D5185m 0	0	---	---
Manganese	ppm	ASTM D5185m	<1	---	---
Magnesium	ppm	ASTM D5185m 100	43	---	---
Calcium	ppm	ASTM D5185m 0	2	---	---
Phosphorus	ppm	ASTM D5185m 0	3	---	---
Zinc	ppm	ASTM D5185m 0	15	---	---
Sulfur	ppm	ASTM D5185m 23500	20189	---	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	---	---
Sodium	ppm	ASTM D5185m	16	---	---
Potassium	ppm	ASTM D5185m >20	11	---	---
Water	%	ASTM D6304 >0.05	0.020	---	---
ppm Water	ppm	ASTM D6304 >500	201	---	---

FLUID CLEANLINESS


	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		1797	---	---
Particles >6µm	ASTM D7647	>1300	924	---	---
Particles >14µm	ASTM D7647	>80	▲ 284	---	---
Particles >21µm	ASTM D7647	>20	▲ 88	---	---
Particles >38µm	ASTM D7647	>4	1	---	---
Particles >71µm	ASTM D7647	>3	0	---	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 18/17/15	---	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.34	---	---

OIL ANALYSIS REPORT


▲ Particle Trend

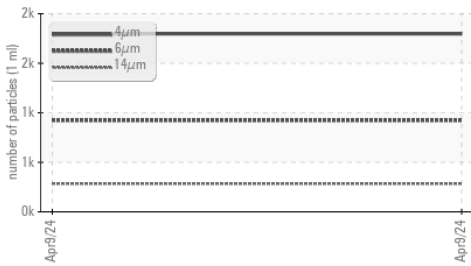

Water (KF)




Acid Number

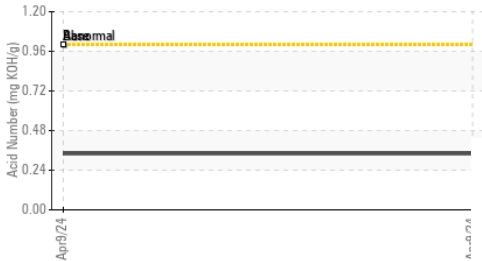

Water (KF)



Viscosity @ 40°C

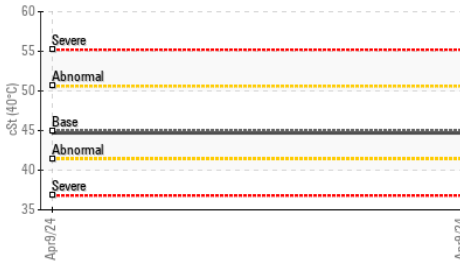

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	44.7	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------


Color		no image	no image
Bottom		no image	no image

GRAPHS


Ferrous Alloys




Non-ferrous Metals

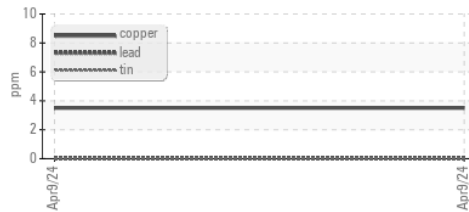


Viscosity @ 40°C

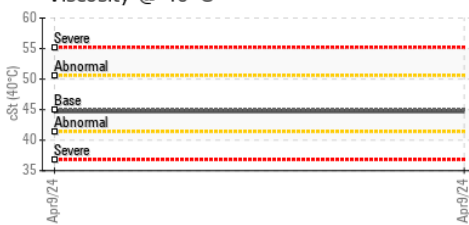

▲ Particle Count

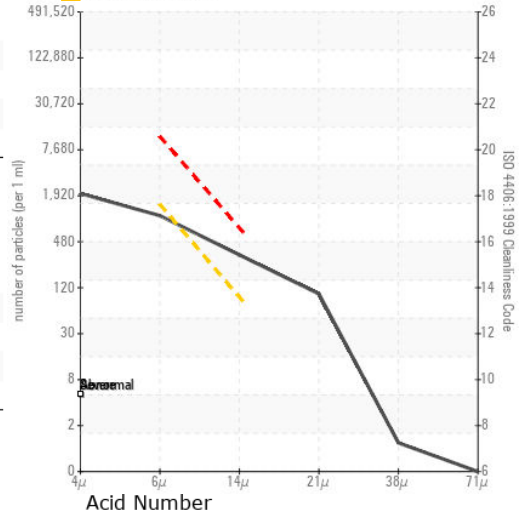

Acid Number

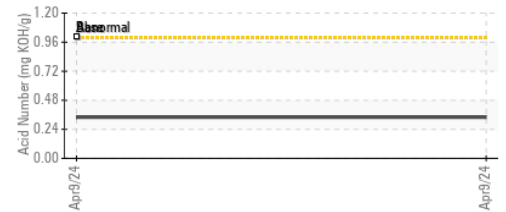

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : KCPA017081

Lab Number : 06202047

Unique Number : 11069508

Test Package : IND 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Received : 06 Jun 2024

Tested : 07 Jun 2024

Diagnosed : 09 Jun 2024 - Don Baldrige

PILLOW PERFECT

1601 CHEROKEE PKWY

ACWORTH, GA

US 30102

Contact: R. ATNEVE

ratneve@pillowperfect.com

T:

F: