




OIL ANALYSIS REPORT

Sample Rating Trend

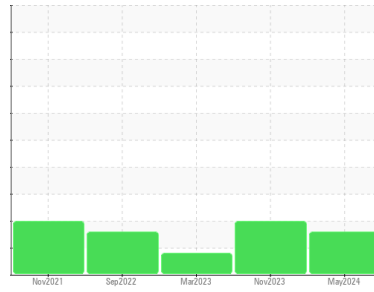

ISO



Area

[73558974]

Machine Id

KAESER 4738400

Component

Compressor

Fluid

KAESER SIGMA (OEM) M-460 (--- QTS)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KCPA017954	KCP40040	KCP55158
Sample Date	Client Info	29 May 2024	20 Nov 2023	05 Mar 2023
Machine Age	hrs	Client Info	62882	58328
Oil Age	hrs	Client Info	0	6000
Oil Changed	Client Info	Changed	Changed	Changed
Sample Status		ABNORMAL	ABNORMAL	ATTENTION

WEAR METALS

method	limit/base	current	history1	history2		
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	<1
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	0	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	12	4	5
Tin	ppm	ASTM D5185m	>10	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m	90	0	31
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m		0	<1
Magnesium	ppm	ASTM D5185m	100	0	38
Calcium	ppm	ASTM D5185m	0	0	1
Phosphorus	ppm	ASTM D5185m	0	2	5
Zinc	ppm	ASTM D5185m	0	14	0
Sulfur	ppm	ASTM D5185m	23500	19786	20026

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>25	<1	<1
Sodium	ppm	ASTM D5185m		<1	11
Potassium	ppm	ASTM D5185m	>20	0	0
Water	%	ASTM D6304	>0.05	0.003	0.013
ppm Water	ppm	ASTM D6304	>500	37	136






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		10656	22810
Particles >6µm	ASTM D7647	>1300	▲ 4473	▲ 7973
Particles >14µm	ASTM D7647	>80	▲ 222	▲ 793
Particles >21µm	ASTM D7647	>20	▲ 48	▲ 235
Particles >38µm	ASTM D7647	>4	1	▲ 12
Particles >71µm	ASTM D7647	>3	0	1
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 21/19/15	▲ 22/20/17

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.42

OIL ANALYSIS REPORT

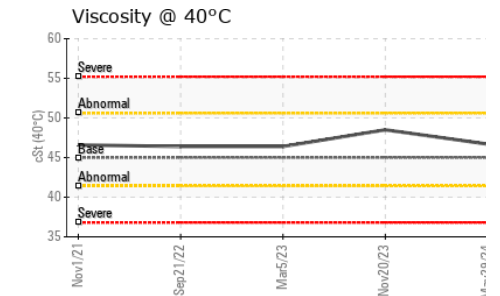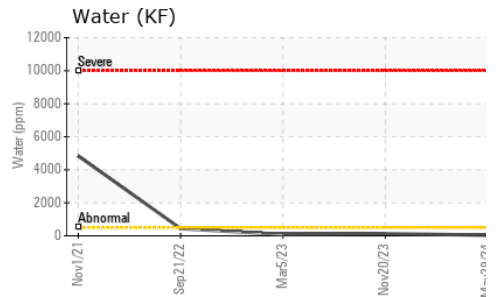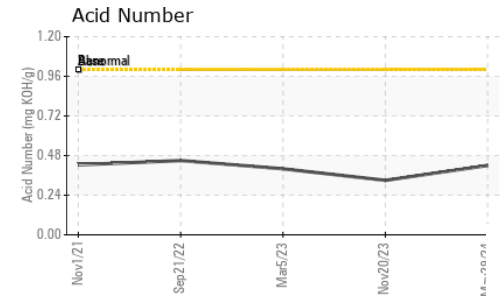
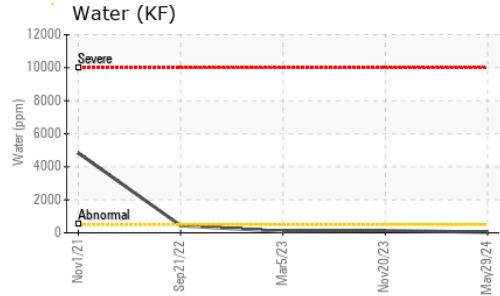
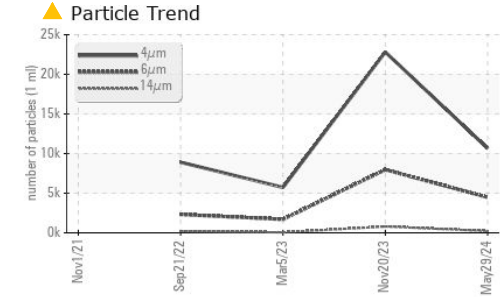


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	46.7	48.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

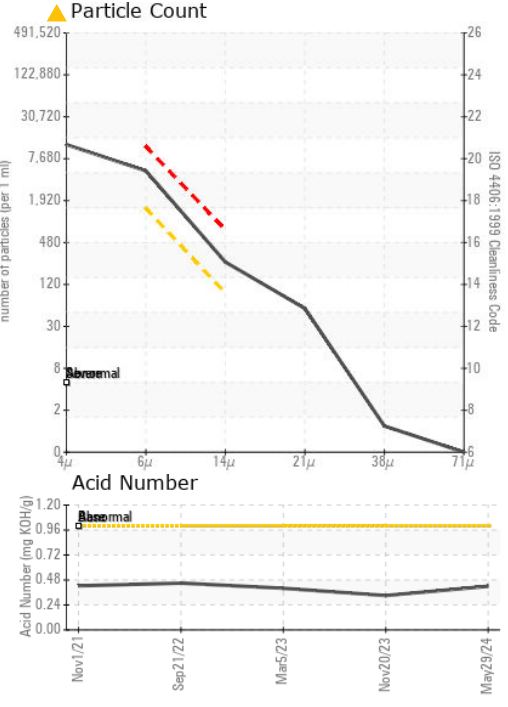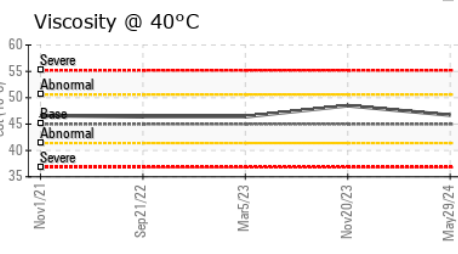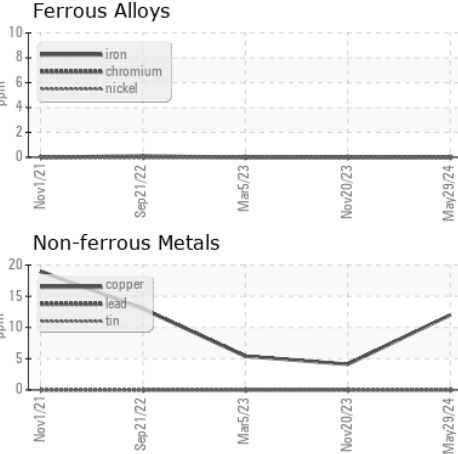

Viscosity @ 40°C	method	limit/base	current	history1	history2
Viscosity (40°C)	cSt	ASTM D445	45	46.7	48.5



Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA017954 **Received** : 06 Jun 2024
Lab Number : 06202065 **Tested** : 07 Jun 2024
Unique Number : 11069526 **Diagnosed** : 09 Jun 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

ZERO WASTE ENERGY
 685 LOS ESTEROS RD
 SAN JOSE, CA
 US 95134
 Contact: A. BARRAZA
 abarraza@zwedc.com
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)