




OIL ANALYSIS REPORT

Sample Rating Trend

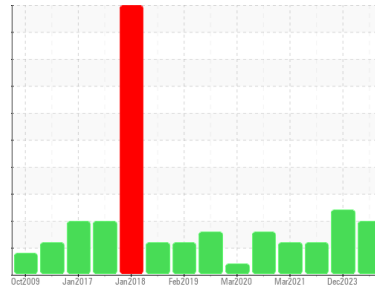

Machine Id
KAESER SX 7 2714431 (S/N 1261)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation
 No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear
 All component wear rates are normal.

Contamination
 There is a high amount of particulates present in the oil.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA018789	KCPA010811	KCP44542
Sample Date	Client Info		31 May 2024	01 Dec 2023	08 Apr 2022
Machine Age	hrs	Client Info	13866	13806	13808
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		Changed	N/A	Changed
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<1	0	1
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	0	0	0
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	2	3	3
Tin	ppm	ASTM D5185m >10	0	0	0
Antimony	ppm	ASTM D5185m	---	---	---
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	<1
Barium	ppm	ASTM D5185m 90	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	<1	<1	<1
Magnesium	ppm	ASTM D5185m 90	50	55	50
Calcium	ppm	ASTM D5185m 2	<1	2	<1
Phosphorus	ppm	ASTM D5185m	2	<1	11
Zinc	ppm	ASTM D5185m	8	0	4
Sulfur	ppm	ASTM D5185m	20415	17498	16479

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	0	<1
Sodium	ppm	ASTM D5185m	18	20	7
Potassium	ppm	ASTM D5185m >20	1	2	<1
Water	%	ASTM D6304 >0.05	0.024	0.012	0.015
ppm Water	ppm	ASTM D6304 >500	243	126	151.4






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		37707	79033	8197
Particles >6µm	ASTM D7647 >1300		▲ 16899	▲ 33816	▲ 2653
Particles >14µm	ASTM D7647 >80		▲ 1758	▲ 3339	▲ 283
Particles >21µm	ASTM D7647 >20		▲ 384	▲ 899	▲ 80
Particles >38µm	ASTM D7647 >4		▲ 11	▲ 45	4
Particles >71µm	ASTM D7647 >3		▲ 1	▲ 3	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 22/21/18	▲ 23/22/19	▲ 19/15

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.36	0.33	0.31


OIL ANALYSIS REPORT

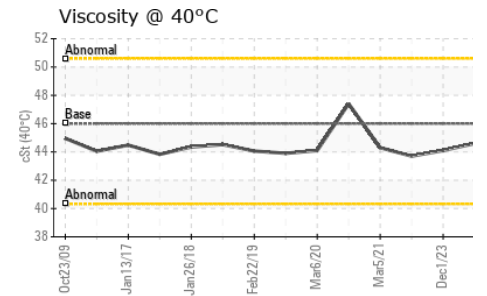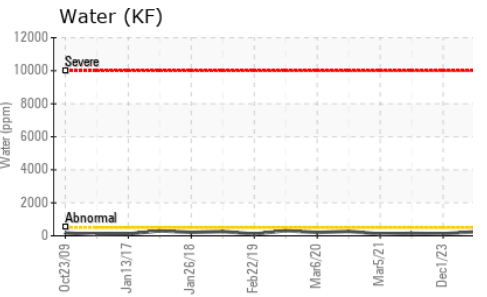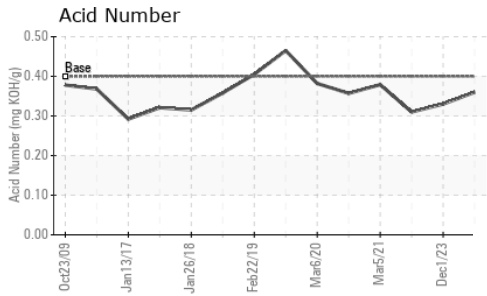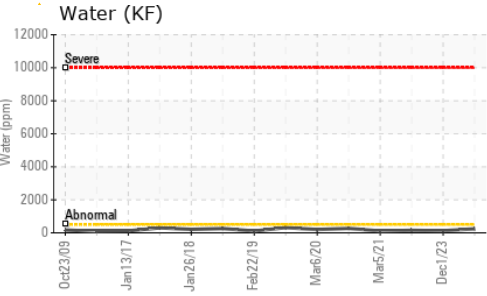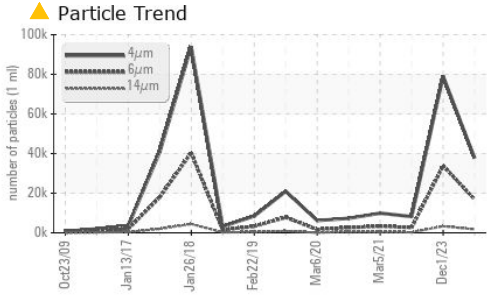





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.1	43.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

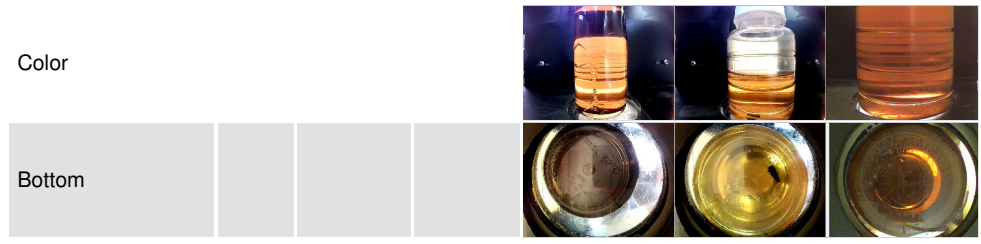

GRAPHS

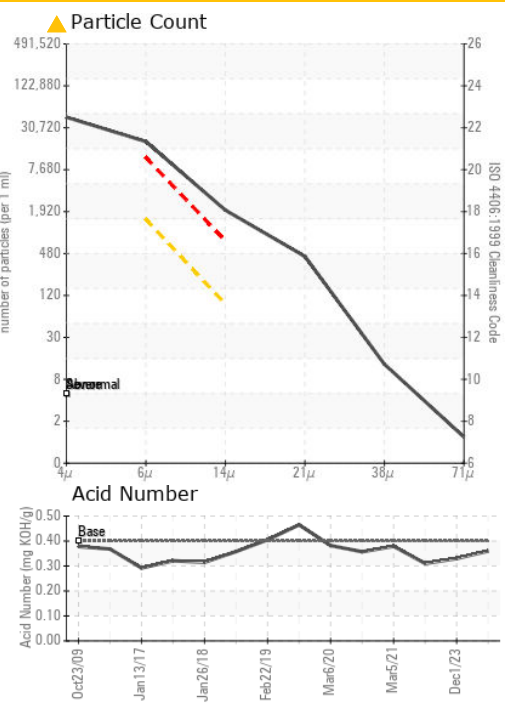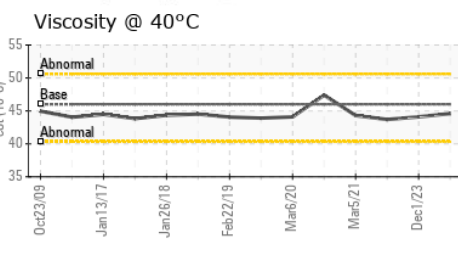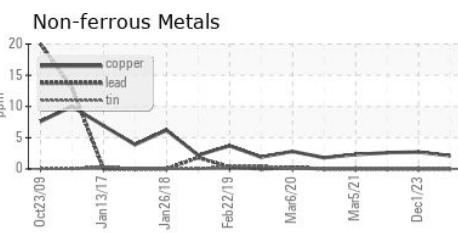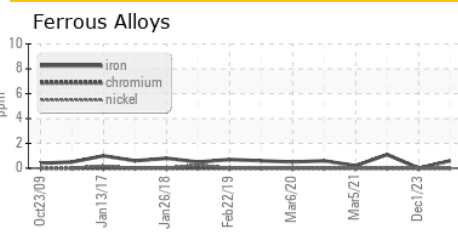

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA018789
Lab Number : 06202066
Unique Number : 11069527
Test Package : IND 2 (Additional Tests: KF, PrtCount)
Received : 06 Jun 2024
Tested : 07 Jun 2024
Diagnosed : 09 Jun 2024 - Don Baldrige

AUTOMATED MOTION INC
 807 NW COMMERCE DR
 LEES SUMMIT, MO
 US 64086
 Contact: M. HUTCHINGS
 mhutchings@automatedmotion.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)