




OIL ANALYSIS REPORT

Sample Rating Trend

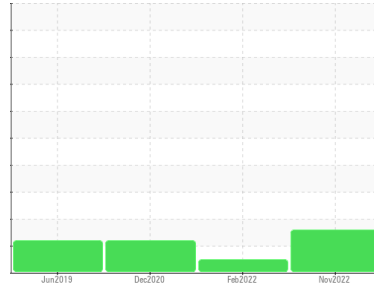

ISO



Machine Id
KAESER ASD 40S 6001820 (S/N 1199)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCP45775	KCP38039	KCP34411
Sample Date	Client Info		08 Nov 2022	17 Feb 2022	14 Dec 2020
Machine Age	hrs	Client Info	18319	16577	13634
Oil Age	hrs	Client Info	1742	5043	1787
Oil Changed	Client Info		Not Chngd	Changed	Changed
Sample Status			ABNORMAL	NORMAL	ATTENTION

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	<1	0
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	0	0	0
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	8	10	9
Tin	ppm	ASTM D5185m >10	0	0	0
Antimony	ppm	ASTM D5185m	---	<1	1
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<1	<1
Barium	ppm	ASTM D5185m 90	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	0	0
Magnesium	ppm	ASTM D5185m 90	32	27	8
Calcium	ppm	ASTM D5185m 2	0	0	0
Phosphorus	ppm	ASTM D5185m	2	0	<1
Zinc	ppm	ASTM D5185m	49	82	10
Sulfur	ppm	ASTM D5185m	20619	15623	15289

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	<1	0
Sodium	ppm	ASTM D5185m	20	18	<1
Potassium	ppm	ASTM D5185m >20	5	6	2
Water	%	ASTM D6304 >0.05	0.018	0.010	0.005
ppm Water	ppm	ASTM D6304 >500	188	103.7	56.7






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		15268	3942	4773
Particles >6µm	ASTM D7647 >1300		▲ 5187	985	● 1427
Particles >14µm	ASTM D7647 >80		▲ 346	77	● 146
Particles >21µm	ASTM D7647 >20		▲ 81	15	● 44
Particles >38µm	ASTM D7647 >4		1	2	3
Particles >71µm	ASTM D7647 >3		0	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/13		▲ 21/20/16	17/13	● 18/14

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.33	0.373	0.345


OIL ANALYSIS REPORT

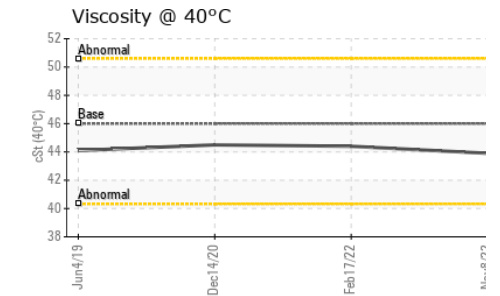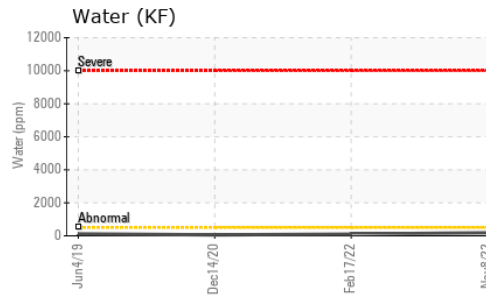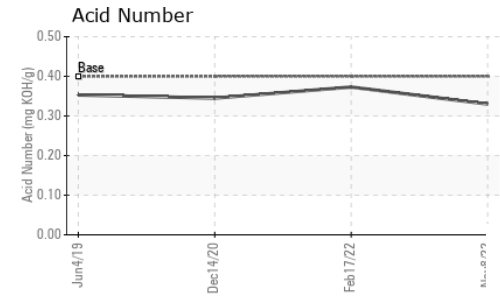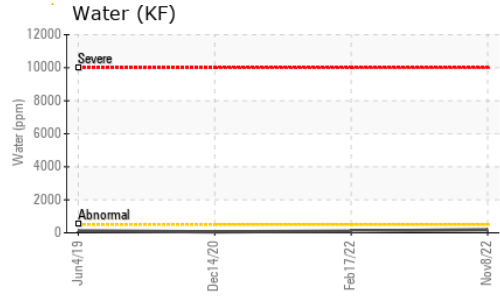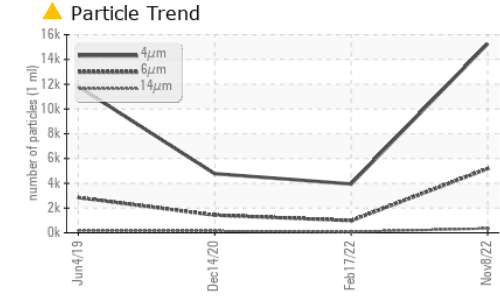





PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	43.9	44.4

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

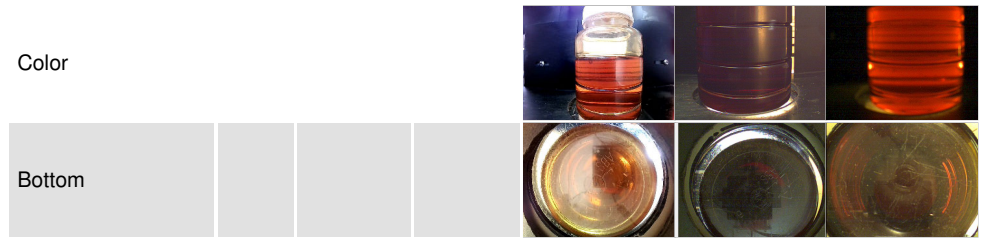

GRAPHS

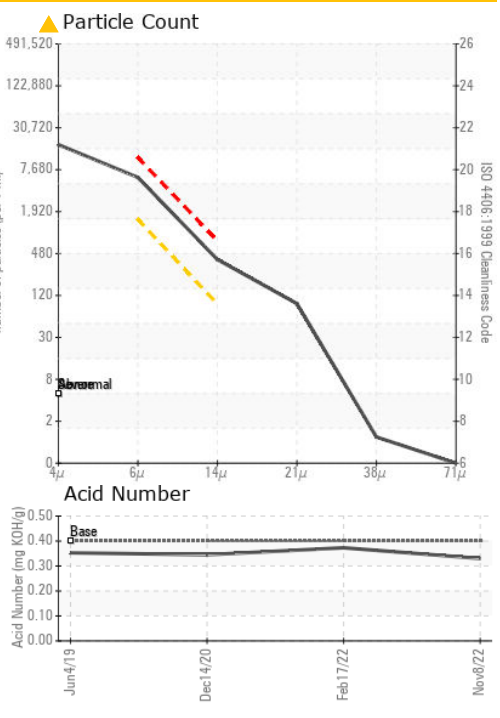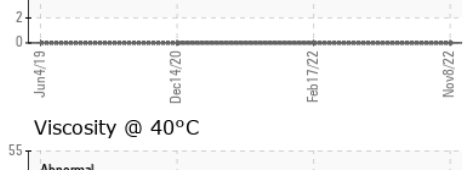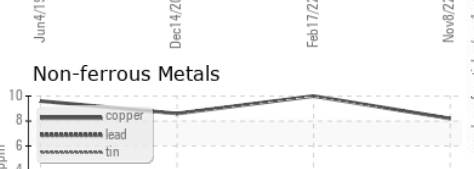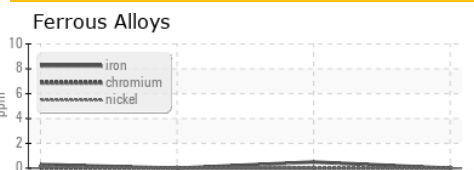

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP45775
Lab Number : 06202069
Unique Number : 11069530
Test Package : IND 2 (Additional Tests: KF, PrtCount)
Received : 06 Jun 2024
Tested : 07 Jun 2024
Diagnosed : 09 Jun 2024 - Don Baldrige

HOBBY LOBBY
 7707 SW 44TH ST
 OKLAHOMA CITY, OK
 US 73179
 Contact: JEFF LEWIS
 JEFF.LEWIS@HOBBYLOBBY.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)