




# OIL ANALYSIS REPORT

## Sample Rating Trend

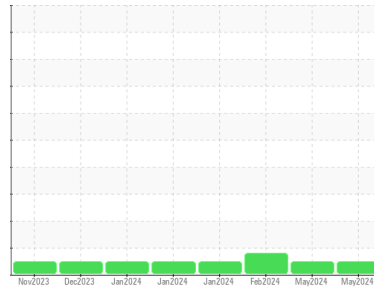

**NORMAL**



Machine Id  
**ASRI-SKD-GNED-0001 ASRI-SKD-GNED-0001**  
 Component  
**Diesel Engine**  
 Fluid  
 **DIESEL ENGINE OIL SAE 15W40 (9 GAL)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.

#### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>HLC0002883</b>	HLC0002934	HLC0002968
Sample Date	Client Info			<b>28 May 2024</b>	09 May 2024	25 Feb 2024
Machine Age	hrs	Client Info		<b>6827</b>	6500	5623
Oil Age	hrs	Client Info		<b>325</b>	450	350
Oil Changed	Client Info			<b>Changed</b>	Changed	Changed
Sample Status				<b>NORMAL</b>	NORMAL	ABNORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>5		<b>&lt;1.0</b>	<1.0	<1.0
Water	WC Method	>0.2		<b>NEG</b>	NEG	NEG
Glycol	WC Method			<b>NEG</b>	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>100	<b>8</b>	16	26
Chromium	ppm	ASTM D5185m	>20	<b>0</b>	<1	1
Nickel	ppm	ASTM D5185m	>4	<b>0</b>	<1	<1
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Silver	ppm	ASTM D5185m	>3	<b>0</b>	1	<1
Aluminum	ppm	ASTM D5185m	>20	<b>&lt;1</b>	1	2
Lead	ppm	ASTM D5185m	>40	<b>0</b>	<1	1
Copper	ppm	ASTM D5185m	>330	<b>0</b>	1	2
Tin	ppm	ASTM D5185m	>15	<b>0</b>	<1	2
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Cadmium	ppm	ASTM D5185m		<b>0</b>	<1	<1

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	250	<b>17</b>	27	61
Barium	ppm	ASTM D5185m	10	<b>0</b>	<1	0
Molybdenum	ppm	ASTM D5185m	100	<b>0</b>	3	2
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	1
Magnesium	ppm	ASTM D5185m	450	<b>155</b>	264	770
Calcium	ppm	ASTM D5185m	3000	<b>2359</b>	2221	1472
Phosphorus	ppm	ASTM D5185m	1150	<b>923</b>	849	817
Zinc	ppm	ASTM D5185m	1350	<b>1048</b>	1080	884
Sulfur	ppm	ASTM D5185m	4250	<b>4140</b>	3590	3512

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>3</b>	4	7
Sodium	ppm	ASTM D5185m	>158	<b>2</b>	<1	2
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	3	4


INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	>3	<b>0.9</b>	0.9	▲ 3.2
Nitration	Abs/cm	*ASTM D7624	>20	<b>6.9</b>	7.4	10.9
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>17.8</b>	18.5	24.6

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>10.3</b>	11.2	15.1
Base Number (BN)	mg KOH/g	ASTM D2896	8.5	<b>9.40</b>	9.28	8.31




# OIL ANALYSIS REPORT


FT-IR (Direct Trend)

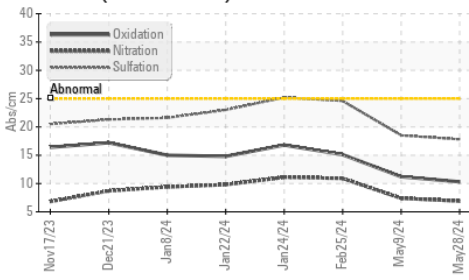

Base Number

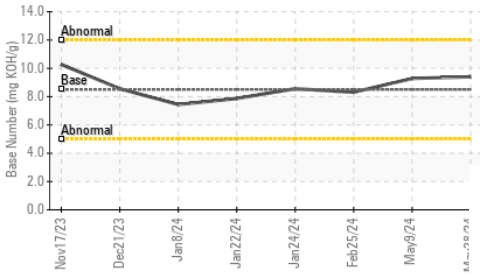

Viscosity @ 100°C

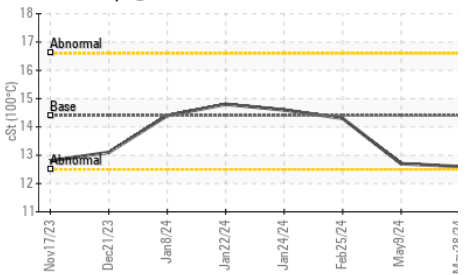


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.4	12.6	12.7

## GRAPHS


Ferrous Alloys

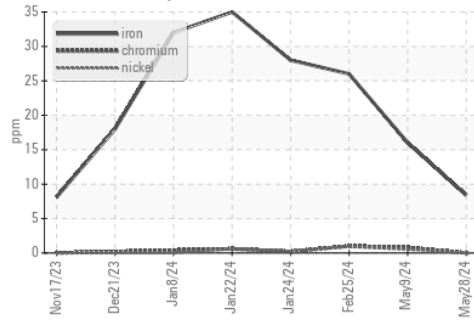


Non-ferrous Metals

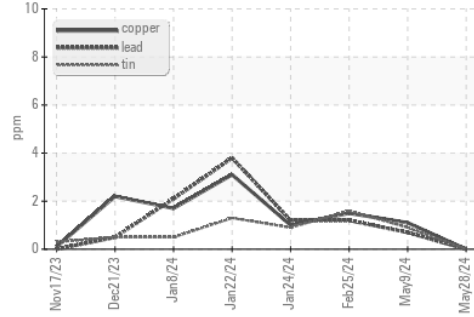

Viscosity @ 100°C

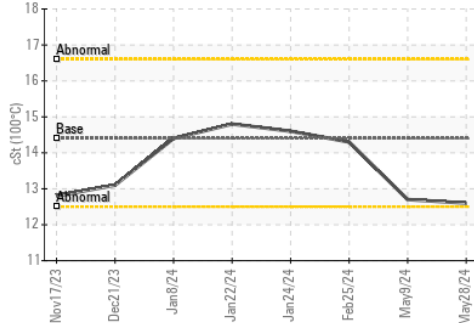

Base Number

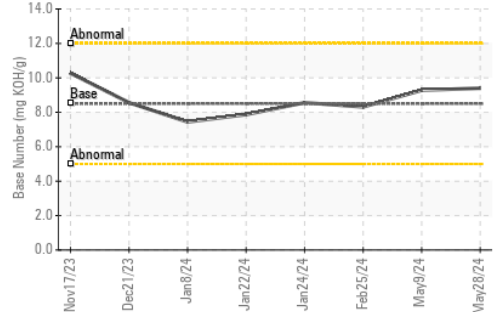

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : HLC0002883  
**Lab Number** : 06202145  
**Unique Number** : 11069606  
**Test Package** : IND 2

**HILCORP EXPLORATION ALASKA - MILNE POINT**  
 1000 MILNE POINT RD  
 PRUDOE BAY, AK  
 US 99734

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**Received** : 06 Jun 2024  
**Tested** : 10 Jun 2024  
**Diagnosed** : 10 Jun 2024 - Wes Davis

Contact: Evan Reilly  
 evan.reilly@hilcorp.com  
 T: (907)670-3231

F: x: