

## **COOLANT REPORT**

Sample Rating Trend



Machine Id

# **GENERAC SUNNY VIEW 1**

Coolant

{not provided} (--- GAL)

#### Recommendation

The fluid is suitable for further service.

### Contaminants

There is no indication of any contamination in the coolant.

#### **Coolant Condition**


Glycol and nitrite levels are acceptable. The pH level of this fluid is within the acceptable limits.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0901721		
Sample Date		Client Info		06 Jun 2024		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
PHYSICAL TEST R	ESULTS	method	limit/base	current	history1	history2
Glycol Type		FT-IR				
Specific Gravity		*ASTM D1298		1.084		
рН	Scale 0-14	ASTM D1287		8.31		
Nitrites	ppm	AP-053:2009		524		
Reserve Alkalinity	Scale 0-20	*ASTM D1121				
Percentage Glycol	%	ASTM D3321		64.9		
Freezing Point	°F	ASTM D3321		-63		
Total Dissolved Solids				325.0		
Carboxylate				n/a		
VISUAL		method	limit/base	current	history1	history2
Coolant Color		*Visual		Yllow		
Coolant Appearance		*Visual	Clear	normal		
Color					no image	no image
Bottom					no image	no image



## **COOLANT REPORT**



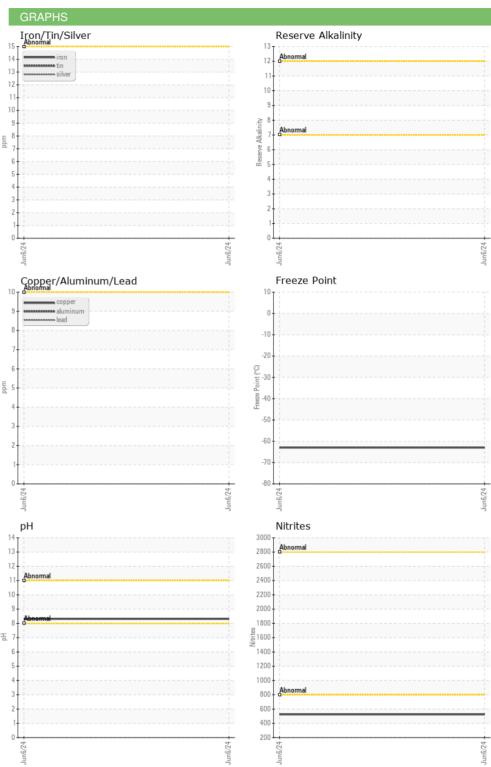



Certificate 12367

Laboratory Sample No.

: WC0901721 Lab Number : 06202346 Unique Number : 11069807

: WearCheck USA - 501 Madison Ave., Cary, NC 27513

Received : 06 Jun 2024 **Tested** Diagnosed

: 11 Jun 2024

: 11 Jun 2024 - Jonathan Hester Test Package : COOL- ( Additional Tests: BoilingPoint, COOL, GlycolType ) To discuss this sample report, contact Customer Service at 1-800-237-1369.

US 28150 Contact: PAIGE paige@carolinapowersolutions.com T: (704)481-0782

**CAROLINA POWER SOLUTION** 

445 W GROVER ST

SHELBY, NC

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)