

OIL ANALYSIS REPORT

Sample Rating Trend



Area [12010]

9333511 (S/N 1866)

Compressor

Fluid KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC122944		
Sample Date		Client Info		22 May 2024		
Machine Age	hrs	Client Info		1001		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
		and the set	Line it //n none		Interface and	history O
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm		>10	<1		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m		2		
Lead	ppm	ASTM D5185m	>10	<1		
Copper	ppm	ASTM D5185m	>50	2		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	22		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	90	62		
Calcium	ppm	ASTM D5185m	2	0		
Phosphorus	ppm	ASTM D5185m		34		
Zinc	ppm	ASTM D5185m		10		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m		14		
Potassium	ppm	ASTM D5185m	>20	11		
Water	%	ASTM D6304	>0.05	0.017		
ppm Water	ppm	ASTM D6304	>500	180		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		2908		
Particles >6µm		ASTM D7647	>1300	720		
Particles >14µm		ASTM D7647	>80	35		
Particles >21µm		ASTM D7647	>20	7		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/17/12		
FLUID DEGRADA		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.33		
× /	5 5					



OIL ANALYSIS REPORT

NONE

NONE

NONE

NONE

LIGHT

NONE

NORML

NORML

NEG

NEG

43.7

Particle Count

Acid Number

491,52

122,880

30.720 7,680

1,920

480

120

30

(^{0.50} (⁰/HOX) 0.40

Ē 0.30

e 0.20

0.10 Acid

0.00

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Ba

no image

no image

no image


no imade

18 18

16

14

:1999 Cle

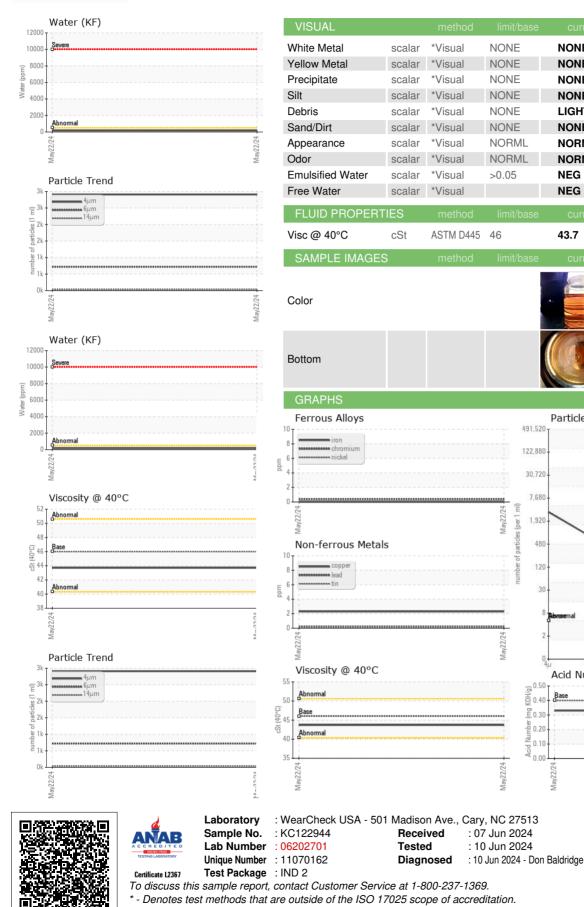

MINALEX CORP 25 CODDINGTON RD WHITEHORSE STATION, NJ US 08889 Contact: Service Manager

T: F:

Report Id: MINWHI [WUSCAR] 06202701 (Generated: 06/10/2024 13:01:25) Rev: 1

Contact/Location: Service Manager - MINWHI

21/