




OIL ANALYSIS REPORT

Sample Rating Trend

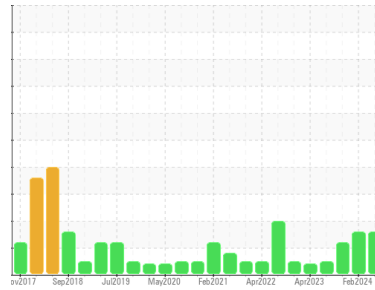

ISO



Machine Id
KAESER ASD 40S 5856938 (S/N 1168)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KC130922	KC122574	KC124402
Sample Date	Client Info			24 May 2024	23 Feb 2024	26 Oct 2023
Machine Age	hrs	Client Info		39144	37329	36098
Oil Age	hrs	Client Info		2000	0	0
Oil Changed	Client Info			Not Chngd	N/A	N/A
Sample Status				ABNORMAL	ABNORMAL	ATTENTION

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	<1	<1	0
Nickel	ppm	ASTM D5185m	>3	0	0	<1
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	2	0	0
Lead	ppm	ASTM D5185m	>10	0	0	<1
Copper	ppm	ASTM D5185m	>50	5	10	10
Tin	ppm	ASTM D5185m	>10	<1	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m	90	33	1	4
Calcium	ppm	ASTM D5185m	2	0	1	0
Phosphorus	ppm	ASTM D5185m		2	3	2
Zinc	ppm	ASTM D5185m		62	18	0

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	0	0
Sodium	ppm	ASTM D5185m		8	0	2
Potassium	ppm	ASTM D5185m	>20	2	0	<1
Water	%	ASTM D6304	>0.05	0.014	0.005	0.009
ppm Water	ppm	ASTM D6304	>500	150	54	99.8

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		5621	5309	2674
Particles >6µm		ASTM D7647	>1300	▲ 2013	▲ 2067	1040
Particles >14µm		ASTM D7647	>80	▲ 247	▲ 168	● 90
Particles >21µm		ASTM D7647	>20	▲ 68	▲ 40	● 24
Particles >38µm		ASTM D7647	>4	2	2	2
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 20/18/15	▲ 20/18/15	● 19/17/14

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.37	0.36	0.34

OIL ANALYSIS REPORT

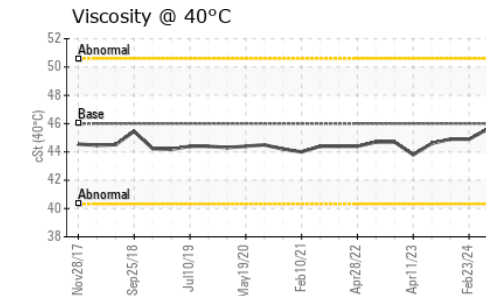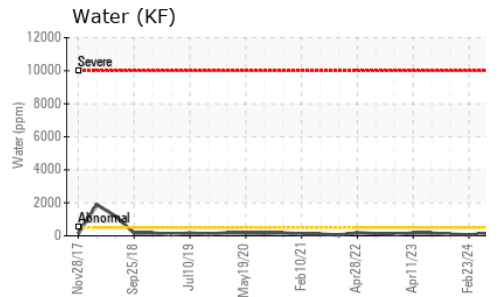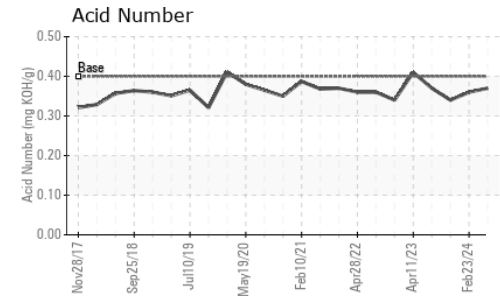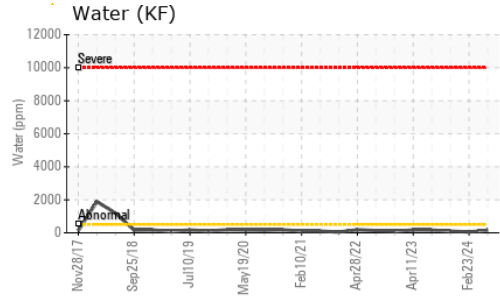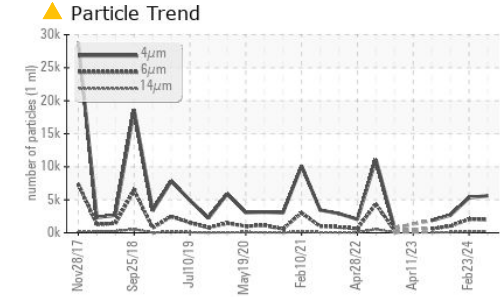






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	45.6	44.9	44.9

SAMPLE IMAGES

method	limit/base	current	history1	history2
Color				
Bottom				

GRAPHS

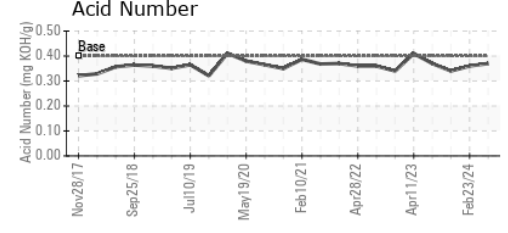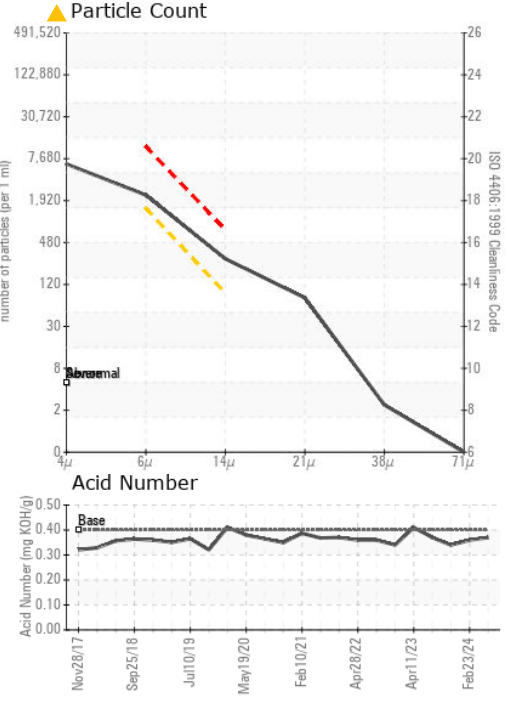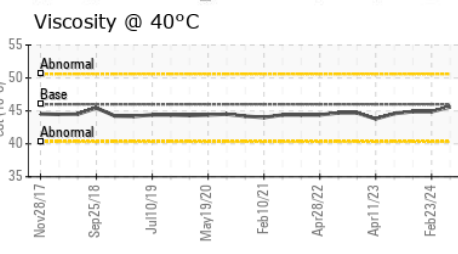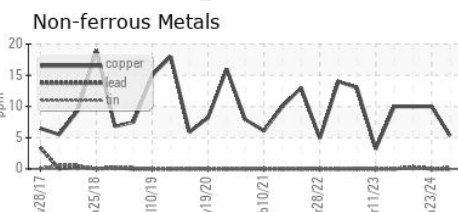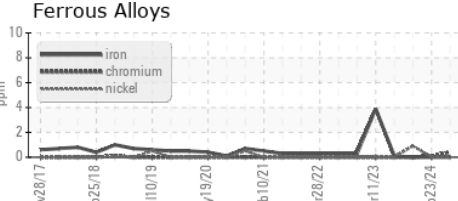

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC130922
Lab Number : 06202722
Unique Number : 11070183
Test Package : IND 2
Received : 07 Jun 2024
Tested : 10 Jun 2024
Diagnosed : 10 Jun 2024 - Don Baldrige

STOCKMEIER
 20 COLUMBIA AVE
 CLARKSBURG, WV
 US 26301
 Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)