


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id

KAESER 7946986

Component Compressor

KAESER SIGMA (OEM) S-460 (--- QTS)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Sep	2023	Feb2024 May20	24	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC128587	KC122599	KC110824
Sample Date		Client Info		24 May 2024	14 Feb 2024	19 Sep 2023
Machine Age	hrs	Client Info		3713	3356	2909
Oil Age	hrs	Client Info		400	0	500
Oil Changed		Client Info		Changed	N/A	Changed
Sample Status				NORMAL	ABNORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	<1	<1	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	2	0	0
Lead	ppm	ASTM D5185m	>10	0	<1	0
Copper	ppm	ASTM D5185m	>50	0	0	0
Tin	ppm	ASTM D5185m	>10	<1	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	49	24	34
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m	90	78	19	72
Calcium	ppm	ASTM D5185m	2	0	2	4
Phosphorus	ppm	ASTM D5185m		<1	0	3
Zinc	ppm	ASTM D5185m		3	0	10
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	0	0
Sodium	ppm	ASTM D5185m		8	0	8
Potassium	ppm	ASTM D5185m	>20	2	0	1
Water	%	ASTM D6304	>0.05	0.017	<u>△</u> 0.245	0.046
ppm Water	ppm	ASTM D6304	>500	172	<u>^</u> 2450	464.4
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		943	2584	502
Particles >6μm		ASTM D7647	>1300	463	<u>1407</u>	189
Particles >14μm		ASTM D7647	>80	47	<u>^</u> 240	12
Particles >21µm		ASTM D7647		9	<u></u> 81	1
Particles >38µm		ASTM D7647	>4	0	<u>12</u>	0
Particles >71μm		ASTM D7647	>3	0	1	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/16/13	<u> </u>	16/15/11
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
	I/OII/	10T11 D0015	0 1		0.04	

Acid Number (AN)

mg KOH/g ASTM D8045 0.4


0.21

0.31

0.33



OIL ANALYSIS REPORT

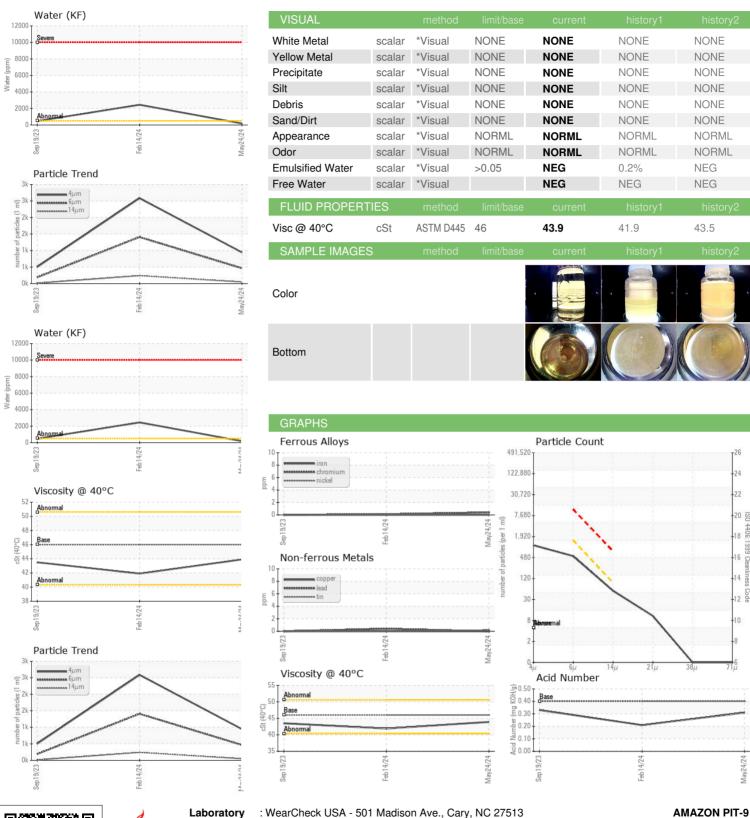





Certificate 12367

Laboratory Sample No.

Lab Number Unique Number : 11070195

: KC128587 : 06202734 Test Package : IND 2

Received : 07 Jun 2024 **Tested** : 10 Jun 2024

Diagnosed : 10 Jun 2024 - Don Baldridge 17 WILLIAM DR IMPERIAL, PA US 15126

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: