

OIL ANALYSIS REPORT

Sample Rating Trend

ISO

Machine Id

8393462 (S/N 1912)

Component Compressor Fluid KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC128575		
Sample Date		Client Info		23 May 2024		
Machine Age	hrs	Client Info		5012		
Oil Age	hrs	Client Info		3000		
Oil Changed		Client Info		Not Changd		
Sample Status				ATTENTION		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	2		
Lead	ppm	ASTM D5185m	>10	- <1		
Copper	ppm	ASTM D5185m	>50	3		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m	- 10	0		
Cadmium	ppm	ASTM D5185m		0		
	ррш			-		
ADDITIVES		method	limit/base		history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	19		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	90	79		
Calcium	ppm	ASTM D5185m	2	0		
Phosphorus	ppm	ASTM D5185m		2		
Zinc	ppm	ASTM D5185m		5		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		24		
Potassium	ppm	ASTM D5185m	>20	3		
Water	%	ASTM D6304	>0.05	0.029		
ppm Water	ppm	ASTM D6304	>500	297		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		5592		
Particles >6µm		ASTM D7647	>1300	<u> </u>		
Particles >14µm		ASTM D7647	>80	<mark> </mark> 119		
Particles >21µm		ASTM D7647	>20	<mark>-</mark> 24		
Particles >38µm		ASTM D7647	>4	1		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	e 20/18/14		
FLUID DEGRADA		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.33		



OIL ANALYSIS REPORT

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML

>0.05

46

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML

NEG

NEG

44.5

Particle Count

Acid Number

491,5

122,880 30.720 7,680

480

120

30

(^{0.50} (⁰/HOX) 0.40

Ē 0.30

· 문 0.20

0.10 Acid

0.00

Ba

Mav23/24

May23/24

Mav23/24

per 1 1,920 no image

no image


no image

no image

18 18

14

:1999 Cle

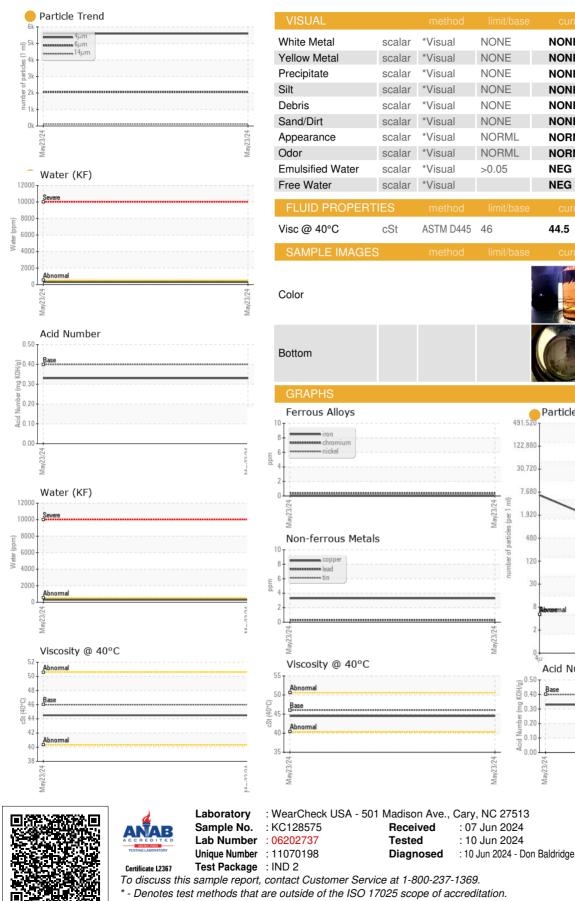

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F:

Contact/Location: Service Manager - IMPMER

214

28

IMPERIAL SYSTEMS

Contact: Service Manager

155 MCKINLEY AVE

MERCER, PA

US 16137

Page 2 of 2