




# OIL ANALYSIS REPORT

Sample Rating Trend

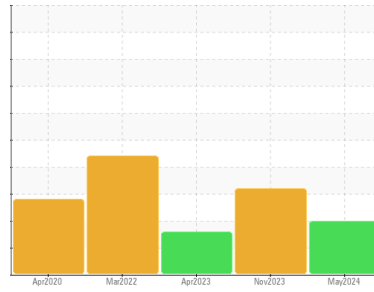

ISO



Machine Id  
**KAESER 1546683 (S/N 1046)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>KC128553</b>	KC124370	KC102038
Sample Date	Client Info	<b>29 May 2024</b>	02 Nov 2023	17 Apr 2023
Machine Age	hrs	<b>76652</b>	74853	72426
Oil Age	hrs	<b>1799</b>	0	3800
Oil Changed	Client Info	<b>Not Chngd</b>	N/A	Not Chngd
Sample Status		<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

## WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>&lt;1</b>	1	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>2</b>	0	0
Lead	ppm	ASTM D5185m >10	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m >50	<b>6</b>	15	9
Tin	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 90	<b>7</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m 90	<b>36</b>	0	8
Calcium	ppm	ASTM D5185m 2	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	<b>1</b>	2	3
Zinc	ppm	ASTM D5185m	<b>2</b>	0	0

## CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	<b>0</b>	0	0
Sodium	ppm	ASTM D5185m	<b>8</b>	1	2
Potassium	ppm	ASTM D5185m >20	<b>1</b>	<1	<1
Water	%	ASTM D6304 >0.05	<b>0.018</b>	▲ 0.420	0.006
ppm Water	ppm	ASTM D6304 >500	<b>181</b>	▲ 4200	66.4






## FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	<b>38376</b>	1374	13675
Particles >6µm	ASTM D7647 >1300	▲ <b>15316</b>	749	▲ 3641
Particles >14µm	ASTM D7647 >80	▲ <b>1584</b>	● 127	▲ 309
Particles >21µm	ASTM D7647 >20	▲ <b>368</b>	● 43	▲ 81
Particles >38µm	ASTM D7647 >4	▲ <b>11</b>	● 7	2
Particles >71µm	ASTM D7647 >3	<b>0</b>	1	0
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ <b>22/21/18</b>	● 18/17/14	▲ 21/19/15

## FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.31</b>	0.30	0.30


# OIL ANALYSIS REPORT

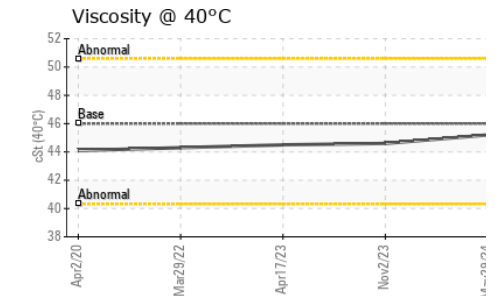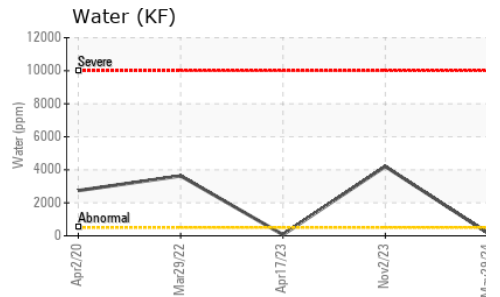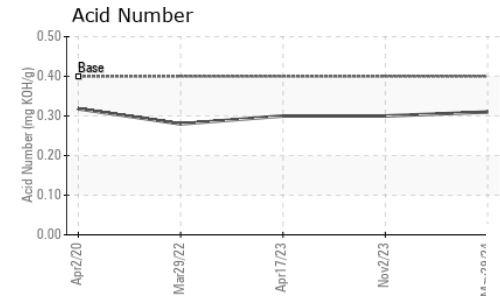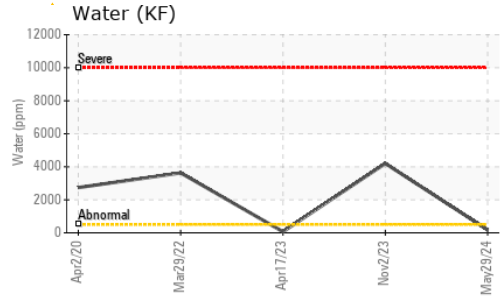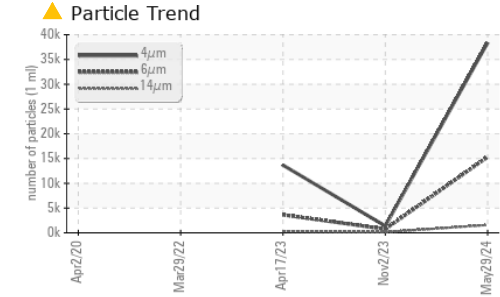





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	0.2%	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	45.2	44.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

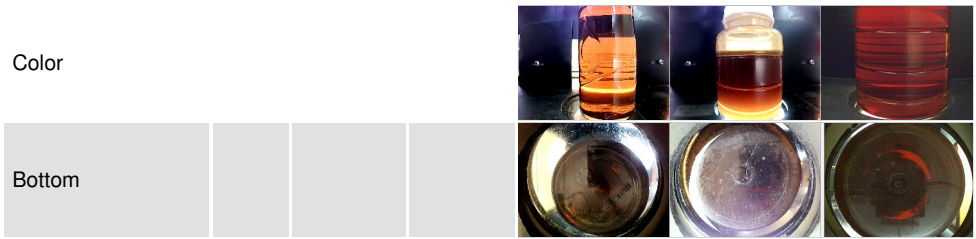

## GRAPHS

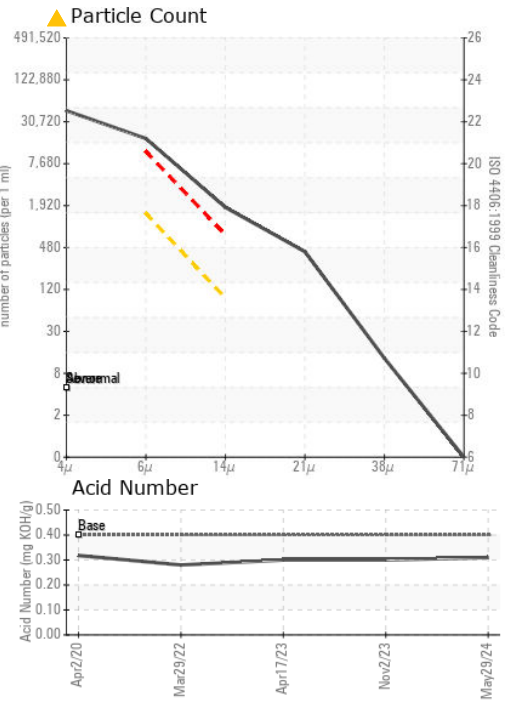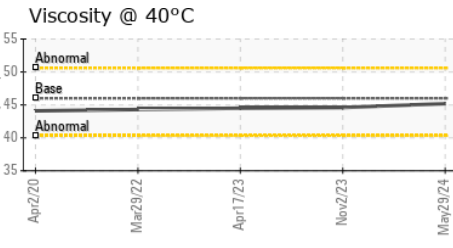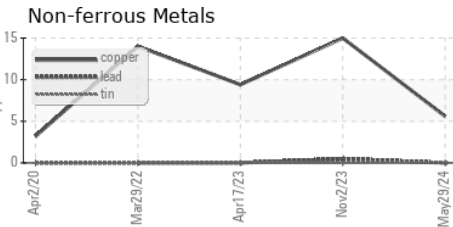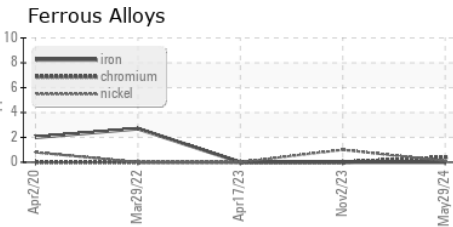

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC128553  
**Lab Number** : 06202744  
**Unique Number** : 11070205  
**Test Package** : IND 2  
**Received** : 07 Jun 2024  
**Tested** : 10 Jun 2024  
**Diagnosed** : 10 Jun 2024 - Don Baldrige

**WHEELER BROTHERS**  
 409 DRUM AVE  
 SOMERSET, PA  
 US 15501  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)