

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

SULLAIR 4 NEW SULLAIR (S/N US0122080197)

Air Compressor

SULLAIR PRISTINE FG (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Feb 2024	Jun2024		
			1602024	UUILULY		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USPM37543	USPM30090	
Sample Date		Client Info		06 Jun 2024	20 Feb 2024	
Machine Age	hrs	Client Info		0	7041	
Oil Age	hrs	Client Info		0	0	
Oil Changed		Client Info		N/A	N/A	
Sample Status				NORMAL	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	
Chromium	ppm	ASTM D5185m	>4	<1	0	
Nickel	ppm	ASTM D5185m	>4	0	0	
Titanium	ppm	ASTM D5185m		0	0	
Silver	ppm	ASTM D5185m		0	0	
Aluminum	ppm	ASTM D5185m	>10	2	0	
Lead	ppm	ASTM D5185m	>20	0	0	
Copper	ppm	ASTM D5185m	>40	0	0	
Tin	ppm	ASTM D5185m	>5	<1	<1	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	0	0	1	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		0	<1	
Magnesium	ppm	ASTM D5185m	0	<1	<1	
Calcium	ppm	ASTM D5185m	0	0	1	
Phosphorus	ppm	ASTM D5185m	0	0	<1	
Zinc	ppm	ASTM D5185m	2	0	0	
Sulfur	ppm	ASTM D5185m		0	76	
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	
Sodium	ppm	ASTM D5185m		0	<1	
Potassium	ppm	ASTM D5185m	>20	<1	<1	
Water	%	ASTM D6304	>0.6	0.021	0.019	
ppm Water	ppm	ASTM D6304	>6000	213	192	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	738	178	
Particles >6μm		ASTM D7647	>2500	333	52	
Particles >14µm		ASTM D7647	>320	52	5	
Particles >21µm		ASTM D7647	>80	18	1	
Particles >38µm		ASTM D7647	>20	2	0	
Particles >71µm		ASTM D7647	>4	0	0	
Oil Cleanliness		ISO 4406 (c)	>20/18/15	17/16/13	15/13/10	
FLUID DEGRADA	NOITA	method	limit/base	current	history1	history2
Acid Number (AN)	ma KOH/a	4STM D8045	0.06	0.67	1 28	

Acid Number (AN)


mg KOH/g ASTM D8045 0.06

1.28

0.67



OIL ANALYSIS REPORT

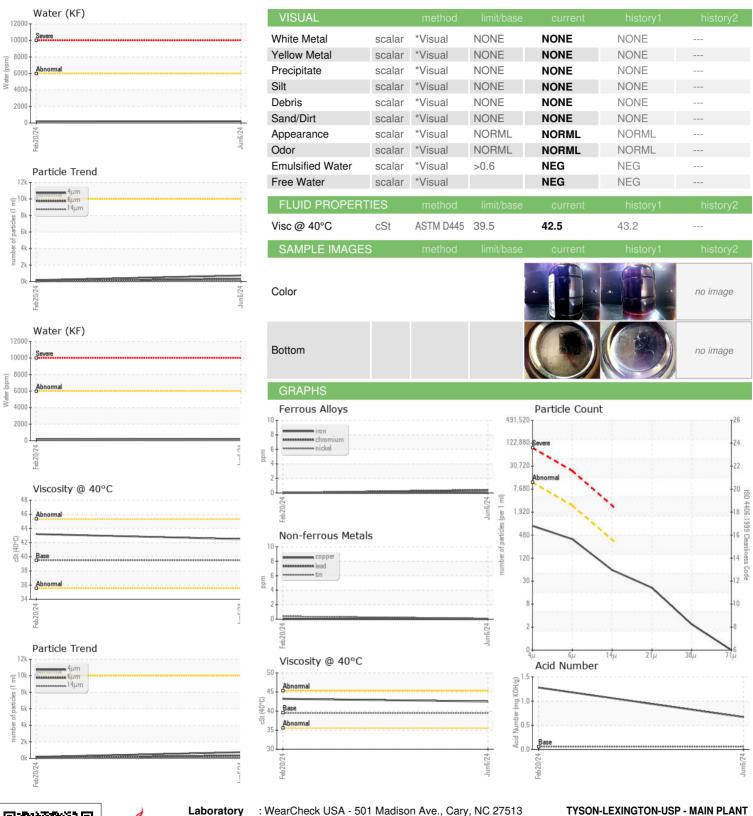



Certificate 12367

Laboratory Sample No. : USPM37543 Lab Number : 06202758 Unique Number : 11070219

Test Package : IND 2

Received : 07 Jun 2024 **Tested** Diagnosed

: 11 Jun 2024 : 11 Jun 2024 - Doug Bogart

TYSON-LEXINGTON-USP - MAIN PLANT PO BOX 920, PROSPECT ROAD US 283 LEXINGTON, NE

US 68850 Contact: SCOTT NIERMAN

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (308)324-8221

F: (308)324-8233