




OIL ANALYSIS REPORT

Sample Rating Trend

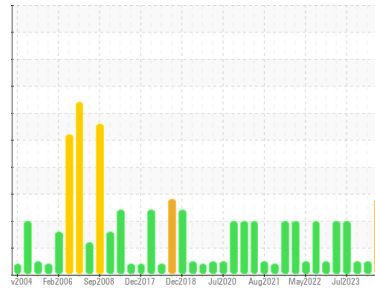

WATER



Machine Id
QUINCY 370 #6 Q-370 Hyd. Rm (S/N 92810J)
 Component
Air Compressor
 Fluid
USPI FG AIR 46 (--- QTS)

DIAGNOSIS

Recommendation

We advise that you follow the water drain-off procedure for this component. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

Wear

All component wear rates are normal.

Contamination

Moderate concentration of visible dirt/debris present in the oil. There is a moderate amount of visible silt present in the sample. Free water present.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	USPM37538	USPM30048	USPM31105
Sample Date	Client Info	06 Jun 2024	15 Feb 2024	23 Oct 2023
Machine Age	hrs	0	0	0
Oil Age	hrs	0	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		ABNORMAL	NORMAL	NORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	1	0	0
Chromium	ppm	ASTM D5185m >4	<1	0	0
Nickel	ppm	ASTM D5185m >4	0	0	<1
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >10	0	0	0
Lead	ppm	ASTM D5185m >20	0	<1	0
Copper	ppm	ASTM D5185m >40	0	<1	0
Tin	ppm	ASTM D5185m >5	0	0	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m 0	0	0	0
Barium	ppm	ASTM D5185m 0	0	0	0
Molybdenum	ppm	ASTM D5185m 0	0	0	0
Manganese	ppm	ASTM D5185m	0	<1	0
Magnesium	ppm	ASTM D5185m 0	0	1	0
Calcium	ppm	ASTM D5185m 0	0	1	2
Phosphorus	ppm	ASTM D5185m 0	0	0	<1
Zinc	ppm	ASTM D5185m 0	0	0	0
Sulfur	ppm	ASTM D5185m 0	0	0	0

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	0	<1	<1
Sodium	ppm	ASTM D5185m	0	<1	0
Potassium	ppm	ASTM D5185m >20	<1	<1	<1
Water	%	ASTM D6304 >0.6	0.014	0.003	0.002
ppm Water	ppm	ASTM D6304 >6000	140	27	17.8

FLUID CLEANLINESS




method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	---	177	3386
Particles >6µm	ASTM D7647 >2500	---	82	580
Particles >14µm	ASTM D7647 >320	---	10	22
Particles >21µm	ASTM D7647 >80	---	4	8
Particles >38µm	ASTM D7647 >20	---	1	1
Particles >71µm	ASTM D7647 >4	---	0	0
Oil Cleanliness	ISO 4406 (c) >--/18/15	---	15/14/10	19/16/12

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.15	0.06	0.222	0.084




OIL ANALYSIS REPORT

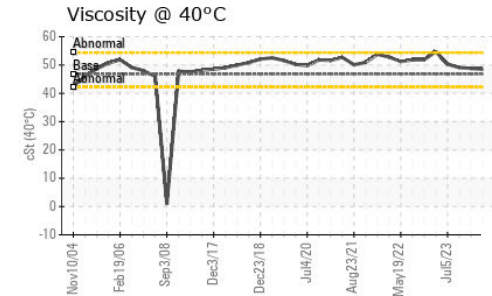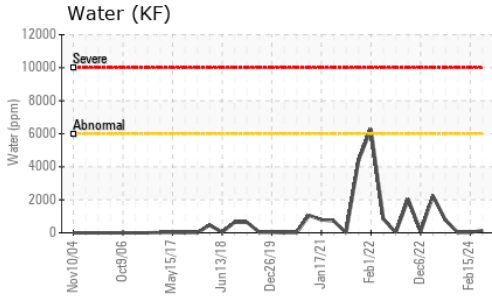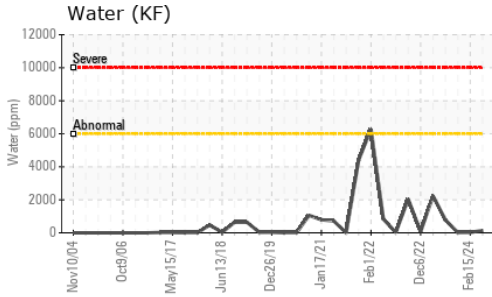





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	▲ MODER	NONE	NONE
Debris	scalar	*Visual	▲ MODER	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.6	0.2%	NEG
Free Water	scalar	*Visual		▲ 2.0	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46.8	48.5	48.8

SAMPLE IMAGES

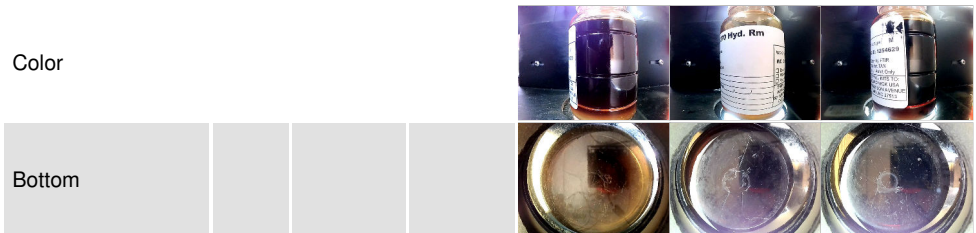

GRAPHS

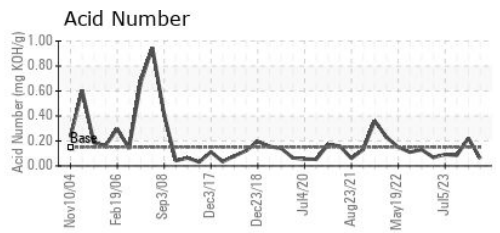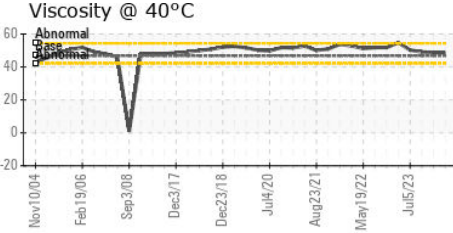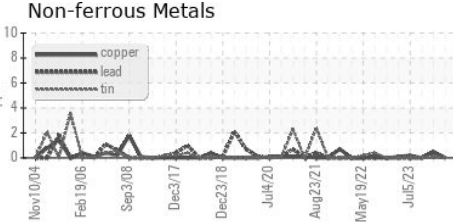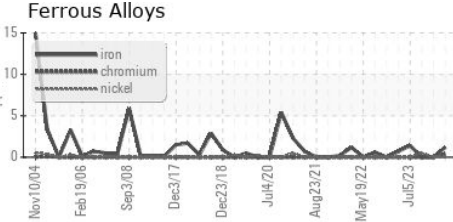

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : USPM37538 **Received** : 07 Jun 2024
Lab Number : 06202763 **Tested** : 11 Jun 2024
Unique Number : 11070224 **Diagnosed** : 11 Jun 2024 - Doug Bogart
Test Package : IND 2

TYSON - CUMMING- USP
 CUMMING, GA
 US 30130
 Contact: BRENT SMITH

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (402)423-6375

F: (402)423-6661