

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

LIQUID RING VAC 1 (S/N 46493)

Component Vacuum Pump

{not provided} (15 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				May2024		
SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0933744		
Sample Date		Client Info		30 May 2024		
Machine Age	hrs	Client Info		1867		
Oil Age	hrs	Client Info		1867		
Oil Changed		Client Info		Not Changd		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184		17		
Iron	ppm	ASTM D5185m	>20	0		
Chromium	ppm	ASTM D5185m	>20	0		
Nickel	ppm	ASTM D5185m	>20	0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>20	0		
Lead	ppm	ASTM D5185m	>20	0		
Copper	ppm	ASTM D5185m	>20	0		
Tin	ppm	ASTM D5185m	>20	0		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		11		
Zinc	ppm	ASTM D5185m		10		
Sulfur	ppm	ASTM D5185m		144		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	14		
Sodium	ppm	ASTM D5185m		8		
Potassium	ppm	ASTM D5185m	>20	0		
Water	%	ASTM D6304	>.1	NEG		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2


0.09

Acid Number (AN)

mg KOH/g ASTM D8045



OIL ANALYSIS REPORT

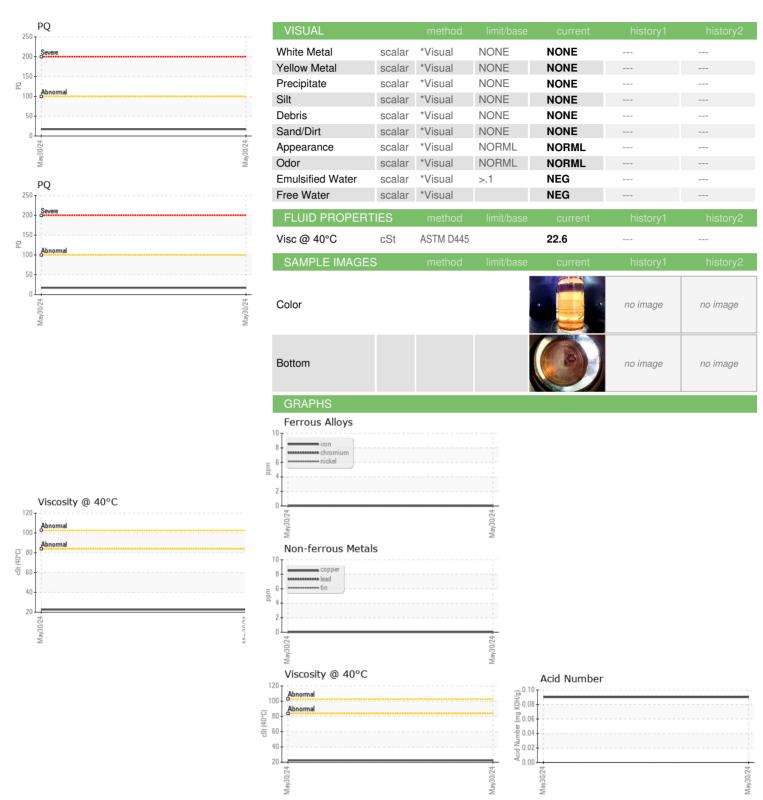





Certificate 12367

Laboratory Sample No.

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : WC0933744 Lab Number : 06202871 Unique Number : 11070332 Test Package : PLANT

Received : 07 Jun 2024 **Tested** : 11 Jun 2024 Diagnosed : 11 Jun 2024 - Jonathan Hester

AIR-VAC EQUIPMENT SALES AND SERVICE 2925 E DAVIS STREET CONROE, TX

US 77301 Contact: DOUG JONES doug.jones@air-vac.com

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: AIRCON [WUSCAR] 06202871 (Generated: 06/12/2024 06:42:08) Rev: 1

Contact/Location: DOUG JONES - AIRCON

T:

F: