


OIL ANALYSIS REPORT

PG-46 [287145] PNEUTECH AK1000018321 - FABMAX

Component Compressor

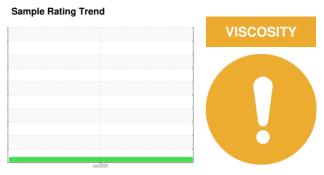

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the


Fluid Condition


The oil viscosity is higher than normal. The AN level is acceptable for this fluid.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UFD0001140		
Sample Date		Client Info		04 Jun 2024		
Machine Age	hrs	Client Info		10794		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Not Changd		
Sample Status				ATTENTION		
CONTAMINATIO	N	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	0		
Lead	ppm	ASTM D5185m	>25	0		
Copper	ppm	ASTM D5185m	>50	<1		
Tin	ppm	ASTM D5185m	>15	0		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		<1		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		<1		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		282		
Zinc	ppm	ASTM D5185m		14		
Sulfur	ppm	ASTM D5185m		883		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	<1		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.49		



OIL ANALYSIS REPORT






VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE		
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulsified Water	scalar	*Visual	>0.1	NEG		
Free Water	scalar	*Visual		NEG		
FLUID PROPERT	ΓIES	method	limit/base	current	history1	history2

SAMPLE IMAGES	meth	od limit/base	current	history1	history2
Color			September 1	no image	no image
Bottom				no image	no image

54.93


Visc @ 40°C




cSt

ASTM D445

10	Non-ferrous Metals
T	
8 -	copper
_∈ 6-	enconnection tin
Ed 4	
2	
0	
0	24
	Jun4,24
	7 7









Certificate 12367

Laboratory

Sample No. : UFD0001140 Lab Number : 06202900

Test Package : IND 2

Unique Number : 11070361

: WearCheck USA - 501 Madison Ave., Cary, NC 27513

Received : 07 Jun 2024 Tested

: 13 Jun 2024

: 14 Jun 2024 - Don Baldridge

Diagnosed

US 60143 Contact: ED DIENER ed.diener@fluidairedynamics.com

FLUID-AIRE DYNAMICS

225 SPRING LAKE DR

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: UCFLUSCH [WUSCAR] 06202900 (Generated: 06/14/2024 10:08:23) Rev: 1

Contact/Location: ED DIENER - UCFLUSCH

T: (847)678-8388

ITASCA, IL