




OIL ANALYSIS REPORT

Sample Rating Trend

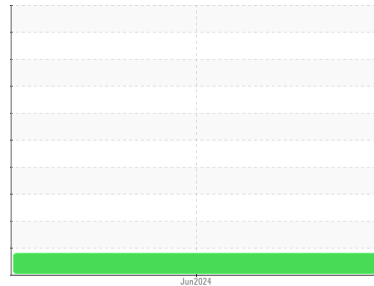

ISO



Machine Id
Oil room tote 25
 Component
Bulk Fluid Tank
 Fluid
TURBINE OIL ISO 100 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION	method	limit/base	current	history1	history2
Sample Number	Client Info		RP0042856	---	---
Sample Date	Client Info		05 Jun 2024	---	---
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		Not Changed	---	---
Sample Status			ATTENTION	---	---

WEAR METALS	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	0	---	---
Chromium	ppm	ASTM D5185m	0	---	---
Nickel	ppm	ASTM D5185m	0	---	---
Titanium	ppm	ASTM D5185m	0	---	---
Silver	ppm	ASTM D5185m	0	---	---
Aluminum	ppm	ASTM D5185m	0	---	---
Lead	ppm	ASTM D5185m	0	---	---
Copper	ppm	ASTM D5185m	0	---	---
Tin	ppm	ASTM D5185m	<1	---	---
Vanadium	ppm	ASTM D5185m	0	---	---
Cadmium	ppm	ASTM D5185m	0	---	---

ADDITIVES	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 5	0	---	---
Barium	ppm	ASTM D5185m 5	1	---	---
Molybdenum	ppm	ASTM D5185m 5	0	---	---
Manganese	ppm	ASTM D5185m	<1	---	---
Magnesium	ppm	ASTM D5185m 5	4	---	---
Calcium	ppm	ASTM D5185m 10	20	---	---
Phosphorus	ppm	ASTM D5185m 275	42	---	---
Zinc	ppm	ASTM D5185m 7	24	---	---


CONTAMINANTS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1	---	---
Sodium	ppm	ASTM D5185m	1	---	---
Potassium	ppm	ASTM D5185m >20	2	---	---
Water	%	ASTM D6304	0.00	---	---
ppm Water	ppm	ASTM D6304	0	---	---

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	7273	---	---
Particles >6µm	ASTM D7647	>1300	1270	---	---
Particles >14µm	ASTM D7647	>160	18	---	---
Particles >21µm	ASTM D7647	>40	4	---	---
Particles >38µm	ASTM D7647	>10	1	---	---
Particles >71µm	ASTM D7647	>3	1	---	---
Oil Cleanliness	ISO 4406 (c)	>19/17/14	20/17/11	---	---


FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.13	0.088	---	---

OIL ANALYSIS REPORT


Particle Trend

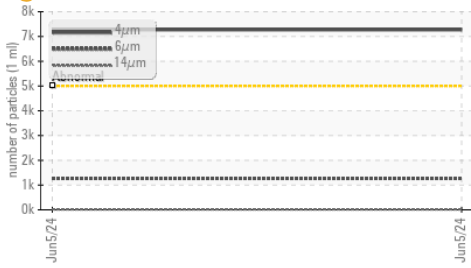


Water (KF)

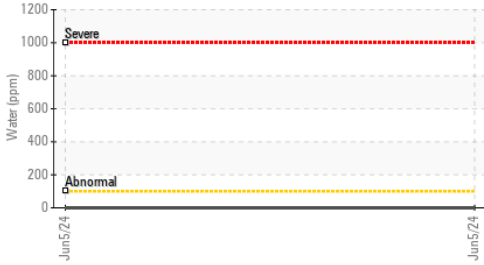


Viscosity @ 100°C

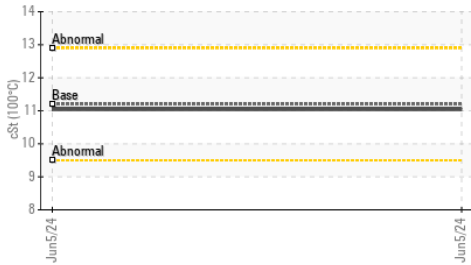

Water (KF)

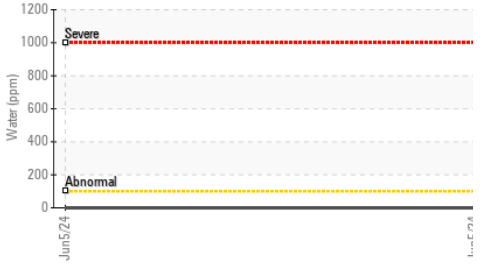

Viscosity @ 100°C

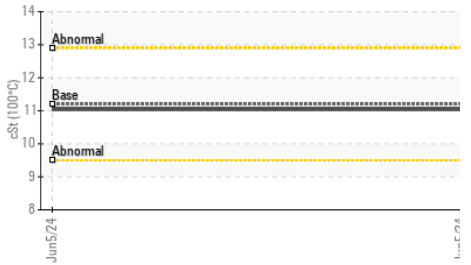

VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	NEG	---	---	
Free Water	scalar	*Visual	NEG	---	---	

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	100	90.93	---	---
Visc @ 100°C	cSt	ASTM D445	11.2	11.04	---	---
Viscosity Index (VI)	Scale	ASTM D2270	97	106	---	---

SAMPLE IMAGES

	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

GRAPHS

Ferrous Alloys




Non-ferrous Metals




Viscosity @ 40°C



Particle Count

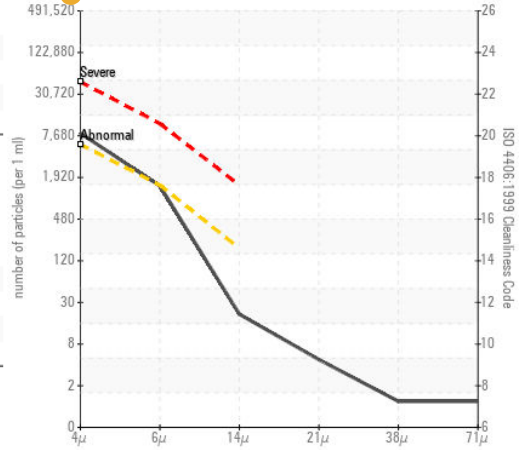

Acid Number



Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : RP0042856

Lab Number : 06203197

Unique Number : 11070658

Test Package : IND 2 (Additional Tests: KV100, PrtCount, VI)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Received : 07 Jun 2024

Tested : 12 Jun 2024

Diagnosed : 12 Jun 2024 - Angela Borella

CALUMET

3333 MIDWAY AVENUE

SHREVEPORT, LA

US 71109

Contact: NICHOLAS LESAGE

nicholas.lesage@clmt.com

T:

F: