

FUEL REPORT

Area QTS ATLANTA GA DC1 [4771] [QTS ATLANTA GA DC1] GG2

Diesel Fuel Fluid

No.2 DIESEL FUEL (ULTRALOW SULPHUR) (10600 GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel.

Corrosion

All metal levels are normal indicating no corrosion in the system.

Contaminants

Light concentration of visible dirt/debris present in the fuel. The water content is negligible. There is no bacteria or fungus (yeast and/or mold) indicated in the sample. The amount and size of particulates present in the system are acceptable.

Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.




Sample Rating Trend



SAMPLE INFORM	1ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0953934		
Sample Date		Client Info		22 May 2024		
Machine Age	hrs	Client Info		0		
Sample Status				NORMAL		
PHYSICAL PROP	ERTIES	method	limit/base	current	history1	history2
Fuel Color	text	*Visual Screen	Yllow	Red		
ASTM Color	scalar	*ASTM D1500		L4.5		
Visc @ 40°C	cSt	ASTM D445	3.0	2.46		
Pensky-Martens Flash Point	°C	*PMCC Calculated	52	61.1		
SULFUR CONTER	NT	method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m	10	1		
Sulfur (UVF)	ppm	ASTM D5453		8		
DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D86	165	172		
5% Distillation Point	°C	ASTM D86		194		
10% Distill Point	°C	ASTM D86	201	204		
15% Distillation Point	°C	ASTM D86		212		
20% Distill Point	°C	ASTM D86	216	219		
30% Distill Point	°C	ASTM D86	230	234		
40% Distill Point	°C	ASTM D86	243	247		
50% Distill Point	°C	ASTM D86	255	261		
60% Distill Point	°C	ASTM D86	267	275		
70% Distill Point	°C	ASTM D86	280	288		
80% Distill Point	°C	ASTM D86	295	304		
85% Distillation Point	°C	ASTM D86		315		
90% Distill Point	°C	ASTM D86	310	326		
95% Distillation Point	°C	ASTM D86		344		
Final Boiling Point	°C	ASTM D86	341	362		
IGNITION QUALIT	ΓY	method	limit/base	current	history1	history2
API Gravity		ASTM D7777	37.7	36		
Cetane Index		ASTM D4737	<40.0	48		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	0		
Sodium	ppm	ASTM D5185m	<0.1	2		
Potassium	ppm	ASTM D5185m	<0.1	2		
Water	%	ASTM D6304	<0.05	0.003		
ppm Water	ppm	ASTM D6304	<500	27		
% Gasoline	%	*In-House	<0.50	0.0		
% Biodiesel	%	*In-House	<20.0	0.0		



FUEL REPORT

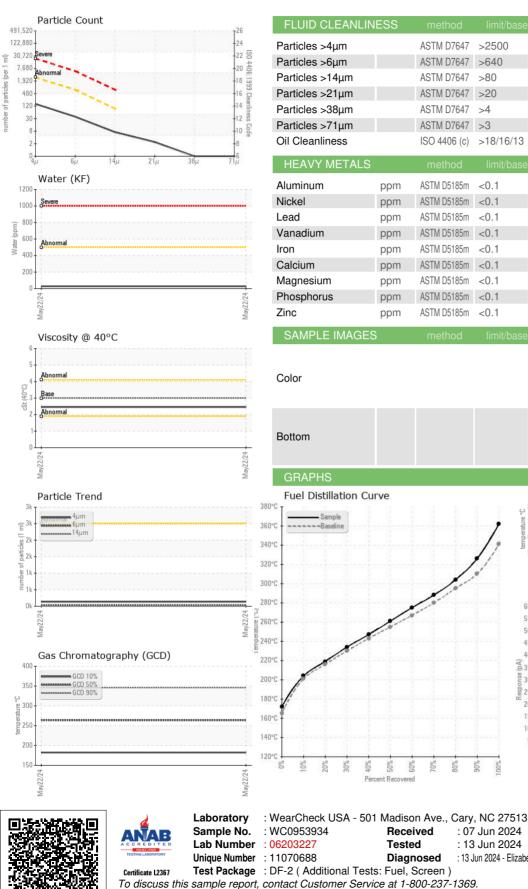

LUID CLEANLI	NESS	method				history2
rticles >4µm		ASTM D7647	>2500	136		
rticles >6μm		ASTM D7647	>640	33		
rticles >14μm		ASTM D7647	>80	6		
rticles >21µm		ASTM D7647	>20	2		
rticles >38µm		ASTM D7647	>4	0		
rticles >71µm		ASTM D7647	>3	0		
Cleanliness		ISO 4406 (c)	>18/16/13	14/12/10		
EAVY METALS	6	method	limit/base	current	history1	history2
minum	ppm	ASTM D5185m	<0.1	0		
kel	ppm	ASTM D5185m	<0.1	<1		
ad	ppm	ASTM D5185m	<0.1	0		
nadium	ppm	ASTM D5185m	<0.1	0		
า	ppm	ASTM D5185m	<0.1	0		
lcium	ppm	ASTM D5185m	<0.1	<1		
gnesium	ppm	ASTM D5185m	<0.1	0		
osphorus	ppm	ASTM D5185m	<0.1	8		
с	ppm	ASTM D5185m	<0.1	5		
AMPLE IMAGE	S	method	limit/base	current	history1	history2
lor					no image	no image
ttom					no image	no image


80

: 07 Jun 2024

: 13 Jun 2024

: 13 Jun 2024 - Elizabeth Valachovic

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

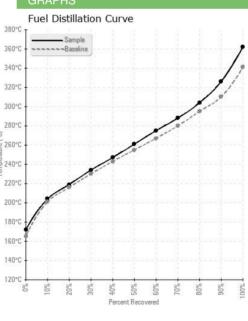

Received

Diagnosed

Tested

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

월 70 60 /av22/24 GCD Spectrum 600 **BEGRE** 550 500 450 400 Q 350 300 8 250 200 150 100 50 Time (min) 5 16 20

Pensky-Martens Flash Point (°C)

PETROLEUM RECOVERY SERVICES 210 POWELL DR SUMMERVILLE, SC US 29483 Contact: AJAY EL Ajay@prsfuel.com T: (843)225-1777 E:

Report Id: PETSUM [WUSCAR] 06203227 (Generated: 06/15/2024 08:28:33) Rev: 1

Contact/Location: AJAY EL - PETSUM

Page 2 of 2