OIL ANALYSIS REPORT

Sample Rating Trend

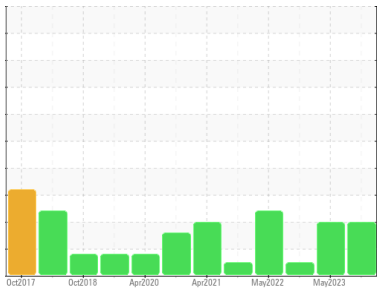

WEAR

Machine Id
MCI/OS/GJ-7502A
Component
Blower
Fluid
ROYAL PURPLE THERMYL-GLYDE 100 (--- GAL)

DIAGNOSIS

Recommendation
We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

Wear
The iron level is abnormal. All other component wear rates are normal.

Contamination
There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**WC0932111**	WC0807297	WC0583604
Sample Date		Client Info		**23 May 2024**	10 May 2023	26 Aug 2022
Machine Age	mths	Client Info		**0**	55	0
Oil Age	mths	Client Info		**67**	0	46
Oil Changed		Client Info		**N/A**	N/A	Not Changd
Sample Status				**ABNORMAL**	ABNORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	▲ **44**	▲ 38	2
Chromium	ppm	ASTM D5185m	>20	**<1**	<1	0
Nickel	ppm	ASTM D5185m	>20	**0**	0	0
Titanium	ppm	ASTM D5185m		**<1**	0	0
Silver	ppm	ASTM D5185m		**0**	0	<1
Aluminum	ppm	ASTM D5185m	>20	**2**	0	<1
Lead	ppm	ASTM D5185m	>20	**2**	0	0
Copper	ppm	ASTM D5185m	>20	**3**	1	16
Tin	ppm	ASTM D5185m	>20	**<1**	0	0
Vanadium	ppm	ASTM D5185m		**0**	0	0
Cadmium	ppm	ASTM D5185m		**0**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		**0**	0	0
Barium	ppm	ASTM D5185m		**11**	22	0
Molybdenum	ppm	ASTM D5185m		**<1**	0	<1
Manganese	ppm	ASTM D5185m		**<1**	<1	0
Magnesium	ppm	ASTM D5185m		**39**	64	0
Calcium	ppm	ASTM D5185m		**41**	114	0
Phosphorus	ppm	ASTM D5185m		**26**	25	52
Zinc	ppm	ASTM D5185m		**8**	0	0
Sulfur	ppm	ASTM D5185m		**20394**	23084	19491

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	**12**	6	5
Sodium	ppm	ASTM D5185m		**0**	3	0
Potassium	ppm	ASTM D5185m	>20	**1**	0	0
Water	%	ASTM D6304		**NEG**	NEG	NEG

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>2500	▲ **7749**	▲ 16549	1983
Particles >6µm		ASTM D7647	>640	▲ **1580**	▲ 1564	132
Particles >14µm		ASTM D7647	>80	**49**	70	5
Particles >21µm		ASTM D7647	>20	**6**	18	1
Particles >38µm		ASTM D7647	>4	**0**	1	0
Particles >71µm		ASTM D7647	>3	**0**	0	0
Oil Cleanliness		ISO 4406 (c)	>18/16/13	▲ **20/18/13**	▲ 21/18/13	18/14/10

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		**0.47**	0.39	0.29

OIL ANALYSIS REPORT

Particle Trend

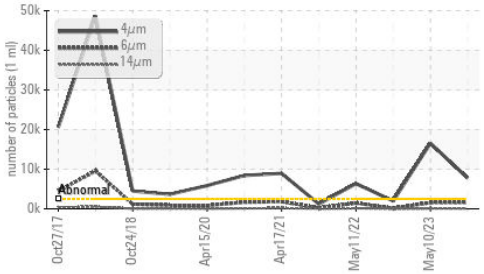

Viscosity @ 100°C

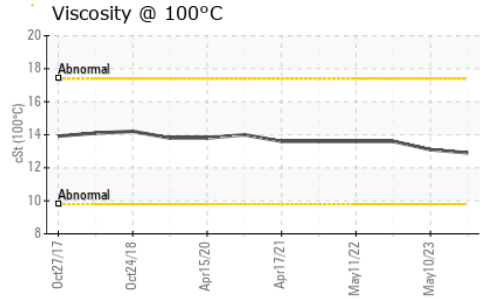

Ferrous Alloys

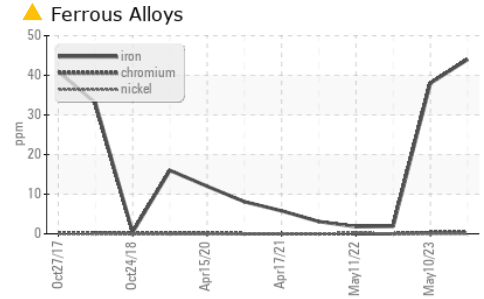

Acid Number

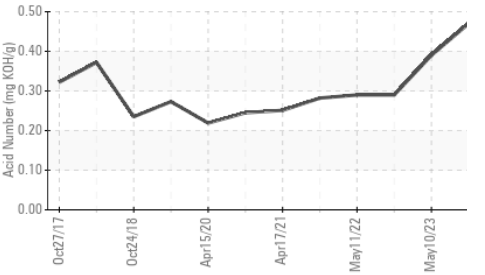

Viscosity @ 100°C

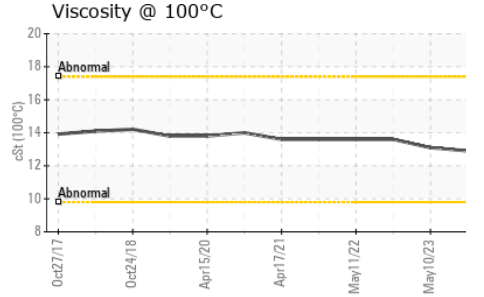

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	LIGHT	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	**NONE**	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual		**NEG**	NEG	NEG
Free Water	scalar	*Visual		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445		**97.5**	103	102
Visc @ 100°C	cSt	ASTM D445		**12.9**	13.1	13.6
Viscosity Index (VI)	Scale	ASTM D2270		**128**	123	133

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

Ferrous Alloys

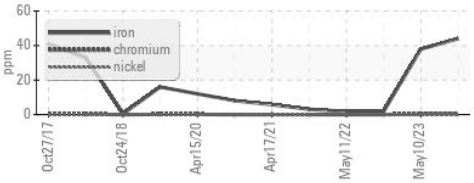

Non-ferrous Metals

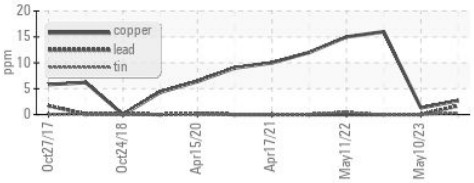

Viscosity @ 40°C

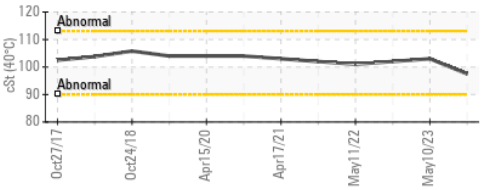

Particle Count

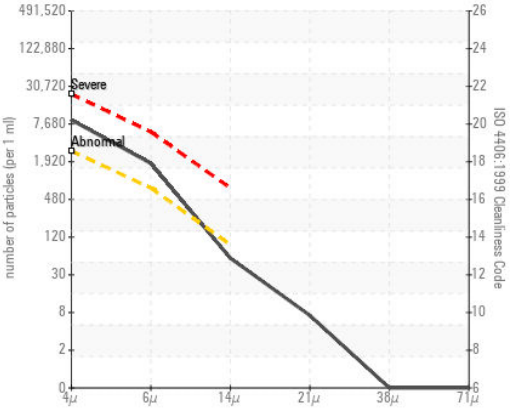

Acid Number

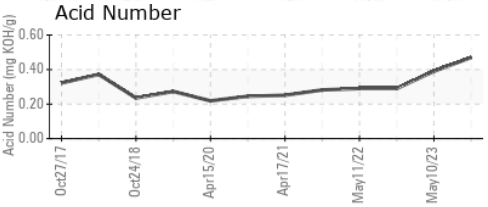

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0932111
Lab Number : 06203358
Unique Number : 11070819
Test Package : PLANT (Additional Tests: KV100, VI)

Received : 07 Jun 2024
Tested : 11 Jun 2024
Diagnosed : 11 Jun 2024 - Angela Borella

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

J/POWER-BD
,
JP
Contact: KENTO OKUHARA
Mitsuo_Miyahara@jpower.co.jp
T:
F: x: