







# OIL ANALYSIS REPORT

## Particle Trend

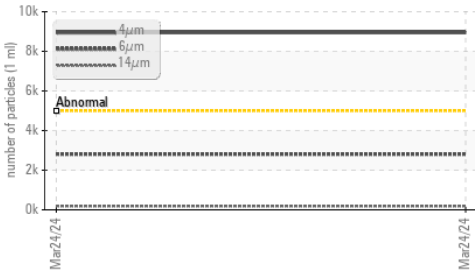


## Water (KF)

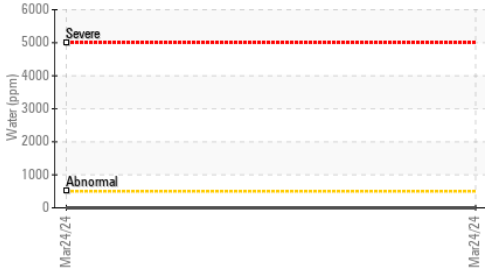


## Particle Trend



## Acid Number

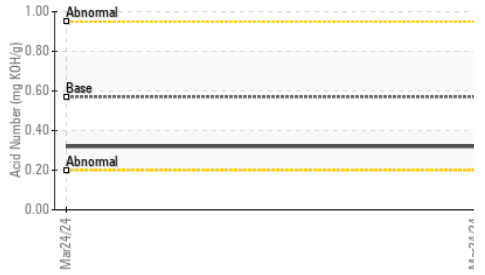

## Water (KF)

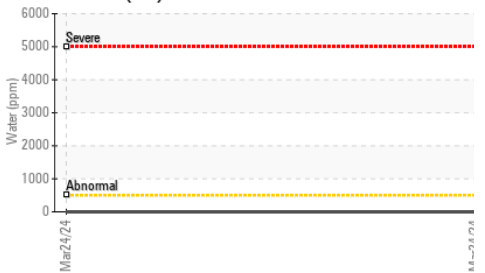


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	---
Emulsified Water	scalar	*Visual	>0.05	<b>NEG</b>	---
Free Water	scalar	*Visual		<b>NEG</b>	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	▲ 55.5	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

## GRAPHS

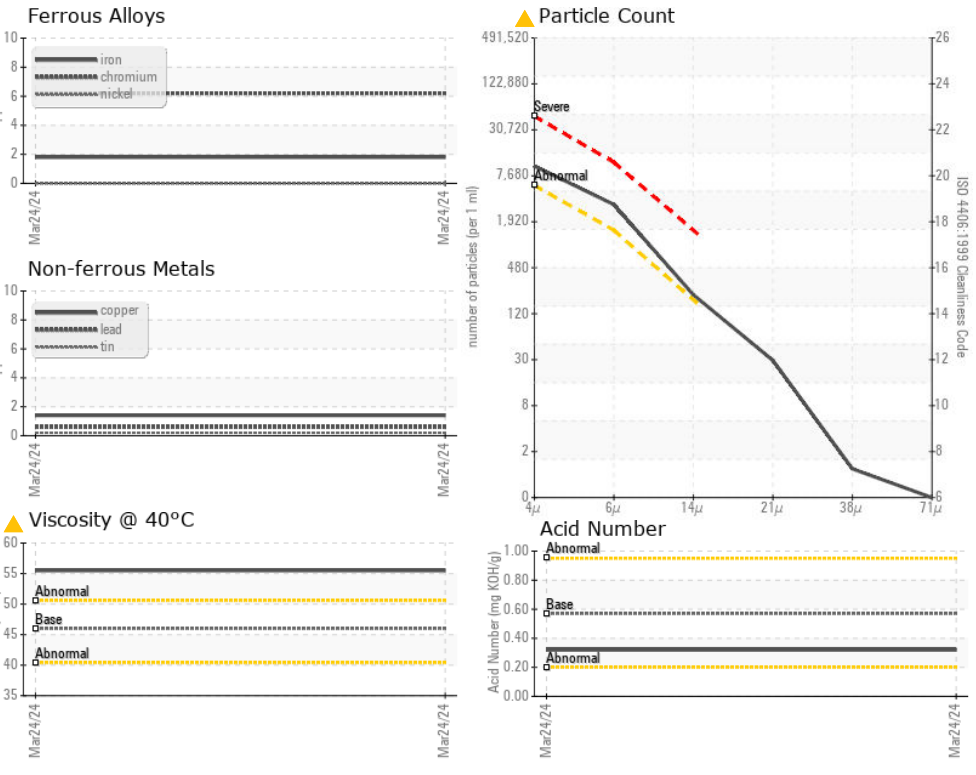

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0871234  
**Lab Number** : 06203383  
**Unique Number** : 11070844  
**Test Package** : IND 2 ( Additional Tests: KF )

**Received** : 07 Jun 2024  
**Tested** : 10 Jun 2024  
**Diagnosed** : 11 Jun 2024 - Angela Borella

**GRIFOLS TALECRIS PHARMACEUTICAL**  
 8368 US 70 WEST  
 CLAYTON, NC  
 US 27520  
 Contact: KEN TERRY  
 kenneth.terry@grifols.com  
 T: (919)359-4362  
 F: (919)359-4767

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)