


OIL ANALYSIS REPORT

Sample Rating Trend







Machine Id

KAESER 7698373

Component Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Aug2023	May2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA017842	KCPA005200	
Sample Date		Client Info		30 May 2024	23 Aug 2023	
Machine Age	hrs	Client Info		10711	7061	
Oil Age	hrs	Client Info		0	0	
Oil Changed	0	Client Info		Changed	N/A	
Sample Status		Chorte triio		NORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
						motoryz
Iron Chromium	ppm	ASTM D5185m	>50 >10	<1 <1	0	
	ppm			0		
Nickel	ppm	ASTM D5185m	>3	-	0	
Titanium	ppm	ASTM D5185m		<1	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	2	0	
Lead	ppm	ASTM D5185m	>10	0	<1	
Copper	ppm	ASTM D5185m		1	2	
Tin	ppm	ASTM D5185m	>10	<1	<1	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	53	37	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m	100	71	64	
Calcium	ppm	ASTM D5185m	0	0	2	
Phosphorus	ppm	ASTM D5185m	0	6	2	
Zinc	ppm	ASTM D5185m	0	5	5	
Sulfur	ppm	ASTM D5185m	23500	20957	21166	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	
Sodium	ppm	ASTM D5185m		20	16	
Potassium	ppm	ASTM D5185m	>20	6	9	
Water	%	ASTM D6304	>0.05	0.023	0.025	
ppm Water	ppm	ASTM D6304	>500	230	257.0	
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		3198		
Particles >6µm		ASTM D7647	>1300	1111		
Particles >14µm		ASTM D7647	>80	68		
Particles >21µm		ASTM D7647	>20	16		
Particles >38µm		ASTM D7647	>4	1		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/17/13		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.37	0.38	



OIL ANALYSIS REPORT

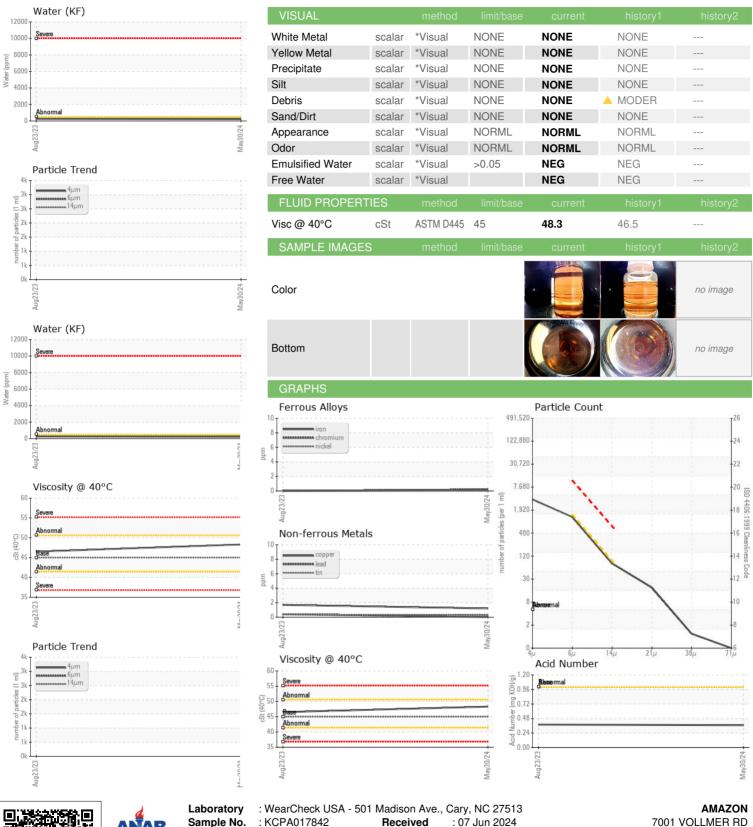



Sample No.

Lab Number : 06203388

: KCPA017842

Received **Tested** Unique Number : 11070849 Diagnosed

: 07 Jun 2024 : 11 Jun 2024

: 11 Jun 2024 - Angela Borella

US 60443 Contact: Service Manager

Test Package : IND 2 (Additional Tests: KF, PrtCount) Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: AMAMAT [WUSCAR] 06203388 (Generated: 06/11/2024 18:49:00) Rev: 1

Contact/Location: Service Manager - AMAMAT

T:

F:

MATTESON, IL