




# OIL ANALYSIS REPORT

Sample Rating Trend

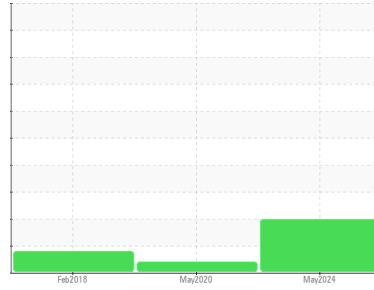

Machine Id  
**KAESER AS 25T 5979001 (S/N 1415)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) FG-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KCPA017392</b>	KCP25665	KCP08589
Sample Date	Client Info		<b>28 May 2024</b>	22 May 2020	02 Feb 2018
Machine Age	hrs	Client Info	<b>16092</b>	4429	3267
Oil Age	hrs	Client Info	<b>0</b>	684	3000
Oil Changed	Client Info		<b>Changed</b>	Changed	Changed
Sample Status			<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<1	16	4
Chromium	ppm	ASTM D5185m >10	<1	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	<1	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	2	5	5
Lead	ppm	ASTM D5185m >10	0	<1	<1
Copper	ppm	ASTM D5185m >50	3	2	3
Tin	ppm	ASTM D5185m >10	<1	0	0
Antimony	ppm	ASTM D5185m	---	0	<1
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<1	0
Barium	ppm	ASTM D5185m	0	<1	<1
Molybdenum	ppm	ASTM D5185m	0	0	<1
Manganese	ppm	ASTM D5185m	0	<1	<1
Magnesium	ppm	ASTM D5185m	<1	1	2
Calcium	ppm	ASTM D5185m	0	<1	<1
Phosphorus	ppm	ASTM D5185m 500	22	320	266
Zinc	ppm	ASTM D5185m	11	276	248
Sulfur	ppm	ASTM D5185m	991	1138	2835

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	<1	<1
Sodium	ppm	ASTM D5185m	0	0	4
Potassium	ppm	ASTM D5185m >20	1	<1	0
Water	%	ASTM D6304 >0.05	<b>0.039</b>	0.003	0.002
ppm Water	ppm	ASTM D6304 >500	<b>397</b>	36.4	20






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>29427</b>	---	50873
Particles >6µm	ASTM D7647	>1300	▲ <b>13866</b>	---	▲ 7193
Particles >14µm	ASTM D7647	>80	▲ <b>1352</b>	---	● 103
Particles >21µm	ASTM D7647	>20	▲ <b>256</b>	---	17
Particles >38µm	ASTM D7647	>4	▲ <b>13</b>	---	2
Particles >71µm	ASTM D7647	>3	<b>0</b>	---	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ <b>22/21/18</b>	---	▲ 20/14

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.5	<b>0.34</b>	1.024	0.663


# OIL ANALYSIS REPORT

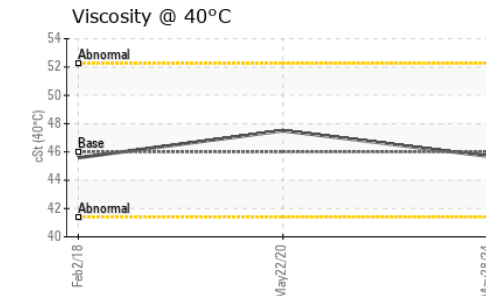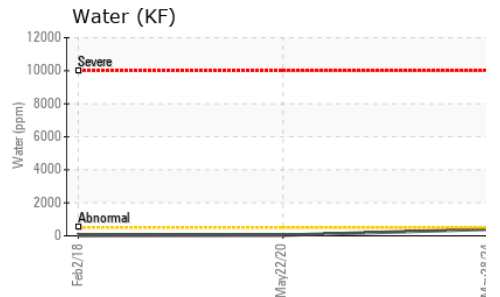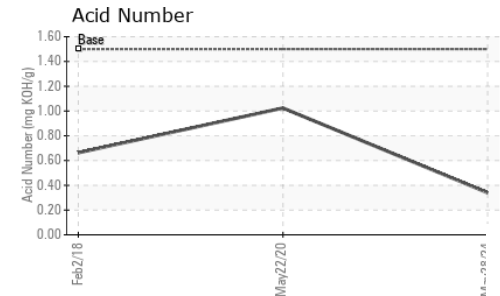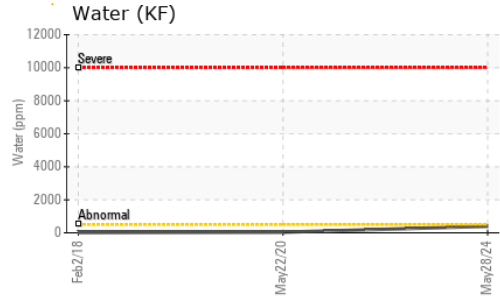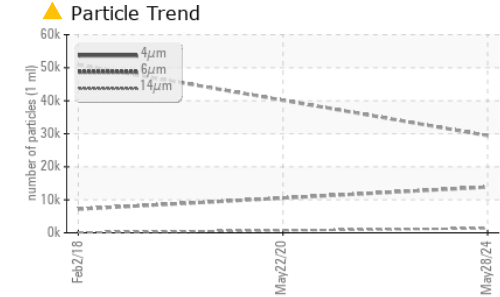






PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	45.7	47.5	45.59

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

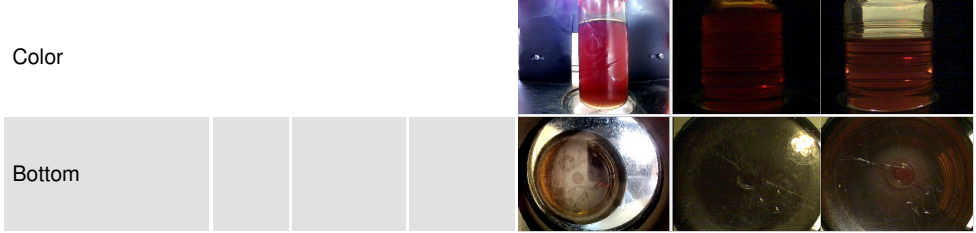

## GRAPHS

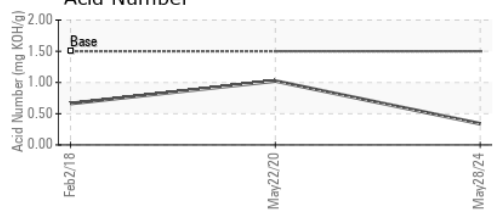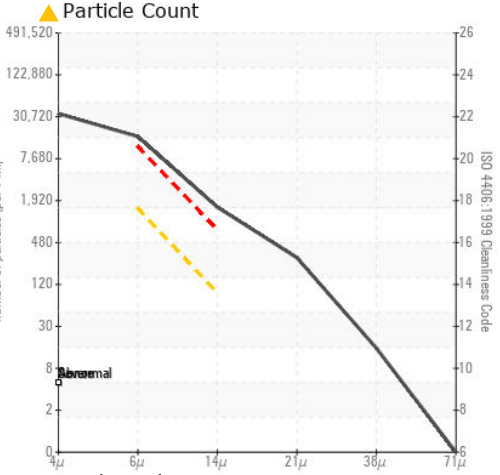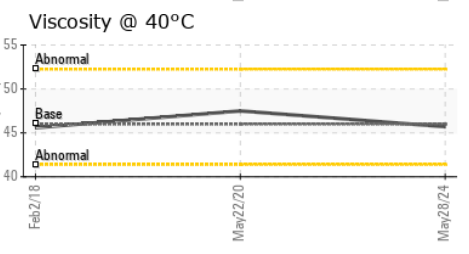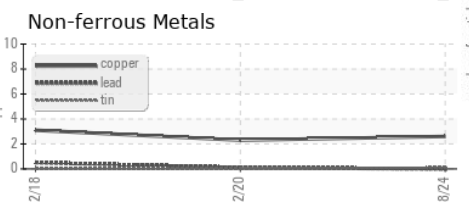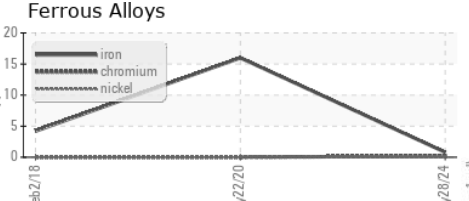

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA017392 **Received** : 07 Jun 2024  
**Lab Number** : 06203395 **Tested** : 11 Jun 2024  
**Unique Number** : 11070856 **Diagnosed** : 11 Jun 2024 - Angela Borella  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**REAL ALE BREWING COMPANY**  
 231 SAN SABA CT  
 BLANCO, TX  
 US 78606  
 Contact: GARRY  
 garry@realalebrewing.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)