




OIL ANALYSIS REPORT

Sample Rating Trend

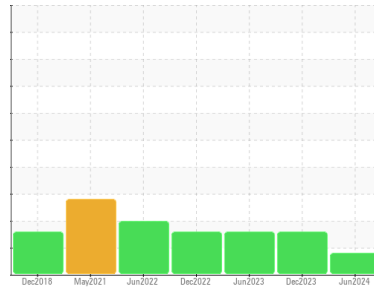

ISO



Machine Id
KAESER SK 20 4453016 (S/N 1120)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation
 The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear
 All component wear rates are normal.

Contamination
 There is a moderate amount of particulates present in the oil.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA018105	KCPA011486	KCPA002001
Sample Date	Client Info			04 Jun 2024	20 Dec 2023	19 Jun 2023
Machine Age	hrs	Client Info		19791	19168	18320
Oil Age	hrs	Client Info		600	0	0
Oil Changed	Client Info			Not Chngd	N/A	N/A
Sample Status				ATTENTION	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	0	0
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	2	0	2
Lead	ppm	ASTM D5185m	>10	<1	0	0
Copper	ppm	ASTM D5185m	>50	1	1	1
Tin	ppm	ASTM D5185m	>10	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	30	0	29
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	90	76	58	64
Calcium	ppm	ASTM D5185m	2	0	0	0
Phosphorus	ppm	ASTM D5185m		7	0	0
Zinc	ppm	ASTM D5185m		2	0	4
Sulfur	ppm	ASTM D5185m		20219	17557	19232

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	0
Sodium	ppm	ASTM D5185m		11	17	13
Potassium	ppm	ASTM D5185m	>20	2	2	2
Water	%	ASTM D6304	>0.05	0.018	0.019	0.025
ppm Water	ppm	ASTM D6304	>500	188	195	256.1

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		6180	22858	55521
Particles >6µm		ASTM D7647	>1300	1435	4147	18016
Particles >14µm		ASTM D7647	>80	32	191	619
Particles >21µm		ASTM D7647	>20	4	42	102
Particles >38µm		ASTM D7647	>4	0	1	2
Particles >71µm		ASTM D7647	>3	0	0	1
Oil Cleanliness		ISO 4406 (c)	>--/17/13	20/18/12	22/19/15	23/21/16

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.31	0.29	0.36

OIL ANALYSIS REPORT

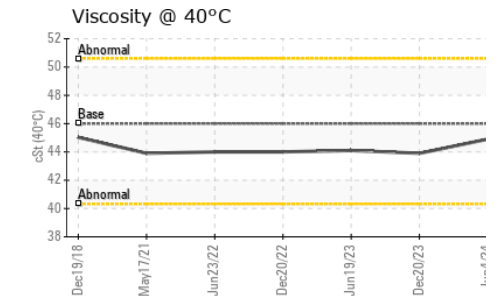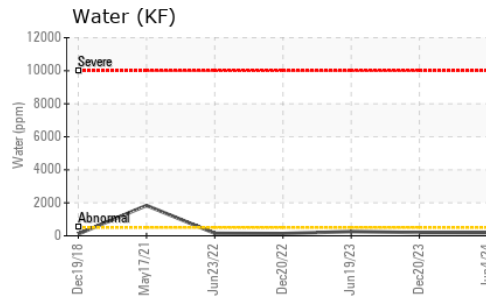
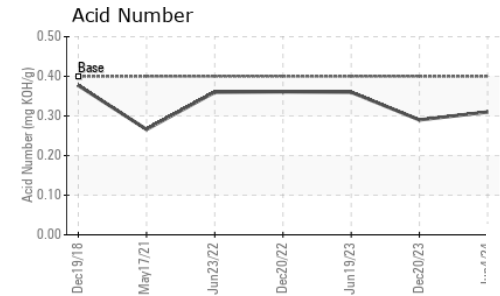
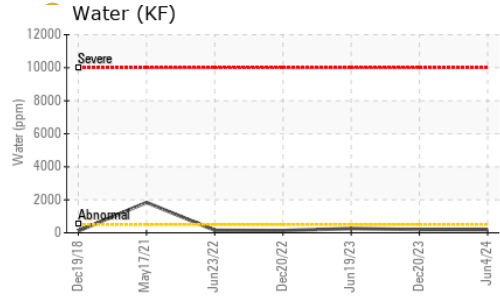
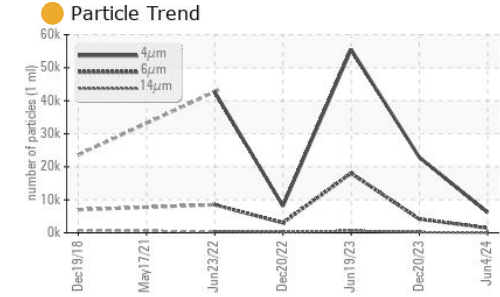


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.9	43.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

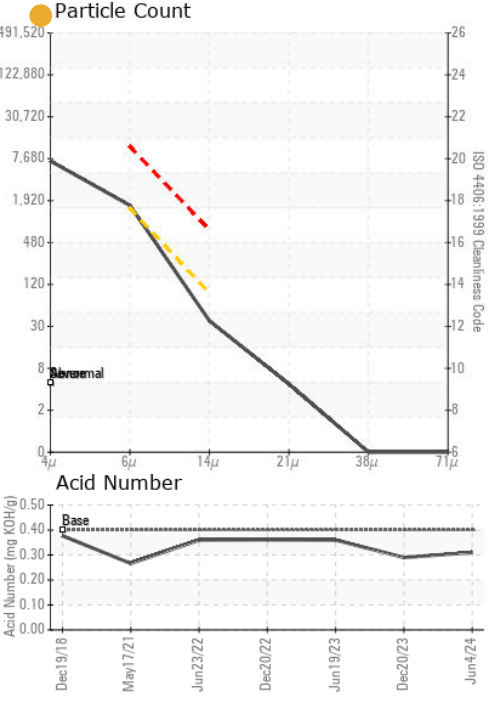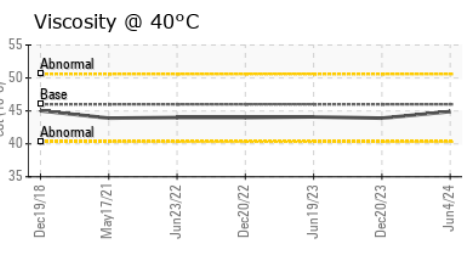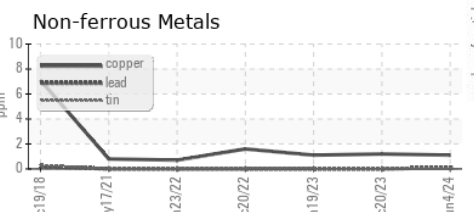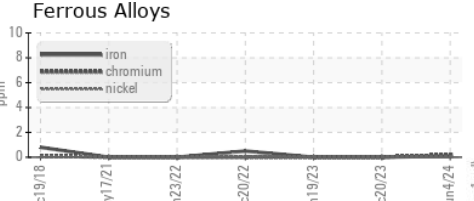

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA018105 **Received** : 07 Jun 2024
Lab Number : 06203411 **Tested** : 11 Jun 2024
Unique Number : 11070872 **Diagnosed** : 11 Jun 2024 - Angela Borella
Test Package : IND 2 (Additional Tests: KF, PrtCount)

POMPS TIRE
 2315 S CALHOUN RD
 NEW BERLIN, WI
 US 53151
 Contact: EMANUEL BARRAZA
 emanuel.barraza@pompstire.com
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)