

## **OIL ANALYSIS REPORT**

# Area S&S FOODS LC-1 - SS FOODS (S/N S0392SFMPTHAA02)

**Refrigeration Compressor** 

Fluid FRICK COMPRESSOR OIL #11 (200 GAL)

#### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

## Wear


All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

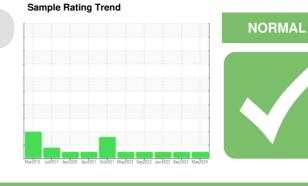

SAMPLE INFORM	<b>IATION</b>	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0012487	USP250286	USP250809
Sample Date		Client Info		24 May 2024	06 Sep 2023	08 Jun 2023
Machine Age	hrs	Client Info		7260	2308	226
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	0	0	0
Chromium	ppm	ASTM D5185m	>2	<1	<1	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		<1	<1	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>3	0	<1	0
Lead	ppm	ASTM D5185m	>2	0	0	0
Copper	ppm	ASTM D5185m	>8	<1	0	0
Tin	ppm	ASTM D5185m	>4	0	<1	0
Vanadium	ppm	ASTM D5185m		0	<1	0
Cadmium	ppm	ASTM D5185m		0	<1	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m		<1	<1	0
Calcium	ppm	ASTM D5185m		0	0	0
Phosphorus	ppm	ASTM D5185m		0	0	1
Zinc	ppm	ASTM D5185m		0	0	0
Sulfur	ppm	ASTM D5185m		0	0	0
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	1	1	0
Sodium	ppm	ASTM D5185m		0	1	0
Potassium	ppm	ASTM D5185m	>20	1	3	0
Water	%	ASTM D6304	>0.01	3	0.004	0.001
ppm Water	ppm	ASTM D6304	>100	0	40.5	11.9
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	9723	4696	7276
Particles >6µm		ASTM D7647	>2500	2313	990	2153
Particles >14µm		ASTM D7647	>320	51	55	175
Particles >21µm		ASTM D7647	>80	5	12	46
Particles >38µm		ASTM D7647	>20	0	1	1
Particles >71µm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	20/18/13	19/17/13	20/18/15
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974		0.014	0.015	0.015



# **OIL ANALYSIS REPORT**

scalar

scalar

scalar

scalar

scalar

scalar

scalar

scalar

cSt

White Metal

Yellow Metal

Precipitate

Silt

Debris

Odor

Color

Bottom

GRAPHS Ferrous Alloys

Sand/Dirt

Appearance

Free Water

Visc @ 40°C

**Emulsified Water** 

FLUID PROPERTIES

SAMPLE IMAGES

\*Visual

\*Visual

\*Visua

\*Visual

\*Visual

\*Visual

\*Visual

\*Visual

ASTM D445

scalar \*Visual

scalar \*Visual

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML


>0.01


44.0


Mav24/24 en6/73


lay24/24


May24/24 -Sep 6/23





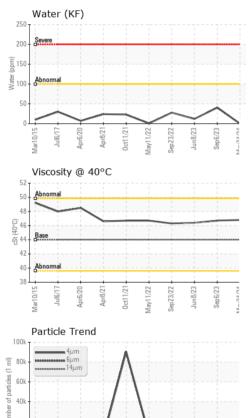

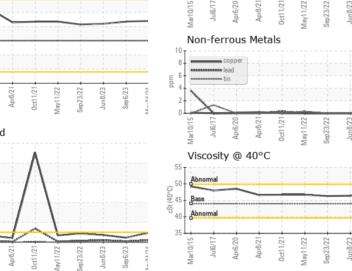



NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML

NEG

NEG

46.7

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML

NEG

NEG

46.4

NONE

NONE

NONE

NONE

NONE

NONE


NORML

NORML

NEG

NEG

46.8



Laboratory Sample No. Lab Number Unique Number : 11070880 Test Package : IND 2 Certificate 12367

108/23

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 07 Jun 2024 Tested : 11 Jun 2024 Diagnosed : 11 Jun 2024 - Doug Bogart

**RACE ENGINEERING CORP** 12871 WESTERN AVE, SUITE E GARDEN GROVE, CA US 92841 Contact: TODD CARTER tcrace@verizon.net T: (714)895-3488 F: (714)895-5125

To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

: USP0012487

: 06203419

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: RACGAR [WUSCAR] 06203419 (Generated: 06/11/2024 20:30:09) Rev: 1

Contact/Location: TODD CARTER - RACGAR

Page 2 of 2