


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id 8 CO 16725 Component Gearbox

GEAR OIL ISO 460 (--- GAL)

DI.	

Recommendation

Resample at the next service interval to monitor. Please specify the component make and model with your next sample.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC06203474		
Sample Date		Client Info		28 May 2024		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
CONTAMINATION	V	method	limit/base	current	history1	history2
Water		WC Method	>0.2	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>200	2		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>10	0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	0		
Lead	ppm	ASTM D5185m	>50	0		
Copper	ppm	ASTM D5185m	>200	<1		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	50	5		
Barium	ppm	ASTM D5185m	15	0		
Molybdenum	ppm	ASTM D5185m	15	0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	50	<1		
Calcium	ppm	ASTM D5185m	50	<1		
Phosphorus	ppm	ASTM D5185m	350	204		
Zinc	ppm	ASTM D5185m	100	53		
Sulfur	ppm	ASTM D5185m	12500	8613		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	1		
Sodium	ppm	ASTM D5185m		<1		
Potassium	ppm	ASTM D5185m	>20	0		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.85	0.96		



OIL ANALYSIS REPORT

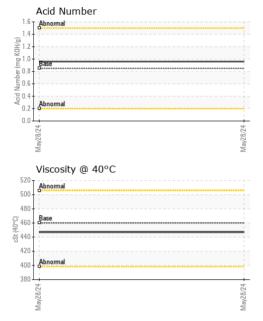

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE		
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulsified Water	scalar	*Visual	>0.2	NEG		
Free Water	scalar	*Visual		NEG		
FLUID PROPERT	TIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	460	447		
SAMPLE IMAGES	3	method	limit/base	current	history1	history2
Color				no image	no image	no image
Bottom				no image	no image	no image
GRAPHS						
Iron (ppm)				Lead (ppm)		
Severe			20	Severe		
Abnormal			톮10	Abnormal		
0				0		-
May28/24			May28/24	May28/24		May28/24
Aluminum (ppm)			2	Chromium (p	pm)	2
Severe			3	Severe		
Abnormal			<u></u> € 2	1		
May28/24 —			May28/24	May28/24		May28/24
≥ Copper (ppm)			≥	≥ Silicon (ppm)		Σ
copper (ppin)						
400 Severe Abnormal			E 10	Abnormal		
Abnormal			5	0+4		
May28/24			May28/24	May28/24		May28/24
10			≥	_		Σ
			(B)/	Acid Number		
Viscosity @ 40°C			B. KOH/g)	Acid Number		1
Viscosity @ 40°C			ber (mg KOH/g)	Acid Number		
Viscosity @ 40°C			I Number (mg KOH/g)	Acid Number Abnomal Base Abnomal		
Viscosity @ 40°C			May28/24 Acid Number (mg KOH/g)	Acid Number Abnormal Abnormal Abnormal		Ma/28/24





Certificate 12367

Sample No. Lab Number : 06203474 Unique Number : 11070935

: WearCheck USA - 501 Madison Ave., Cary, NC 27513

: WC06203474 Test Package : MOB 2

Received : 07 Jun 2024 Tested : 11 Jun 2024 Diagnosed

: 12 Jun 2024 - Angela Borella

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

US 30325 Contact: JOHN STEED john.steed@momar.com T: (404)355-4580

MOMAR Incorporated

P.O. Box 19567

Atlanta, GA

F: (678)894-4204 Contact/Location: JOHN STEED - MOMATL