




OIL ANALYSIS REPORT

Sample Rating Trend

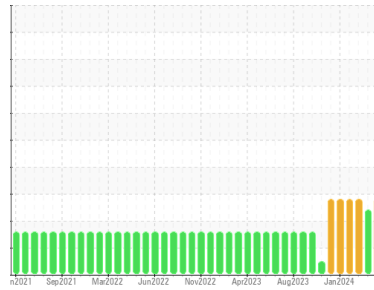

WATER



Area

MELT SHOP - HYDRAULIC

Machine Id

MELT SHOP GRINDER LUBE TANK (S/N 15-4000-0770)

Component

Tank Bulk Fluid Tank

Fluid

FIRE-RESISTANT FLUID ISO 68 (275 QTS)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil. There is a light concentration of water present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		RP0044085	RP0039059	RP0042720
Sample Date	Client Info		06 Jun 2024	09 May 2024	28 Mar 2024
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	10	20	16
Chromium	ppm	ASTM D5185m	0	0	<1
Nickel	ppm	ASTM D5185m	<1	0	<1
Titanium	ppm	ASTM D5185m	0	<1	<1
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m	<1	0	2
Lead	ppm	ASTM D5185m	<1	0	<1
Copper	ppm	ASTM D5185m	0	0	<1
Tin	ppm	ASTM D5185m	<1	<1	<1
Vanadium	ppm	ASTM D5185m	0	0	<1
Cadmium	ppm	ASTM D5185m	0	0	<1

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	5	6	0	4
Barium	ppm	ASTM D5185m	5	0	0	0
Molybdenum	ppm	ASTM D5185m	5	0	0	4
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m	5	2	0	13
Calcium	ppm	ASTM D5185m	50	0	1	31
Phosphorus	ppm	ASTM D5185m	175	579	608	508
Zinc	ppm	ASTM D5185m	62	0	5	14

CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m		<1	<1	2
Sodium	ppm	ASTM D5185m		0	0	2
Potassium	ppm	ASTM D5185m	>20	2	<1	2
Water	%	ASTM D6304	>55	▲ 0.134	▲ 0.131	▲ 0.138
ppm Water	ppm	ASTM D6304	>55000	▲ 1347	▲ 1317	▲ 1382






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	▲ 73762	▲ 97798	▲ 116527
Particles >6µm	ASTM D7647	>5000	● 8745	4730	▲ 8838
Particles >14µm	ASTM D7647	>640	18	11	85
Particles >21µm	ASTM D7647	>160	3	3	24
Particles >38µm	ASTM D7647	>40	0	0	1
Particles >71µm	ASTM D7647	>10	0	0	0
Oil Cleanliness	ISO 4406 (c)	>21/19/16	▲ 23/20/11	▲ 24/19/11	▲ 24/20/14

FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045	3.63	0.60	0.62	0.61


OIL ANALYSIS REPORT

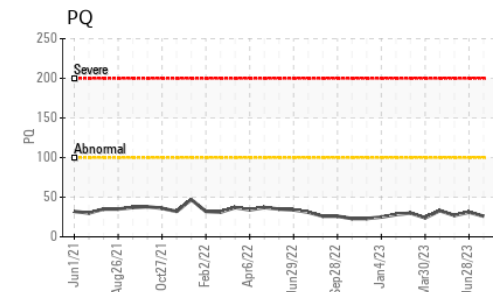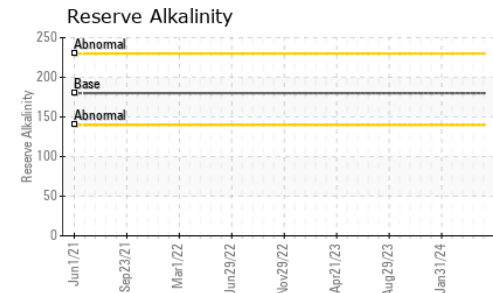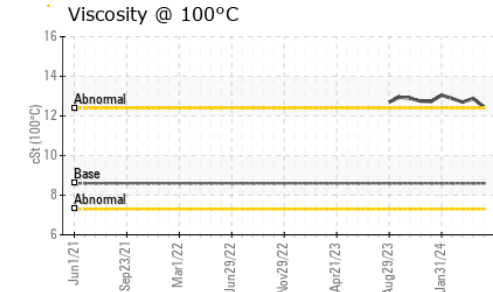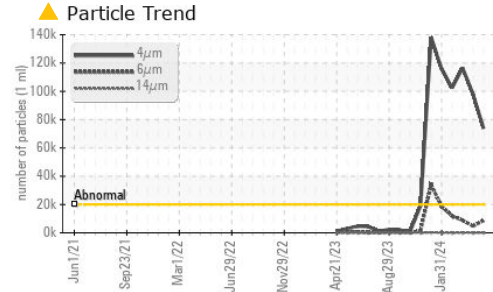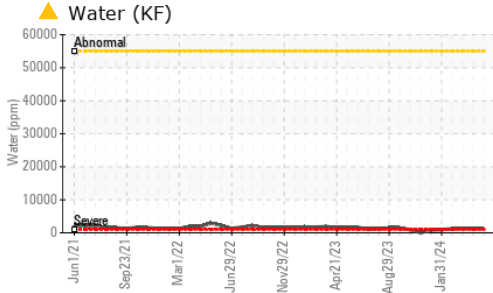






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>55	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	68	71.27	71.82
Visc @ 100°C	cSt	ASTM D445	8.6	12.47	12.88
Viscosity Index (VI)	Scale	ASTM D2270	96	175	181

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

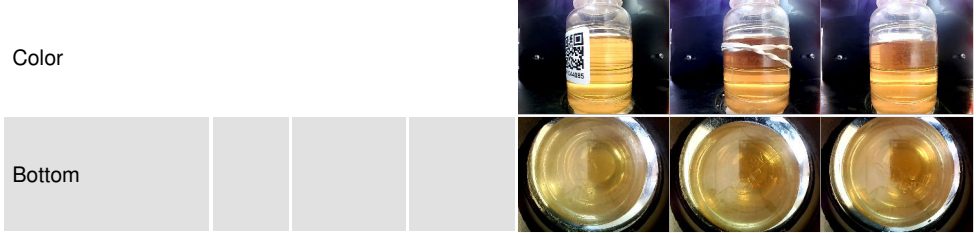

GRAPHS

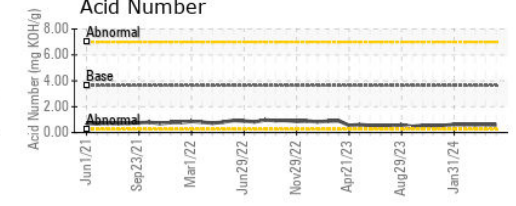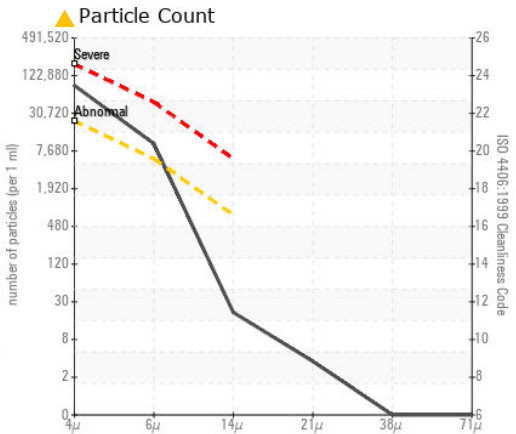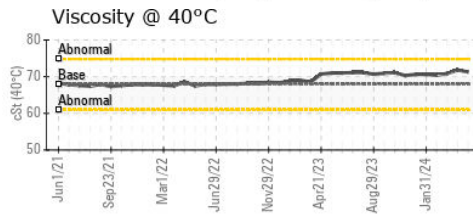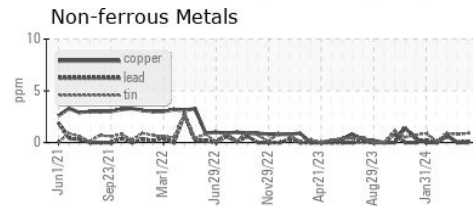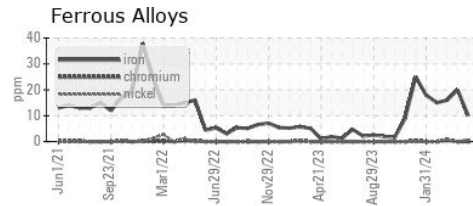

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : RP0044085
Lab Number : 06204016
Unique Number : 11071477
Test Package : IND 2 (Additional Tests: KV100, pH, PQ, PrtCount, ReserveAlk, VI)

OUTOKUMPU STAINLESS USA
 HWY 43 N
 CALVERT, AL
 US 36513
 Contact: MARIO JOHNSON
 Mario.johnson@outokumpu.com
 T: (251)321-4105
 F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)