


FUEL REPORT

QTS SUWANEE DC1 [17724] [QTS SUWANEE DC1] GEN DAY 5

Diesel Fuel

No.2 DIESEL FUEL (ULTRALOW SULPHUF





DIAGNOSIS

Recommendation

All laboratory tests indicate that this sample meets ASTM D975 specifications for No.2 ultra-low-sulfur diesel fuel.

Corrosion

All metal levels are normal indicating no corrosion in the system.

Contaminants

There is no bacteria or fungus (yeast and/or mold) indicated in the sample. The water content is negligible. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the fuel.


Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.

R) (150 GAL)				May2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0953834		
Sample Date		Client Info		20 May 2024		
Machine Age	hrs	Client Info		0		
Sample Status				NORMAL		
PHYSICAL PROP	ERTIES	method	limit/base	current	history1	history2
Fuel Color	text	*Visual Screen	Yllow	Red		
ASTM Color	scalar	*ASTM D1500		L4.5		
Visc @ 40°C	cSt	ASTM D445	3.0	2.56		
Pensky-Martens Flash Point	°C	*PMCC Calculated	52	66		
SULFUR CONTE	VT	method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m	10	0		
Sulfur (UVF)	ppm	ASTM D5453		10		
DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D86	165	177		
5% Distillation Point	°C	ASTM D86		198		
10% Distill Point	°C	ASTM D86	201	207		
15% Distillation Point	°C	ASTM D86		215		
20% Distill Point	°C	ASTM D86	216	223		
30% Distill Point	°C	ASTM D86	230	237		
40% Distill Point	°C	ASTM D86	243	250		
50% Distill Point	°C	ASTM D86	255	263		
60% Distill Point	°C	ASTM D86	267	276		
70% Distill Point	°C	ASTM D86	280	290		
80% Distill Point	°C	ASTM D86	295	305		
85% Distillation Point	°C	ASTM D86		315		
90% Distill Point	°C	ASTM D86	310	326		
95% Distillation Point	°C	ASTM D86		344		
Final Boiling Point	°C	ASTM D86	341	360		
IGNITION QUALIT	ΓΥ	method	limit/base	current	history1	history2
API Gravity		ASTM D7777	37.7	36		
Cetane Index		ASTM D4737	<40.0	48		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	<1		
Sodium	ppm	ASTM D5185m	<0.1	2		
Potassium	ppm	ASTM D5185m	< 0.1	2		
Water	%	ASTM D6304	< 0.05	0.003		
ppm Water	ppm	ASTM D6304	< 500	39		
% Gasoline	%	*In-House	< 0.50	0.0		
% Biodiesel	%	*In-House	<20.0	0.0		



FUEL REPORT

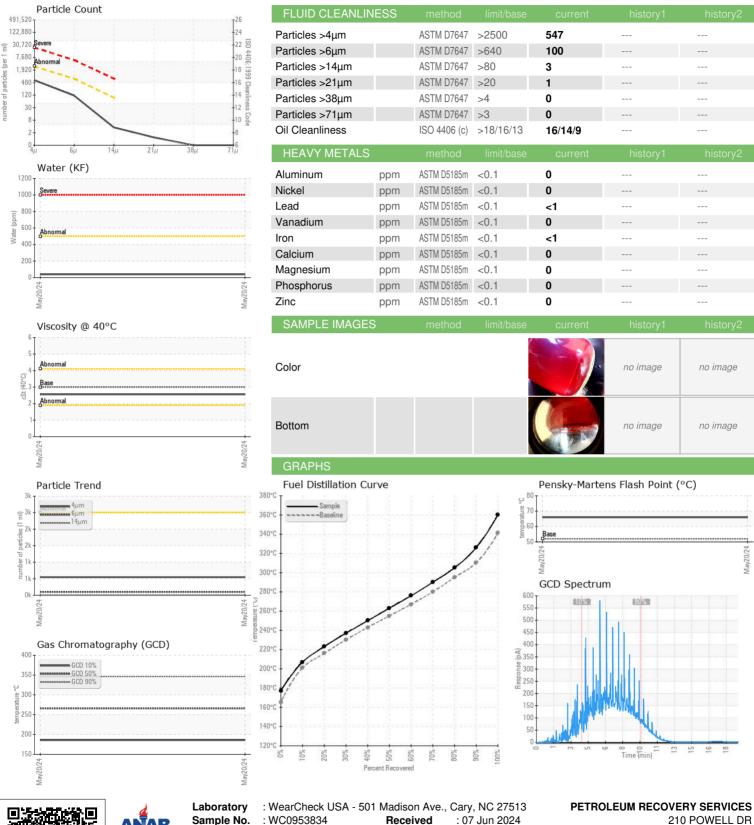





Certificate 12367

Report Id: PETSUM [WUSCAR] 06204055 (Generated: 06/15/2024 09:48:26) Rev: 1

Sample No. Lab Number : 06204055 Unique Number : 11071516

: WC0953834

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Received **Tested** Diagnosed Test Package : DF-2 (Additional Tests: Fuel, Screen)

: 14 Jun 2024

: 14 Jun 2024 - Elizabeth Valachovic

SUMMERVILLE, SC US 29483 Contact: AJAY EL Ajay@prsfuel.com T: (843)225-1777

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: AJAY EL - PETSUM