


FUEL REPORT

QTS ATLANTA GA DC1 [4647] [QTS ATLANTA GA DC1] GC7

Diesel Fuel

No.2 DIESEL FUEL (ULTRALOW SULPHUF





DIAGNOSIS

Recommendation

All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel.

Corrosion

All metal levels are normal indicating no corrosion in the system.

Contaminants

There is no bacteria or fungus (yeast and/or mold) indicated in the sample. The water content is negligible. There is no indication of any contamination in the fuel. The amount and size of particulates present in the system are acceptable.

Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.

) (0500 OAL)						
R) (3500 GAL)				May2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0953948		
Sample Date		Client Info		22 May 2024		
Machine Age	hrs	Client Info		0		
Sample Status				NORMAL		
PHYSICAL PROP	ERTIES	method	limit/base	current	history1	history2
Fuel Color	text	*Visual Screen	Yllow	Red		
ASTM Color	scalar	*ASTM D1500		L4.5		
Visc @ 40°C	cSt	ASTM D445	3.0	2.44		
Pensky-Martens Flash Point	°C	*PMCC Calculated	52	59.6		
SULFUR CONTE	VT	method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m	10	0		
Sulfur (UVF)	ppm	ASTM D5453		13		
DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D86	165	170		
5% Distillation Point	°C	ASTM D86		192		
10% Distill Point	°C	ASTM D86	201	202		
15% Distillation Point	°C	ASTM D86		210		
20% Distill Point	°C	ASTM D86	216	218		
30% Distill Point	°C	ASTM D86	230	233		
40% Distill Point	°C	ASTM D86	243	246		
50% Distill Point	°C	ASTM D86	255	260		
60% Distill Point	°C	ASTM D86	267	274		
70% Distill Point	°C	ASTM D86	280	288		
80% Distill Point	°C	ASTM D86	295	303		
85% Distillation Point	°C	ASTM D86		314		
90% Distill Point	°C	ASTM D86	310	325		
95% Distillation Point	°C	ASTM D86		344		
Final Boiling Point	°C	ASTM D86	341	359		
IGNITION QUALIT	ГΥ	method	limit/base	current	history1	history2
API Gravity		ASTM D7777	37.7	37		
Cetane Index		ASTM D4737	<40.0	48		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	<1		
Sodium	ppm	ASTM D5185m	<0.1	1		
Potassium	ppm	ASTM D5185m	<0.1	2		
Water	%	ASTM D6304	< 0.05	0.001		
ppm Water	ppm	ASTM D6304	< 500	6		
% Gasoline	%	*In-House	< 0.50	0.0		
0/ Dissilated	0/	¥1 1.1	00.0			


*In-House <20.0

0.0

% Biodiesel



FUEL REPORT

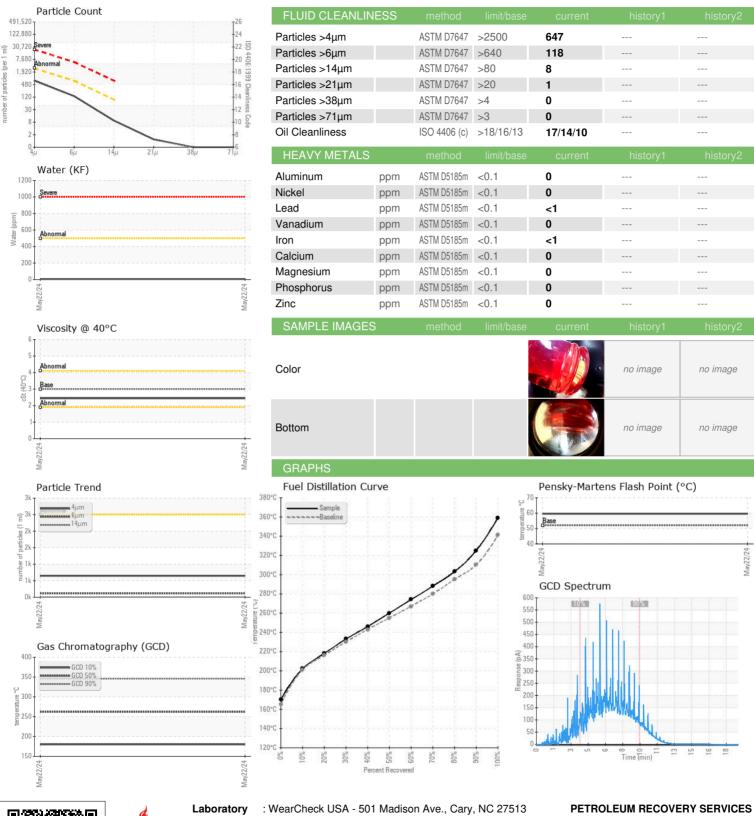





Certificate 12367

Sample No.

: WC0953948 Lab Number : 06204073

Unique Number : 11071534

Received Tested Diagnosed

Test Package : DF-2 (Additional Tests: Fuel, Screen) To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

210 POWELL DR SUMMERVILLE, SC US 29483

Contact: AJAY EL Ajay@prsfuel.com T: (843)225-1777

: 07 Jun 2024

: 14 Jun 2024

: 14 Jun 2024 - Elizabeth Valachovic

Contact/Location: AJAY EL - PETSUM