




OIL ANALYSIS REPORT

Sample Rating Trend

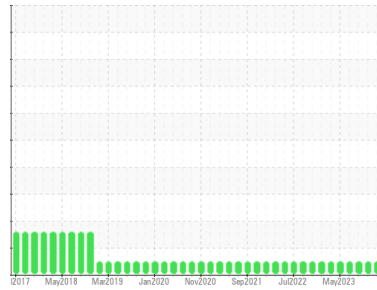

NORMAL



Machine Id
ROOTS-3
 Component
Compressor
 Fluid
MOBIL SHC 629 (20 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0850001	WC0849995	WC0849994
Sample Date	Client Info			06 Jun 2024	29 Jan 2024	05 Oct 2023
Machine Age	hrs	Client Info		65907	64720	61696
Oil Age	hrs	Client Info		65907	64720	61696
Oil Changed	Client Info			Not Changed	Not Changd	Not Changed
Sample Status				NORMAL	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.1	NEG	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	3	4	2
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m		0	<1	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	<1	0
Aluminum	ppm	ASTM D5185m	>25	0	<1	0
Lead	ppm	ASTM D5185m	>25	0	2	0
Copper	ppm	ASTM D5185m	>50	0	2	0
Tin	ppm	ASTM D5185m	>15	0	<1	<1
Vanadium	ppm	ASTM D5185m		0	<1	0
Cadmium	ppm	ASTM D5185m		0	<1	0





ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		<1	0	0
Molybdenum	ppm	ASTM D5185m		0	<1	0
Manganese	ppm	ASTM D5185m		<1	2	0
Magnesium	ppm	ASTM D5185m		<1	1	1
Calcium	ppm	ASTM D5185m		2	1	3
Phosphorus	ppm	ASTM D5185m		491	466	485
Zinc	ppm	ASTM D5185m		10	3	0
Sulfur	ppm	ASTM D5185m		38	38	13

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	13	12	14
Sodium	ppm	ASTM D5185m		2	2	0
Potassium	ppm	ASTM D5185m	>20	2	4	<1

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>20000	500	124	211
Particles >6µm		ASTM D7647	>2500	150	36	64
Particles >14µm		ASTM D7647	>320	11	4	12
Particles >21µm		ASTM D7647	>80	3	2	6
Particles >38µm		ASTM D7647	>20	1	1	2
Particles >71µm		ASTM D7647	>4	1	0	2
Oil Cleanliness		ISO 4406 (c)	>21/18/15	16/14/11	14/12/9	15/13/11

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.53	0.46	0.49


OIL ANALYSIS REPORT

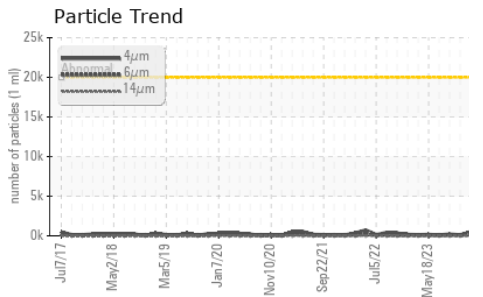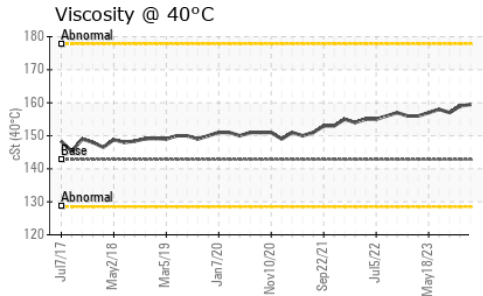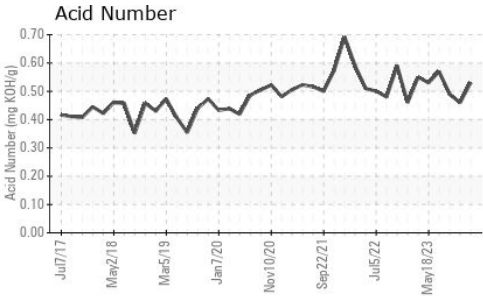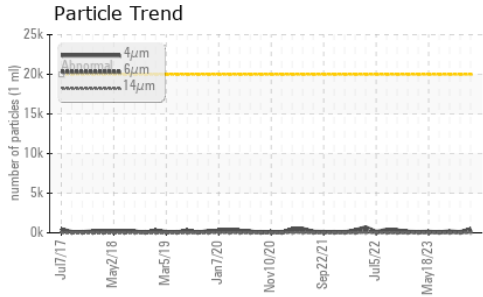






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	142.8	159.5	159

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

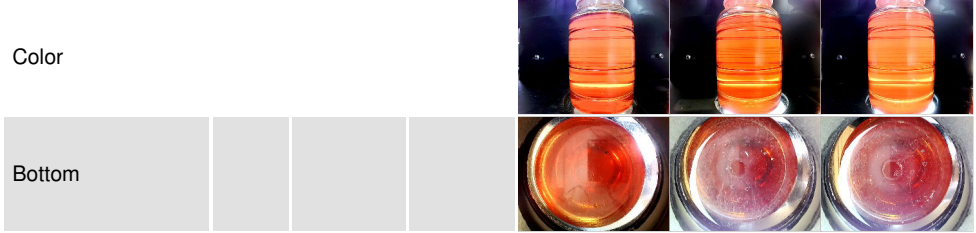

GRAPHS

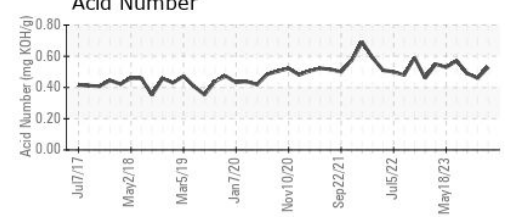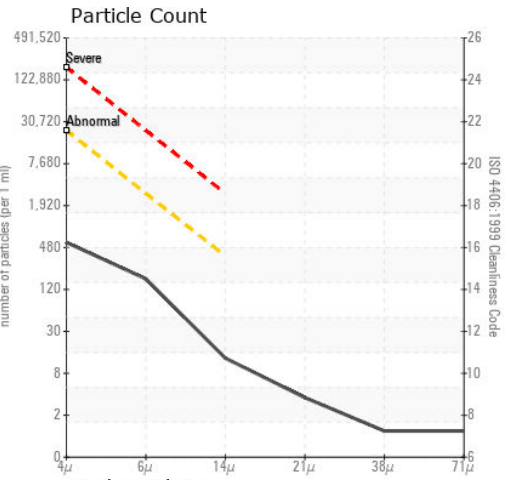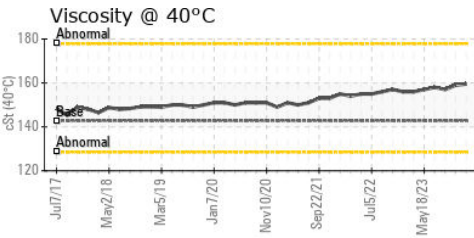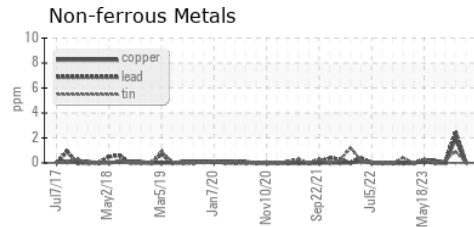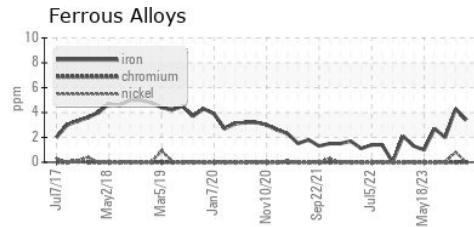

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0850001 **Received** : 10 Jun 2024
Lab Number : 06204556 **Tested** : 17 Jun 2024
Unique Number : 11072017 **Diagnosed** : 18 Jun 2024 - Jonathan Hester
Test Package : IND 2 (Additional Tests: PrtCount)

GREENE VALLEY LANDFILL
 9 SOUTH 610 GREENE ROAD
 NAPERVILLE, IL
 US 60565
 Contact: CHRIS ADEN
 caden@wm.com
 T: (630)743-4479
 F: (630)983-1535

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)