OIL ANALYSIS REPORT

Sample Rating Trend

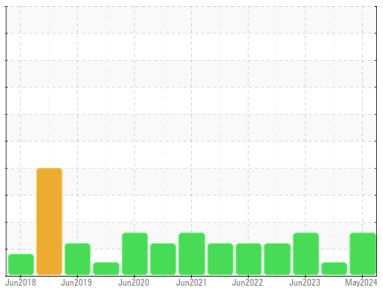

ISO

Area
SBR
Machine Id
MT 2 - AGITATOR
Component
Gearbox
Fluid
FUCHS FM GEAR OIL 220 (--- GAL)

DIAGNOSIS

Recommendation
We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
There is a high amount of particulates present in the oil.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**WC0915915**	WC0813298	WC0802663
Sample Date		Client Info		**31 May 2024**	04 Jan 2024	14 Jun 2023
Machine Age	hrs	Client Info		**0**	0	0
Oil Age	hrs	Client Info		**0**	0	0
Oil Changed		Client Info		**N/A**	N/A	N/A
Sample Status				**ABNORMAL**	NORMAL	ABNORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water		WC Method	>0.2	**NEG**	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>200	**43**	<1	43
Chromium	ppm	ASTM D5185m	>15	**0**	<1	<1
Nickel	ppm	ASTM D5185m	>15	**0**	0	0
Titanium	ppm	ASTM D5185m		**0**	0	0
Silver	ppm	ASTM D5185m		**0**	0	0
Aluminum	ppm	ASTM D5185m	>25	**<1**	1	0
Lead	ppm	ASTM D5185m	>100	**0**	0	0
Copper	ppm	ASTM D5185m	>200	**0**	<1	<1
Tin	ppm	ASTM D5185m	>25	**<1**	1	<1
Vanadium	ppm	ASTM D5185m		**0**	0	0
Cadmium	ppm	ASTM D5185m		**0**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		**0**	0	0
Barium	ppm	ASTM D5185m		**<1**	10	0
Molybdenum	ppm	ASTM D5185m		**0**	<1	0
Manganese	ppm	ASTM D5185m		**4**	0	3
Magnesium	ppm	ASTM D5185m		**<1**	<1	0
Calcium	ppm	ASTM D5185m		**11**	2	8
Phosphorus	ppm	ASTM D5185m		**805**	713	833
Zinc	ppm	ASTM D5185m		**41**	2	27
Sulfur	ppm	ASTM D5185m		**822**	1489	921

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	**1**	<1	<1
Sodium	ppm	ASTM D5185m		**2**	0	<1
Potassium	ppm	ASTM D5185m	>20	**3**	1	<1

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>20000	▲ **134307**	2071	▲ 156138
Particles >6µm		ASTM D7647	>5000	▲ **49487**	420	▲ 46013
Particles >14µm		ASTM D7647	>640	● **745**	25	▲ 838
Particles >21µm		ASTM D7647	>160	**86**	7	136
Particles >38µm		ASTM D7647	>40	**3**	0	2
Particles >71µm		ASTM D7647	>10	**2**	0	0
Oil Cleanliness		ISO 4406 (c)	>21/19/16	▲ **24/23/17**	18/16/12	▲ 24/23/17

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		**1.38**	1.48	0.37

OIL ANALYSIS REPORT

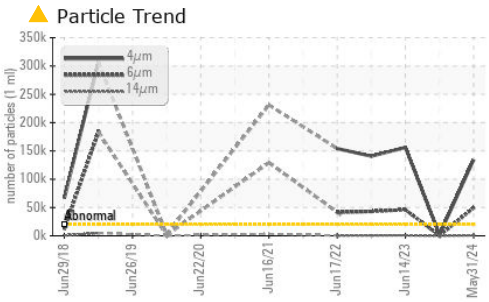

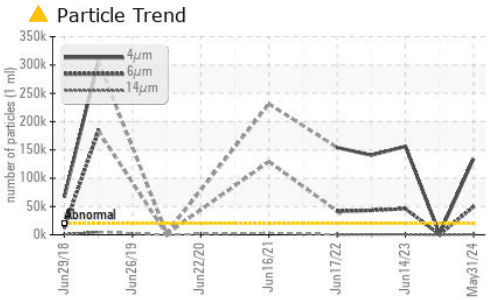

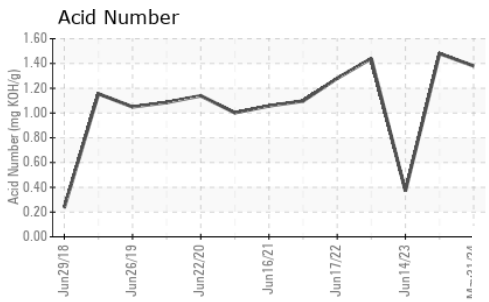

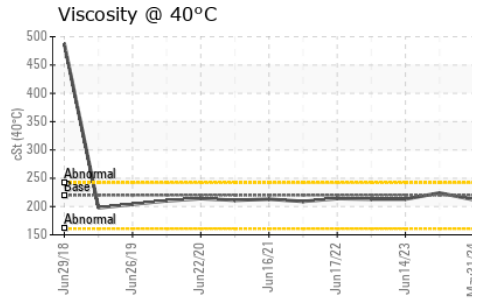

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	**NONE**	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	**NEG**	NEG	NEG
Free Water	scalar	*Visual		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	220	**212**	224	213

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

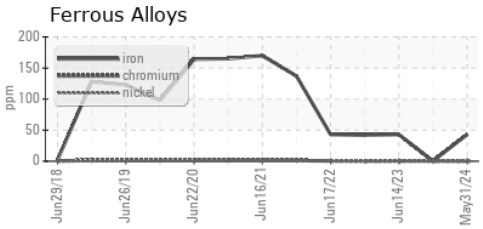

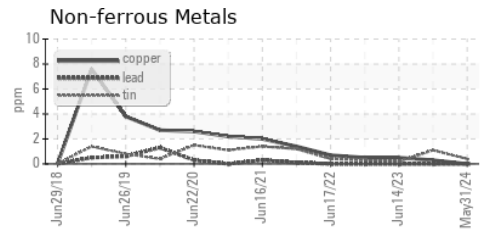

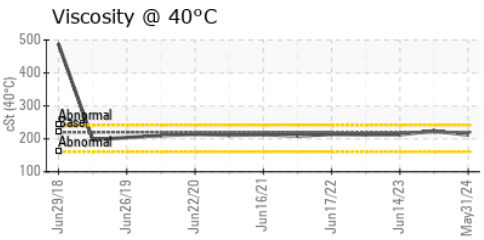

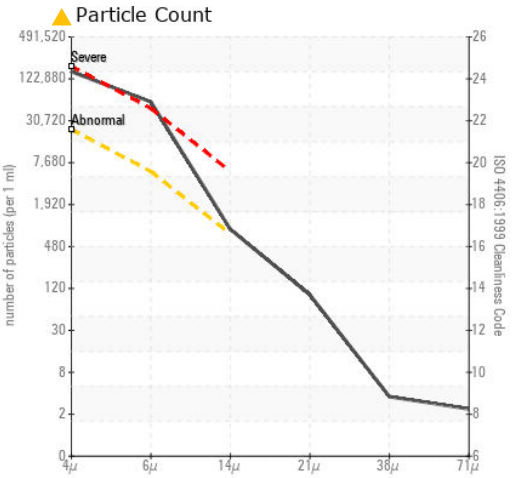

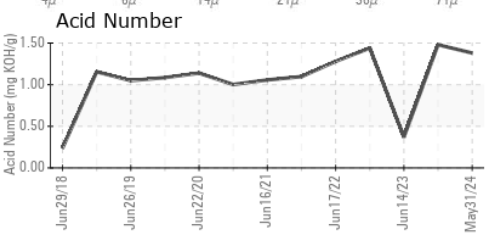

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0915915 **Received** : 10 Jun 2024
Lab Number : 06204558 **Tested** : 11 Jun 2024
Unique Number : 11072019 **Diagnosed** : 12 Jun 2024 - Angela Borella
Test Package : IND 2 (Additional Tests: PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

LUBRIZOL ADVANCED MATERIALS INC
207 TELEGRAPH DR
GASTONIA, NC
US 28056
Contact: TIMOTHY DAVIS
timothy.davis@lubrizol.com
T: (704)915-4131
F: x:

Report Id: LUBGAS [WUSCAR] 06204558 (Generated: 06/12/2024 18:48:49) Rev: 1
Contact/Location: TIMOTHY DAVIS - LUBGAS