


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL

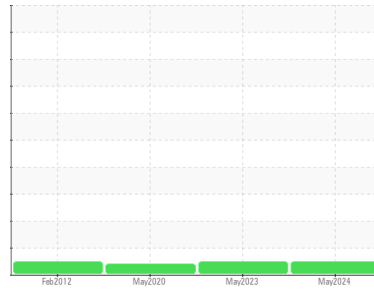

Machine Id
H-06
Component
Hydraulic System
Fluid
MOBIL DTE 10 EXCEL 32 (45 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			MHI020592	MHI021542	MHI022599
Sample Date	Client Info			16 May 2024	23 May 2023	12 May 2020
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	19685
Oil Changed	Client Info			N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	8	17	14
Chromium	ppm	ASTM D5185m	>20	0	<1	<1
Nickel	ppm	ASTM D5185m	>20	<1	0	<1
Titanium	ppm	ASTM D5185m		0	<1	0
Silver	ppm	ASTM D5185m		0	0	<1
Aluminum	ppm	ASTM D5185m	>20	0	2	0
Lead	ppm	ASTM D5185m	>20	0	0	1
Copper	ppm	ASTM D5185m	>20	<1	<1	2
Tin	ppm	ASTM D5185m	>20	0	0	0
Antimony	ppm	ASTM D5185m		---	---	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	<1
Barium	ppm	ASTM D5185m		<1	0	0
Molybdenum	ppm	ASTM D5185m		0	0	<1
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m		2	3	4
Calcium	ppm	ASTM D5185m	120	106	133	130
Phosphorus	ppm	ASTM D5185m	475	235	320	446
Zinc	ppm	ASTM D5185m		19	4	23
Sulfur	ppm	ASTM D5185m	1275	1111	1455	1439

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>+30	<1	<1	3
Sodium	ppm	ASTM D5185m		2	0	2
Potassium	ppm	ASTM D5185m	>20	2	2	<1
Water	%	ASTM D6304	>0.1	0.006	0.009	0.001
ppm Water	ppm	ASTM D6304	>1000	68	98	0.00

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	2523	3367	---
Particles >6µm		ASTM D7647	>1300	423	580	---
Particles >14µm		ASTM D7647	>160	31	27	---
Particles >21µm		ASTM D7647	>40	9	9	---
Particles >38µm		ASTM D7647	>10	0	1	---
Particles >71µm		ASTM D7647	>3	0	0	---
Oil Cleanliness		ISO 4406 (c)	>19/17/14	19/16/12	19/16/12	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.2	0.177	0.166


OIL ANALYSIS REPORT

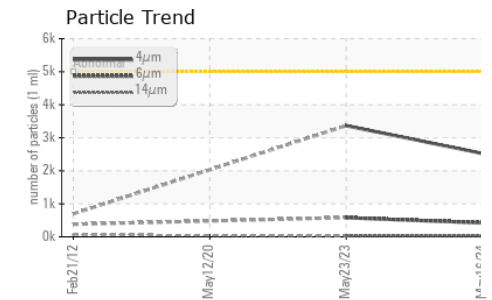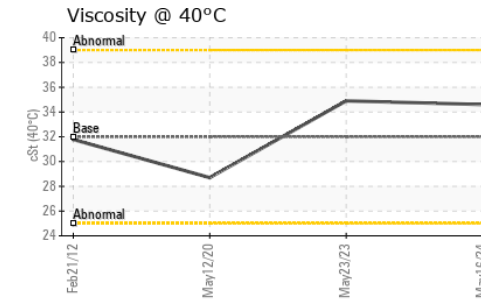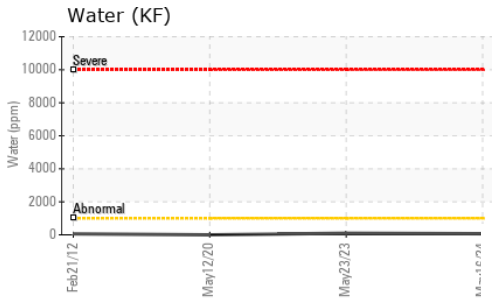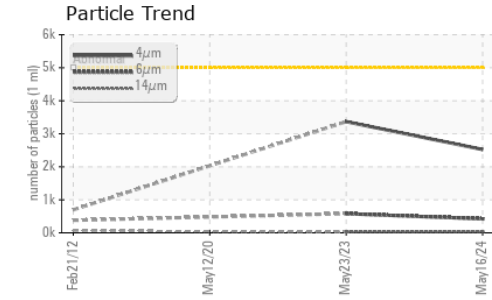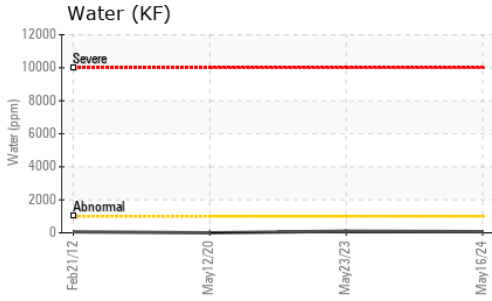






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 32	34.6	34.9	28.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

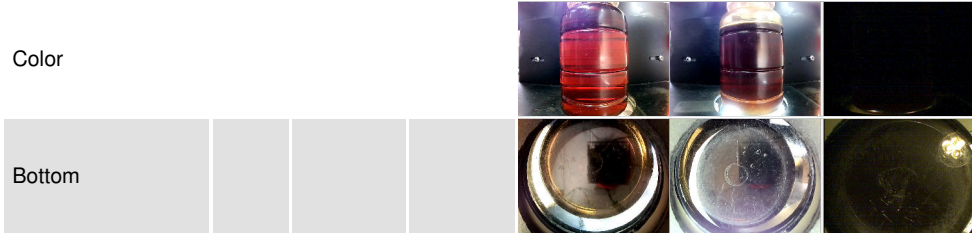

GRAPHS

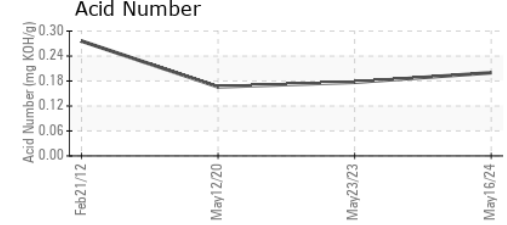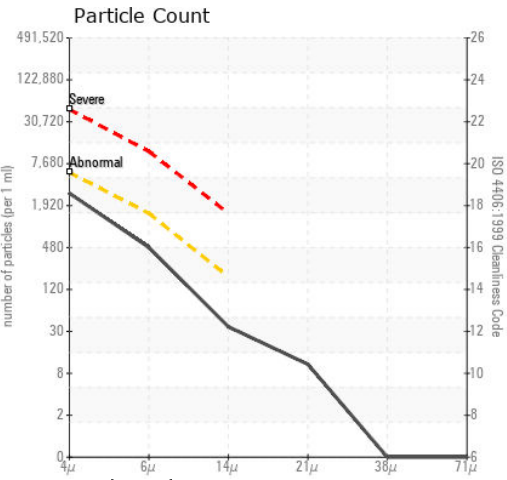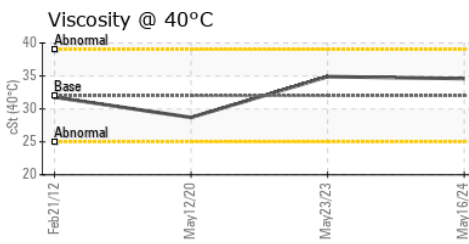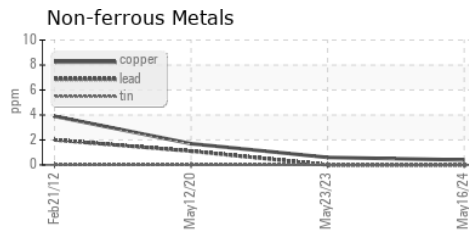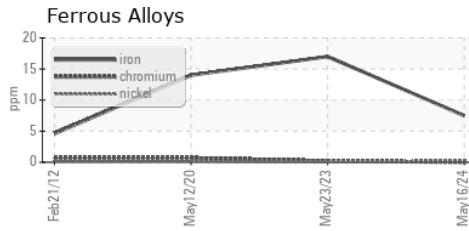

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : MHI020592 **Received** : 10 Jun 2024
Lab Number : 06204609 **Tested** : 12 Jun 2024
Unique Number : 11072070 **Diagnosed** : 12 Jun 2024 - Doug Bogart
Test Package : IND 2 (Additional Tests: KF)

DIAMOND WTG - WHITE DEER SITE - MPS WD
 PO BOX 872
 WHITE DEER, TX
 US 79097

To discuss this sample report, contact Customer Service at 1-800-237-1369.

Contact: WESLEY CAMPBELL
 wesley.campbell@diamondwtg.com

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

T: (806)883-1051

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (806)883-2004