




OIL ANALYSIS REPORT

Sample Rating Trend

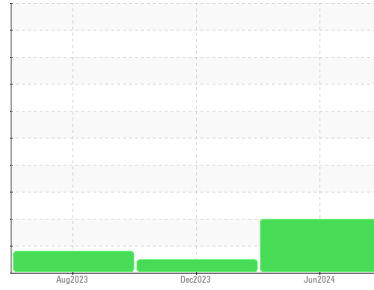

ISO



Area

Paper Machine

Machine Id

Vacuum Pump #7 Gearbox

Component

Gearbox

Fluid

MOBIL MOBILGEAR SHC 220 (35 GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0776421	WC0776495	WC0776539
Sample Date	Client Info		06 Jun 2024	27 Dec 2023	11 Aug 2023
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	NORMAL	ATTENTION

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >200	64	48	40
Chromium	ppm	ASTM D5185m >15	0	0	0
Nickel	ppm	ASTM D5185m >15	0	0	0
Titanium	ppm	ASTM D5185m	0	<1	<1
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >25	0	0	<1
Lead	ppm	ASTM D5185m >100	0	0	0
Copper	ppm	ASTM D5185m >200	<1	<1	<1
Tin	ppm	ASTM D5185m >25	0	0	0
Vanadium	ppm	ASTM D5185m	0	0	<1
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<1	0	0
Barium	ppm	ASTM D5185m	<1	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	2	<1	1
Magnesium	ppm	ASTM D5185m	<1	0	3
Calcium	ppm	ASTM D5185m	2	0	0
Phosphorus	ppm	ASTM D5185m	485	412	492
Zinc	ppm	ASTM D5185m	10	0	0
Sulfur	ppm	ASTM D5185m	2759	2107	2728

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	9	11	19
Sodium	ppm	ASTM D5185m	2	<1	1
Potassium	ppm	ASTM D5185m >20	3	0	2
Water	%	ASTM D6304 >0.2	0.005	0.011	0.008
ppm Water	ppm	ASTM D6304 >2000	59	115	87.3

FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	▲ 157743	13747	● 36057
Particles >6µm	ASTM D7647	>5000	▲ 105475	975	1498
Particles >14µm	ASTM D7647	>640	▲ 13162	35	27
Particles >21µm	ASTM D7647	>160	▲ 1855	8	4
Particles >38µm	ASTM D7647	>40	24	0	0
Particles >71µm	ASTM D7647	>10	1	0	0
Oil Cleanliness	ISO 4406 (c)	>21/19/16	▲ 24/24/21	21/17/12	● 22/18/12

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.07	1.04	0.99




OIL ANALYSIS REPORT

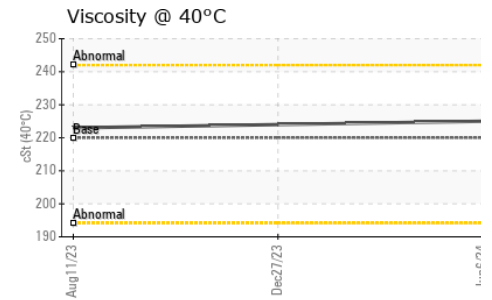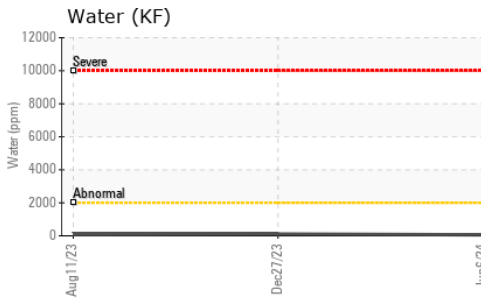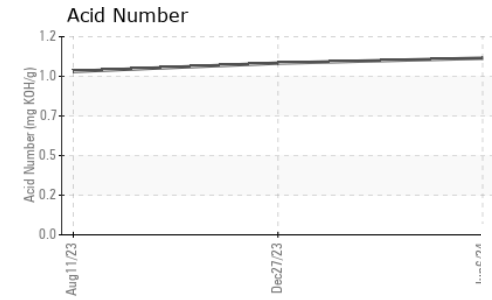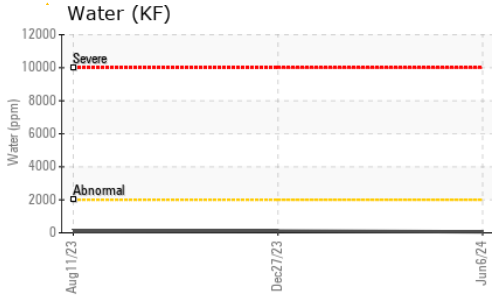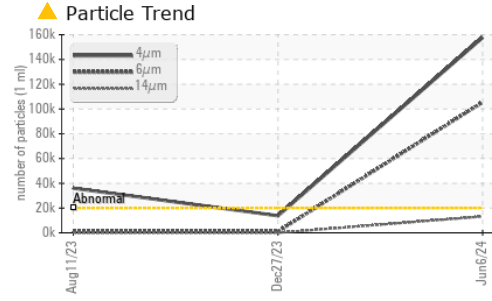




VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	MODER	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	220	225	224

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

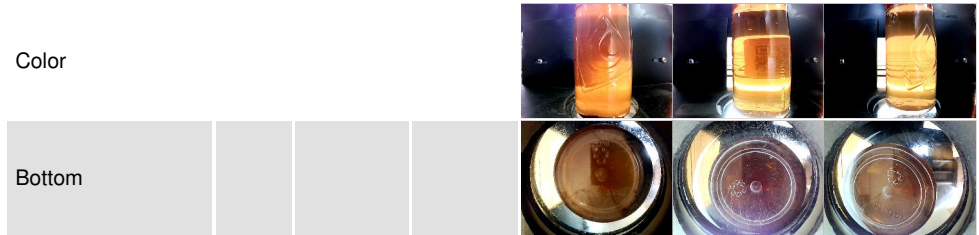

GRAPHS

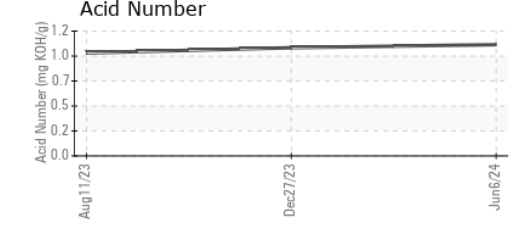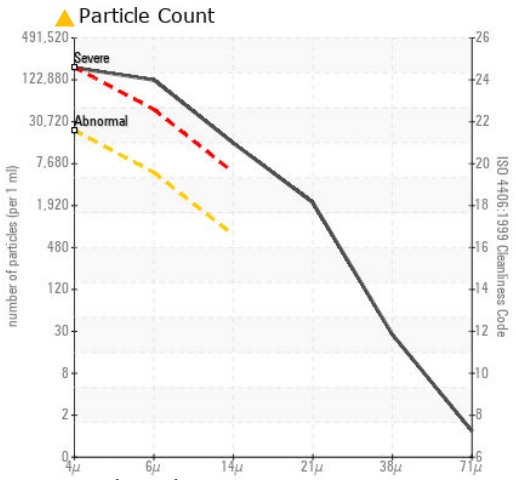

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0776421
Lab Number : 06204626
Unique Number : 11072087
Test Package : PLANT

Received : 10 Jun 2024
Tested : 12 Jun 2024
Diagnosed : 12 Jun 2024 - Doug Bogart

CASCADES CONTAINERBOARD PACKAGING - BEARPACK PROJECT
 10026 OLD RIDGE ROAD
 ASHLAND, VA
 US 23005
 Contact: MARC-ANDRE HUBERT
 marc-andre_hubert@cascades.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)